



Applied Systems

Technical Data

Round flow cassette



EEDEN15-400

FWC-BF

TABLE OF CONTENTS

FWC-BF

1	Features	2
2	Specifications	3
	Technical Specifications	3
	Electrical Specifications	4
3	Electrical data	5
4	Safety device settings	6
5	Options	7
6	Capacity tables	9
	Cooling Capacity Tables	9
	Heating Capacity Tables	10
7	Dimensional drawings	11
8	Centre of gravity	13
9	Piping diagrams	14
10	Sound data	15
	Sound Power Spectrum	15
	Sound Pressure Spectrum	16
11	Hydraulic performance	17
	Water Pressure Drop Curve Evaporator	17

1 Features

BLDC fan motor unit for ceiling mounting. 360° air discharge

- 360° air discharge ensures uniform air flow and temperature distribution
- Modern style decoration panel in white (RAL9010)
- Fresh air intake integrated in the same system thus reducing installation cost as no additional ventilation is required
- Comfortable horizontal air discharge ensures draughtfree operation and prevents ceiling soiling
- Possibility to shut 1 or 2 flaps for easy installation in corners
- Standard drain pump with 850mm lift increases flexibility and installation speed



2 Specifications

2-1 Technical Specifications					FWC06BF	FWC07BF	FWC08BF	FWC09BF
Cooling capacity	Total capacity	Super high	kW		5.8 (1)	6.6 (1)	7.6 (1)	8.7 (1)
		High	kW		4.9 (1)	5.6 (1)	6.3 (1)	7.2 (1)
		Low	kW		4.0 (1)	4.6 (1)	4.8 (1)	5.7 (1)
	Sensible capacity	Super high	kW		4.1 (1)	4.7 (1)	5.6 (1)	6.5 (1)
		High	kW		3.4 (1)	3.9 (1)	4.4 (1)	5.2 (1)
		Low	kW		2.7 (1)	3.2 (1)	3.4 (1)	4.0 (1)
Heating capacity	4-Pipe	Super high	kW		7.5 (2)	8.4 (2)	9.7 (2)	11.0 (2)
		High	kW		6.2 (2)	6.8 (2)	7.8 (2)	8.8 (2)
		Low	kW		5.5 (2)	5.9 (2)	6.7 (2)	7.8 (2)
Power input	Super high		W	46	55	77	107	
	High		W	41	47	59	77	
	Low		W	35	38	40	46	
Dimensions	Unit	Height	mm	288				
		Width	mm	840				
		Depth	mm	840				
Weight	Unit			kg	29			
Decoration panel	Dimensions	Packed unit	Width	mm	-			
Heat exchanger	Type				Cross fin coil (multi louver fins and plane tubes)			
	Inside length	Cooling	mm		2,096			
		Heating	mm		2,039			
	Outside length	Cooling	mm		2,153			
		Heating	mm		2,039			
	Passes	Quantity	Cooling	10				
			Heating	5				
	Rows	Quantity		3				
	Stages	Cooling		12				
		Heating		10				
	Empty tubeplate hole	Quantity		0				
	Fin pitch			mm	1.5			
Face area - Dimensions	Cooling		m²	0.535				
	Heating		m²	0.343				
Water pressure drop	Cooling		kPa	15	19	25	32	
	Heating		kPa	24	30	38	47	
Fan	Type			Turbo fan				
	Quantity			1				
	Air flow rate	High	m³/h	1,032	1,200	1,476	1,746	
		Medium	m³/h	864	1,002	1,164	1,374	
		Low	m³/h	684	804	852	1,014	
Fan motor	Speed	Steps		3				
	Model			QTS48C15M				
	Output		W	120				
Sound power level	Super high		dBA	43	47	53	57	
	High		dBA	36	39	44	49	
	Low		dBA	31	36		40	
Sound pressure level	Super high		dBA	29	33	39	43	
	High		dBA	24	28	32	37	
	Low		dBA	21	22	24	28	
Piping connections	Water	Inlet		3/4" BSP (female thread)				
		Outlet		3/4" BSP (female thread)				
	Drain	OD	mm	VP25 (External dia.32 / internal dia. 25)				
Allowed water temperature	Min.		°C	5 (3)				
	Max.		°C	70 (3)				
Control systems	Infrared remote control			BRC7E532F / BRC7E533F				
	Wired remote control			BRC315D7				

2 Specifications

Standard Accessories : Washer for hanger bracket;
 Standard Accessories : Clamp for drain hose;
 Standard Accessories : O ring;
 Standard Accessories : Installation guide;
 Standard Accessories : Screws;
 Standard Accessories : Insulation;
 Standard Accessories : Drain hose;
 Standard Accessories : Installation and operation manual;

2-2 Electrical Specifications			FWC06BF	FWC07BF	FWC08BF	FWC09BF
Power supply	Phase		1~			
	Frequency	Hz	50			
	Voltage	V	220-240			

Notes

- (1) Cooling: air 27°CDB, 19°CWB; entering water 7°C; leaving water 12°C
 (2) Do not let water of less than 5°C or more than 50°/70°C enter the unit, this may damage the unit
 (3) Height includes switch box
 Heating: 4 pipe: air 20°CDB; entering water 70°C; leaving water 60°C

3 Electrical data

3 - 1 Electrical Data

FWC-BT/BF

Units					Power supply		IFM		Input (W)	
Model	Type	Hz	Voltage range	Voltage limits	MCA	MFA	kW	FLA	Cooling	Heating
FWC06BT	V1	50	220-240	Max. 264 Min. 198	0.3	16	0.120	0.2	45	45
FWC07BT					0.4	16	0.120	0.3	54	54
FWC08BT					0.6	16	0.120	0.5	77	77
FWC09BT					0.9	16	0.120	0.7	107	107
FWC06BF					0.3	16	0.120	0.2	46	46
FWC07BF					0.4	16	0.120	0.3	55	55
FWC08BF					0.6	16	0.120	0.5	77	77
FWC09BF					0.9	16	0.120	0.7	107	107

SYMBOLS

MCA : Min. Circuit Amps. (A)
 MFA : Max. Fuse Amps. (See note 5)
 kW : Fan Motor Rated Output (kW)
 FLA : Full Load Amps. (A)
 IFM : Indoor Fan Motor

NOTES

- Voltage limits:
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.
- Maximum allowable voltage unbalance between phases is 2%
- MCA/MFA:
 $MCA = 1.25 \times FLA$
 $MFA \leq 4 \times FLA$
 (Next lower standard fuse rating min. 16A)
- Select wire size based on the MCA
- Instead of fuse, use Circuit Breaker.

4TW33121-2

4 Safety device settings

4 - 1 Safety Device Settings

FWC-BT/BF

	Safety devices		6	7	8	9
FWC-BT/BF	PC board fuse		250V 5A	250V 5A	250V 5A	250V 5A
	Fan motor thermal fuse	°C	-	-	-	-
	Fan motor thermal protector	°C	OFF: 108 ^{±5} (ON: 96 ^{±15})	OFF: 108 ^{±5} (ON: 96 ^{±15})	OFF: 108 ^{±5} (ON: 96 ^{±15})	OFF: 108 ^{±5} (ON: 96 ^{±15})
	Drain pump fuse	°C	145	145	145	145

3TW33129-4

5 Options

5 - 1 Options

FWC-BT/BF

Options

Item	Model	FWC06-09B
1	Decoration Panel - Standard (RAL 9010 - grey sealings)	Round flow
2	Decoration Panel - White (RAL 9010 - white sealings)	Round flow
3	Sealing member of air discharge outlet	KDBHQ55C140
4	Long-life filter	KAFP551K160
5	Fresh air intake kit (20% fresh air)	Direct installation type
		KDDQ55C140-1 (*13)
		KDDQ55C140-2 (*13)

Control system

Item	Model	FWC06-09B
1	Remote control	Infrared
		H/P
		C/O
	Wired	BRC7F532F (*11)
2	Central remote control	BRC7F533F (*11)
2.1	Electrical box with earth terminal (3 blocks)	BRC315D7 (*1)
3	Unified on/off controller	DCS302CA51 (*2)
3.1	Electrical box with earth terminal (2 blocks)	KJB311A
4	Schedule timer	DCS301BA51 (*5)
5	Wiring adapter for electrical appendices (1)	KJB212A
6	Wiring adapter for electrical appendices (2)	DST301BA51 (*5)(*8)
7	Installation box for adapter PCB	KRP2A52 (*4)(*8)
8	Remote sensor	KRP4AA53 (*4)(*8)
10	Intelligent touch controller	KRP1H98 (*9)
10.1	Electrical installation box	KRCS01-4
11	Optional PCB for MOD-bus connection	DCS601C51C (*3)(*7)
12	2-way valve - On/Off	KJB411A
13	3-way valve - On/Off	EKFCMB7 (*4)(*8)
14	Valve control PCB	EKMV2C09B7 (*4)(*6)(*10)
		EKMV3C09B7 (*4)(*6)(*10)
		EKR1C11

NOTES

- *1. Optional, electrical installation box with earth terminal KJB212A is required, if controller wires need to be installed in the wall.
- *2. Requires electrical installation box with earth terminal KJB311A.
- *3. Requires electrical installation box KJB411A.
- *4. Requires installation box KRP1H98.
- *5. Requires electrical installation box with earth terminal KJB212A if built in the wall.
- *6. Requires valve control PCB EKR1C11.
- *7. I-touch:
 - Not allowed to use the i-touch for an installation with both fan coils and VRV® units.
 - Can not be used in combination with fan coil units, that use MOD bus communication.
 - No Airnet or telephone connection possible.
- *8. Only 1 of these 4 options can be installed on 1 indoor unit.
- *9. Max. 1 KRP1H98 box can be mounted on the unit. Max. 2 PCB's can be mounted in 1 KRP1H98 box.
- *10. 2-pipe unit: 1 x valve kit + 1 x installation box for PCB KRP1H98 + 1 x valve control PCB EKR1C11
4-pipe unit: 2 x valve kit + 1 x installation box for PCB KRP1H98 + 1 x valve control PCB EKR1C11
- *11. It is possible to change the operation mode, but this will not have an impact on the water temperature.
(No feed back to water source)
It is not possible to select the "auto air flow" setting.
Dry operation can be selected with this remote control, but this function is not available on the FWC model.
- *12. All options are supplied as kit.
- *13. Both parts of the fresh air intake are needed for each unit.

3TW33129-1B

5 Options

5 - 1 Options

5

FWC-BT/BF

Brief description of purpose of the available options:

	Item	Model	FWC06-09BT/BF	Description
1	Decoration Panel - Standard (RAL 9010 - grey sealings)	Round flow	BYCQ140CW1	Decoration panel for the fan coil unit that is built in the false sealing. Mandatory when installing the fan coil unit.
2	Decoration Panel - White (RAL 9010 - white sealings)	Round flow	BYCQ140CW1W	Decoration panel for the fan coil unit that is built in the false sealing. Mandatory when installing the fan coil unit.
3	Sealing member of air discharge outlet		KDBHQ55C140	This option can be used in case the fan coil unit is installed close to a wall on one or more sides (closer than 1500 mm). With the blocking parts one or more air outlets of the fan coil unit can be closed --> Fan coil unit can be installed closer to a wall (but further then 200mm).
4	Long-life filter		KAFP551K160	High quality filter that can be used if supplied filter is damaged.
5	Fresh air intake kit (20% fresh air)	Direct installation type	KDDQ55C140-1 KDDQ55C140-2	Kit that can be connected to the ventilation system to supply fresh air to the fan coil unit. Both parts of the fresh air intake kit are needed for each unit
6	Remote control	Infrared	H/P BRC7E532F	Infrared remote control to control each fan coil unit independently with cooling and heating functionality. It's not possible to select auto air flow with this remote control. Also there is no feedback regarding the operation mode to the "water supply unit". --> Changing the operation mode will not have an effect on the supplied water temperature. Dry operation can be selected, but the FWF unit does not have this function.
			C/O BRC7E533F	Infrared remote control to control each fan coil unit independently with cooling functionality. It's not possible to select auto air flow with this remote control. Also there is no feedback regarding the operation mode to the water supply unit. --> Changing the operation mode will not have an effect on the supplied water temperature. Dry operation can be selected, but the FWF unit does not have this function.
		Wired	BRC315D7	Wired remote control to control each fan coil unit independently with cooling and heating functionality. There is no weekly timer function in this remote control. Only a limited on/off timer function is available. In case wires need to be installed inside the wall, the KJB212A installation box is required.
7	Central remote control		DCS302CA51	Remote control for centralized control of all connected fan coil units (only FWF and FWC type).
7.1	Electrical box with earth terminal (3 blocks)		KJB311A	Requires the KJB311A electrical installation box for the installation.
8	Unified on/off control		DCS301BA51	Remote control to switch all connected fan coil units (only FWC and FWF type) ON or OFF.
8.1	Electrical box with earth terminal (2 blocks)		KJB212A	In case unified on/off controller is built in the wall, the electrical box KJB212A kit is required.
9	Schedule timer		DST301BA51	Controller with schedule timer functionality for the fan coil units (only FWC and FWF). It's not possible to combine this option with neither KRP2A52 nor KRP4AA53 nor EKFCMBCB7 on the same fan coil unit. In case the schedule timer is built in the wall, the electrical box KJB212A is required.
10	Intelligent touch control		DCS601C51C	Advanced remote control for centralized control of all connected fan coil units (but only FWF and FWC type and up to 128 fan coil units). More functions are possible than with the central remote control. Compared to VRF systems, it's not possible to use AIRNET and telephone connection. The I-touch can not be used for installations with both DX units and fan coil units. The I-touch can not be used for installations with fan coil units that use Mod Bus communication.
10.1	Electrical installation box		KJB411A	Electrical installation box KJB411A is needed for the installation of the I-touch remote control.
11	Remote sensor		KRCS01-1	Sensor to measure the room temperature remotely from a location other than the fan coil unit or the remote control.
12	2-way valve - On/Off		EKMV2C09B7	2-way valve to control the water supply to the fan coil unit. The option kit EKRP1C11 is needed to control the valve.
13	3-way valve - On/Off		EKMV3C09B7	3-way valve to control the water supply to the fan coil unit. The option kit EKRP1C11 is needed to control the valve.
14	Valve control PCB		EKRP1C11	PCB to control the 2-way and 3 way valves. Only 1 option kit is needed per fan coil unit. It is possible to connect 2 valves on 1 PCB. For the installation of the PCB, the installation box KRP1H98 is required.
15	Optional PCB for MOD-bus connection		EKFCMBCB7	PCB to transform the DIII communication of the FWC and FWF fan coil units to Mod Bus RTU RS485 communication. For the installation of the PCB, the installation box KRP1 H98 is required. It's not possible to combine this option with KRP2A52 or KRP4AA53 or DST301BA51 on the same fan coil unit.
16	Wiring adapter for electrical appendices (1)		KRP2A52	PCB with additional connection for external input/output signals. For the installation of the PCB, the installation box KRP1 H98 is required. It's not possible to combine this option with KRP4AA53 or EKFCMBCB7 or DST301 BA51 on the same fan coil unit. Example of input signals: set point, on/off contact. Example of outputs: error stats of fan coil unit, operation status of fan coil unit (on/off). This PCB can control all FWC and FWF fan coil units connected on the same F1/F2 communication wire.
17	Wiring adapter for electrical appendices (2)		KRP4AA53	PCB with additional connection for external input/output signals. For the installation of the PCB, the installation box KRP1H98 is required. It's not possible to combine this option with KRP2A52 or EKFCMBCB7 or DST301BA51 on the same fan coil unit. Example of input signals: set point, on/off contact. Example of outputs: error stats of fan coil unit, operation status of fan coil unit (on/off). This PCB can control only FWC and FWF fan coil units connected on the same P1/P2 remote control communication wire.
18	Installation box for adapter PCB		KRP1H98	Installation box for some option kits. Max. 1 box can be installed on a single FWC unit. 2 PCB's can be installed in 1 box.

3TW33129-2A

8

6 Capacity tables

6 - 1 Cooling Capacity Tables

6

FWC-BF

Air temperature (°CDB - °CWB)		22-16															
Water temperature (Entering °C - Leaving °C)		6-11				7-12				6-13				9-14			
Model	Air flow	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)
FWC06BF	HH	3.9	2.9	11.5	8	3.3	2.6	10.1	7	2.7	2.4	9.0	6	2.2	2.1	7.7	5
	H	3.4	2.4	9.8	6	2.9	2.2	8.7	5	2.4	2.0	8.1	5	2.0	1.8	7.5	5
	L	2.8	2.0	8.1	5	2.4	1.9	7.8	5	2.1	1.8	7.0	4	1.6	1.6	6.5	5
FWC07BF	HH	4.5	3.4	13.0	10	4.0	3.1	11.5	8	3.3	2.8	10.1	7	2.6	2.5	8.6	5
	H	3.9	2.8	11.0	8	3.2	2.6	9.9	6	2.6	2.3	8.7	5	2.1	2.0	7.9	5
	L	3.2	2.4	9.3	6	2.7	2.2	8.1	5	2.3	2.1	7.4	4	1.8	1.8	6.8	5
FWC08BF	HH	5.1	3.8	15.0	1.3	4.3	3.5	13.1	10	3.5	2.9	11.4	8	2.8	2.6	9.7	6
	H	4.3	3.2	12.4	9	3.8	2.9	11.1	8	3.3	2.6	9.4	6	2.4	2.3	8.3	5
	L	3.4	2.5	9.7	6	2.9	2.3	8.6	5	2.7	2.2	7.8	5	1.9	1.9	7.0	5
FWC09BF	HH	5.7	4.4	17.0	15	4.8	3.8	15.1	13	4.2	3.3	12.8	10	3.2	2.8	11.0	7
	H	4.9	3.8	14.0	11	4.2	3.4	12.5	9	3.4	2.9	10.8	7	2.7	2.5	9.4	6
	L	4.0	3.0	11.4	8	3.4	2.7	10.0	7	2.8	2.4	8.8	5	2.1	2.1	7.7	5

Air temperature (°CDB - °CWB)		25-18															
Water temperature (Entering °C - Leaving °C)		6-11				7-12				6-13				9-14			
Model	Air flow	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)
FWC06BF	HH	5.5	3.8	16.0	14	5.0	3.6	14.4	12	4.4	3.2	12.6	9	3.8	2.9	11.0	8
	H	4.7	3.1	13.6	11	4.2	2.9	12.0	9	3.7	2.7	10.6	7	3.2	2.5	9.4	6
	L	3.8	2.5	11.0	8	3.5	2.4	10.0	7	3.2	2.2	8.7	5	2.8	2.1	7.8	5
FWC07BF	HH	6.3	4.4	18.0	17	5.7	4.1	16.4	15	5.1	3.7	14.0	11	4.5	3.4	12.3	9
	H	5.3	3.7	15.4	13	4.8	3.4	13.9	11	4.2	3.1	12.0	9	3.6	2.9	10.7	7
	L	4.4	3.0	12.7	10	4.0	2.8	11.3	8	3.7	2.6	10.0	7	3.1	2.5	9.0	6
FWC08BF	HH	7.2	5.2	20.7	22	6.5	4.8	18.7	18	5.8	4.3	16.0	14	5.0	3.8	14.1	11
	H	6.0	4.1	17.4	16	5.4	3.9	15.7	14	4.8	3.5	13.5	11	4.1	3.3	12.0	9
	L	4.7	3.2	13.4	10	4.2	3.0	12.0	9	3.8	2.8	10.4	7	3.2	2.5	9.2	6
FWC09BF	HH	8.0	5.9	24.0	28	7.2	5.5	21.3	23	6.3	4.9	18.0	17	5.3	4.3	16.1	14
	H	6.9	4.9	20.0	20	6.2	4.5	17.7	17	5.4	4.1	15.2	13	4.6	3.9	13.6	11
	L	5.4	3.8	15.7	14	5.0	3.5	14.3	12	4.4	3.2	12.4	9	3.7	3.0	11.0	8

NOTES

1. ☐ The capacity is only guaranteed at the nominal conditions

3TW33122-2

FWC-BF

Air temperature (°CDB - °CWB)		27-19															
Water temperature (Entering °C - Leaving °C)		6-11				7-12				6-13				9-14			
Model	Air flow	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)
FWC06BF	HH	6.3	4.3	18.0	17	5.8	4.1	16.7	15	5.3	3.8	15.0	15	4.5	3.5	13.0	10
	H	5.3	3.6	15.2	13	4.9	3.4	14.0	11	4.4	3.2	12.7	10	3.9	2.9	11.0	8
	L	4.3	2.9	12.5	9	4.0	2.7	11.5	8	3.6	2.5	10.3	7	3.2	2.4	9.2	6
FWC07BF	HH	7.1	5.0	20.5	21	6.6	4.7	18.9	19	5.9	4.4	17.0	15	5.1	4.0	14.7	12
	H	6.0	4.1	17.3	16	5.6	3.9	16.0	14	5.0	3.6	14.4	12	4.4	3.4	12.4	9
	L	5.0	3.4	14.2	11	4.6	3.2	13.2	10	4.1	3.0	11.8	8	3.6	2.8	10.5	7
FWC08BF	HH	8.2	5.9	23.5	27	7.6	5.6	21.6	23	6.8	5.2	19.6	20	5.8	4.7	16.6	15
	H	6.8	4.6	19.7	20	6.3	4.4	18.0	17	5.6	4.1	16.0	14	4.9	3.8	14.0	11
	L	5.2	3.6	15.0	13	4.8	3.4	13.8	11	4.3	3.2	12.3	9	3.8	3.0	11.0	8
FWC09BF	HH	9.3	6.7	27.0	35	8.7	6.5	24.8	30	7.8	6.0	22.3	25	6.5	5.3	19.2	19
	H	7.8	5.5	22.4	25	7.2	5.2	20.5	21	6.4	4.8	18.3	18	5.6	4.5	16.0	14
	L	6.2	4.2	18.0	17	5.7	4.0	16.2	14	5.2	3.8	15.0	13	4.5	3.5	12.7	10

Air temperature (°CDB - °CWB)		30-32															
Water temperature (Entering °C - Leaving °C)		6-11				7-12				6-13				9-14			
Model	Air flow	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Total cooling capacity (kW)	Sensible cooling capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)
FWC06BF	HH	8.8	5.1	25.0	30	8.2	4.8	23.7	28	7.7	4.6	22.0	24	7.1	4.4	20.4	21
	H	7.4	4.2	21.0	22	7.0	4.0	20.0	20	6.5	3.8	18.5	18	6.0	3.6	17.0	15
	L	6.0	3.4	17.4	16	5.7	3.2	16.3	14	5.3	3.0	15.0	13	4.9	2.9	14.0	11
FWC07BF	HH	10.0	5.8	28.5	38	9.4	5.6	27.0	35	8.7	5.3	25.0	30	8.1	5.0	23.2	27
	H	8.5	4.8	24.5	29	8.0	4.6	23.0	26	7.4	4.4	21.0	22	6.8	4.1	19.4	19
	L	6.9	4.0	20.0	20	6.5	3.8	18.5	18	6.1	3.6	17.5	16	5.6	3.4	16.0	14
FWC08BF	HH	11.6	6.9	33.0	50	10.9	6.6	31.5	46	10.1	6.2	29.0	40	9.3	5.9	26.5	34
	H	9.6	5.5	27.5	36	9.0	5.2	26.0	32	8.4	5.0	24.0	28	7.7	4.7	22.0	24
	L	7.3	4.2	21.0	22	6.8	4.0	19.5	20	6.4	3.8	18.4	18	5.9	3.6	17.0	15
FWC09BF	HH	13.2	7.9	38.5	67	12.3	7.5	36.0	59	11.5	7.2	33.5	52	10.6	6.8	30.5	43
	H	11.0	6.5	31.5	46	10.3	6.2	29.5	41	9.6	5.9	27.5	36	8.8	5.5	25.0	30
	L	8.7	5.0	25.0	30	8.1	4.7	23.5	27	7.6	4.5	21.5	23	7.0	4.3	20.0	20

NOTES

1. ☐ The capacity is only guaranteed at the nominal conditions

3TW33122-2

6 Capacity tables

6 - 2 Heating Capacity Tables

6

FWC-BF										
Air temperature (°CDB - °CWB)		20								
Water temperature (Entering °C - Leaving °C)		50-45			60-50			70-60		
Model	Airflow	Heating capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Heating capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Heating capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)
FWC06BF	HH	4.5	13.0	27	5.5	7.9	12	7.5	12.2	24
	H	3.8	11.0	20	4.6	6.7	9	6.2	8.9	14
	L	3.4	9.7	16	4.1	6.0	8	5.5	7.9	12
FWC07BF	HH	5.0	14.7	33	6.1	8.8	14	8.4	14.0	30
	H	4.2	12.1	24	5.1	7.4	11	6.8	9.7	16
	L	3.6	10.5	19	4.4	6.4	8	5.9	8.5	13
FWC08BF	HH	5.8	17.0	43	7.0	10.1	18	9.7	15.9	38
	H	4.8	14.0	30	5.8	8.4	13	7.8	11.2	21
	L	4.1	12.0	23	5.0	7.3	10	6.7	9.6	16
FWC09BF	HH	6.6	19.0	52	8.0	11.5	22	11.0	18.0	47
	H	5.4	15.8	38	6.6	9.5	16	8.8	12.6	25
	L	4.8	14.0	30	5.9	8.5	13	7.8	11.2	21

Air temperature (°CDB - °CWB)		22								
Water temperature (Entering °C - Leaving °C)		50-45			60-50			70-60		
Model	Airflow	Heating capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Heating capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)	Heating capacity (kW)	Water flow (l/min)	Water pressure drop (kPa)
FWC06BF	HH	4.1	12.0	23	5.1	7.4	11	6.9	10.0	17
	H	3.5	10.2	18	4.3	6.2	8	5.9	8.4	13
	L	3.1	9.0	15	3.9	5.6	7	5.2	7.5	11
FWC07BF	HH	4.6	13.5	29	5.7	8.2	12	7.7	11.1	20
	H	3.9	11.2	21	4.8	6.9	9	6.5	9.3	15
	L	3.3	9.8	17	4.1	6.0	8	5.6	8.1	12
FWC08BF	HH	5.4	15.5	36	6.6	9.5	16	8.9	12.9	26
	H	4.4	12.8	26	5.4	7.8	11	7.4	10.7	19
	L	3.8	11.0	20	4.75	6.8	9	6.3	9.1	15
FWC09BF	HH	6.1	17.5	45	7.5	10.8	20	10.1	14.6	33
	H	5.0	14.5	32	6.1	8.8	14	8.3	12.0	23
	L	4.4	12.8	26	5.5	7.9	12	7.4	10.6	19


3TW33122-1

7 Dimensional drawings


7 - 1 Dimensional Drawings

FWC-BT/BF


• Remote control dimensions

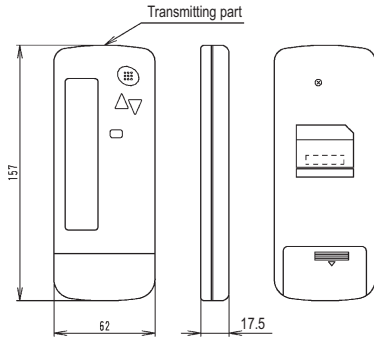


• Remote control holder installation procedure (Installation to wall surface)

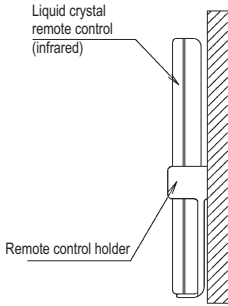

• Receiver detail



• Receiver installation procedure


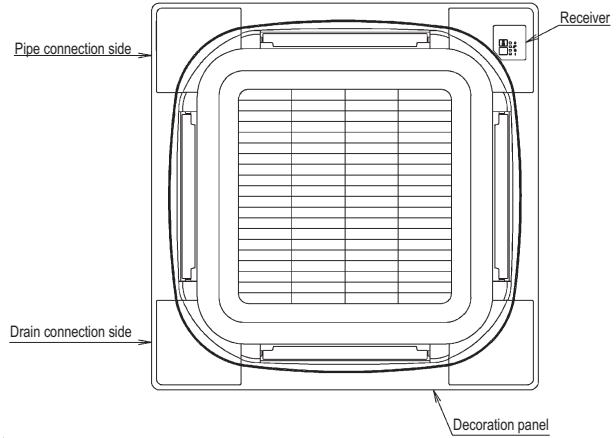


• Infrared remote control kit for each decoration panel

Infrared remote control kit	Decoration panel
BRC7F532F / BRC7F533F	BYCQ140CW1

3D056851


FWC06-09BT/BF

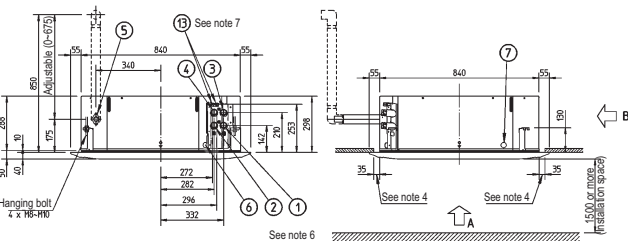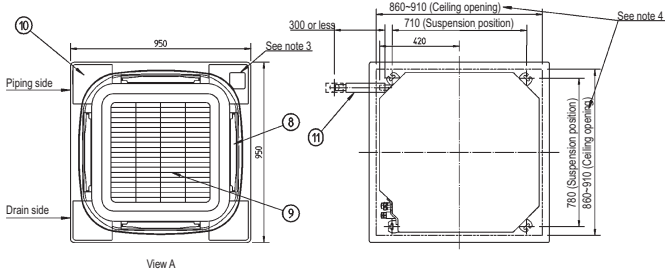

Item	Name	Description
1	Water pipe connection cooling in	3/4" BSP female
2	Water pipe connection cooling out	3/4" BSP female
3	Water pipe connection heating in	3/4" BSP female
4	Water pipe connection heating out	3/4" BSP female
5	Drain pipe connection	3/4" BSP female
6	Power supply entry hole	VP25 (O.D. ø32, I.D. ø25)
7	Transmission wiring entry hole	
8	Air discharge opening	
9	Air suction grille	
10	Corner decoration cover	
11	Drain hose	O.D. ø32, I.D. ø26
12	Knock out hole	
13	Air purge	

NOTES

- Location of the nameplates:
 - Unit body: on the control box cover.
 - Decoration panel: on the panel frame at the motor side under the corner cover
- When installing an optional accessory, refer to the installation drawings.
 - For the fresh air intake kit an inspection part is necessary
- In case of using an infrared remote control, this position will be a signal receiver. Refer to the drawing of the infrared remote control for more detail.
- Make sure the spacing between the ceiling and the cassette is no more than 35mm. Max. ceiling opening: 910 mm.
- When the conditions exceed 30°C and RH 80% in the ceiling or fresh air is inducted into the ceiling, an additional insulation is required (polyethylene foam, thickness 10mm or more)
- Only models FWC06-09BFV1B have heating pipe connections item 3 and item 4.
For models FWC06-09B7TW1B water pipe connections, item 1 and item 2, are used for heating and cooling.
- Models FWC06-09BTV1B have only one air purge (they have no separate heating circuit).
- Please respect the distances as shown on figure below:

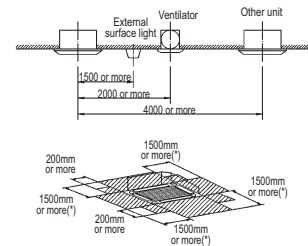


(*) In case a discharge opening is closed with the 'sealing member' option, the distance of 1500mm can be reduced to 500mm on the closed side.

3TW33124-1

7 Dimensional drawings

7 - 1 Dimensional Drawings

FWC06-09BT/BF

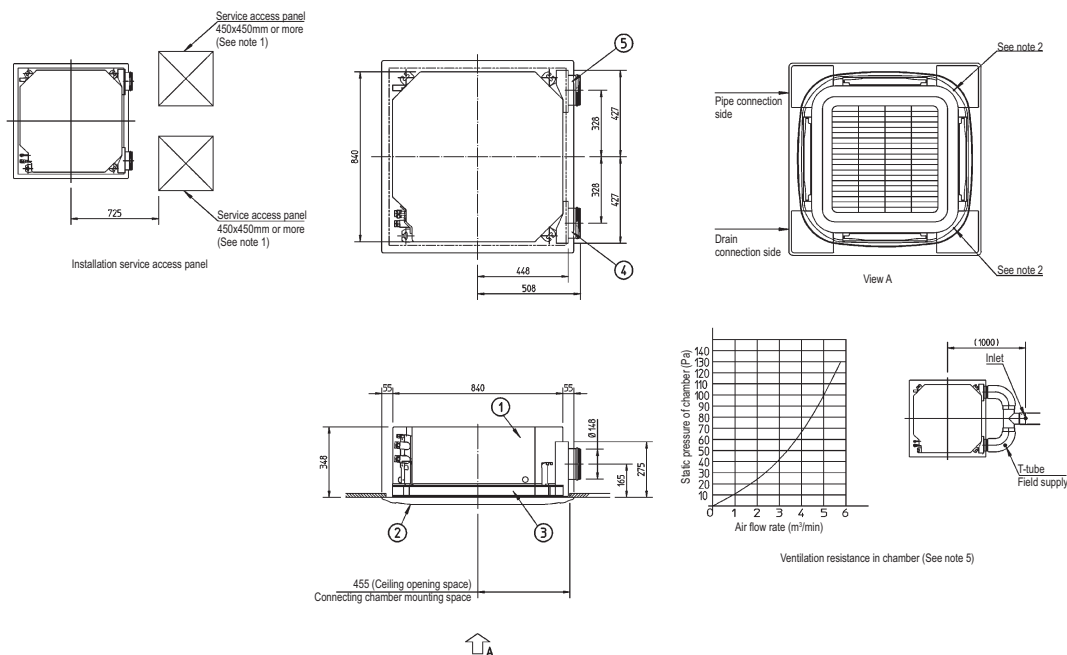

3TW33124-2

Item	Name	Remark
1	Indoor unit	-
2	Decoration panel	-
3	Suction chamber	-
4	Connecting chamber (right)	-
5	Connecting chamber (left)	-


NOTES

- When installing this kit, inspection hatch is necessary. (It is necessary for servicing)
Either one of inspection hatches must be installed.
- The corner air outlet of this part must be shut.
- In case of mounting a duct fan, make sure to use a wiring adapter for electrical appendices and link with the indoor unit fan.
- The intake air flow rate is recommended to be 20% or less of the H speed air flow rate. If the intake air flow rate is too large, the operating sound may rise or detection of the indoor unit suction temperature may be affected.
- This indicates the distance between the T-tube inlet and the indoor unit inlet, when the T-tube is connected.

8 Centre of gravity

8 - 1 Centre of Gravity

FWC-BT/BF

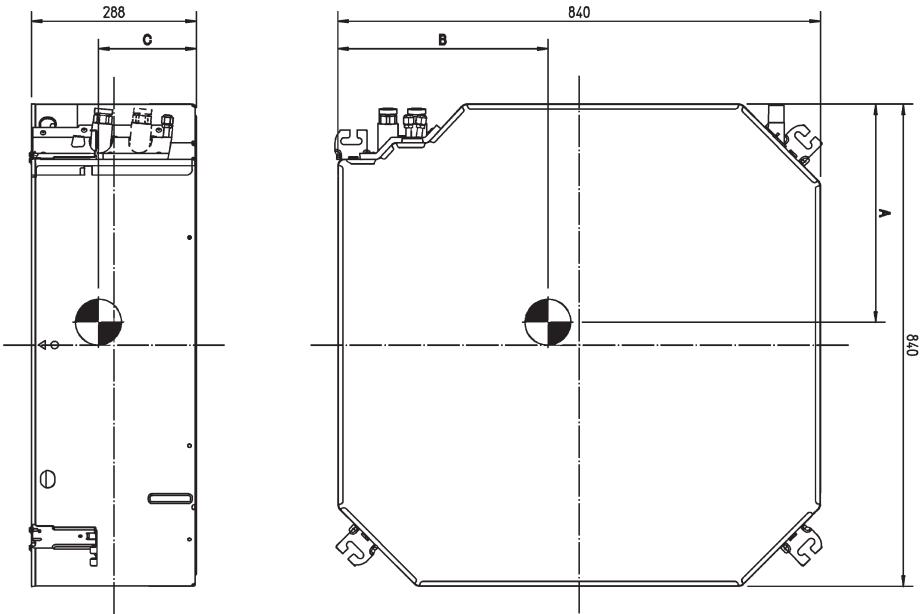


Model	A	B	C
FWC06-09BT	412	404	167
FWC06-09BF	420	406	189

4TW33124-3

9 Piping diagrams


9 - 1 Piping Diagrams

9

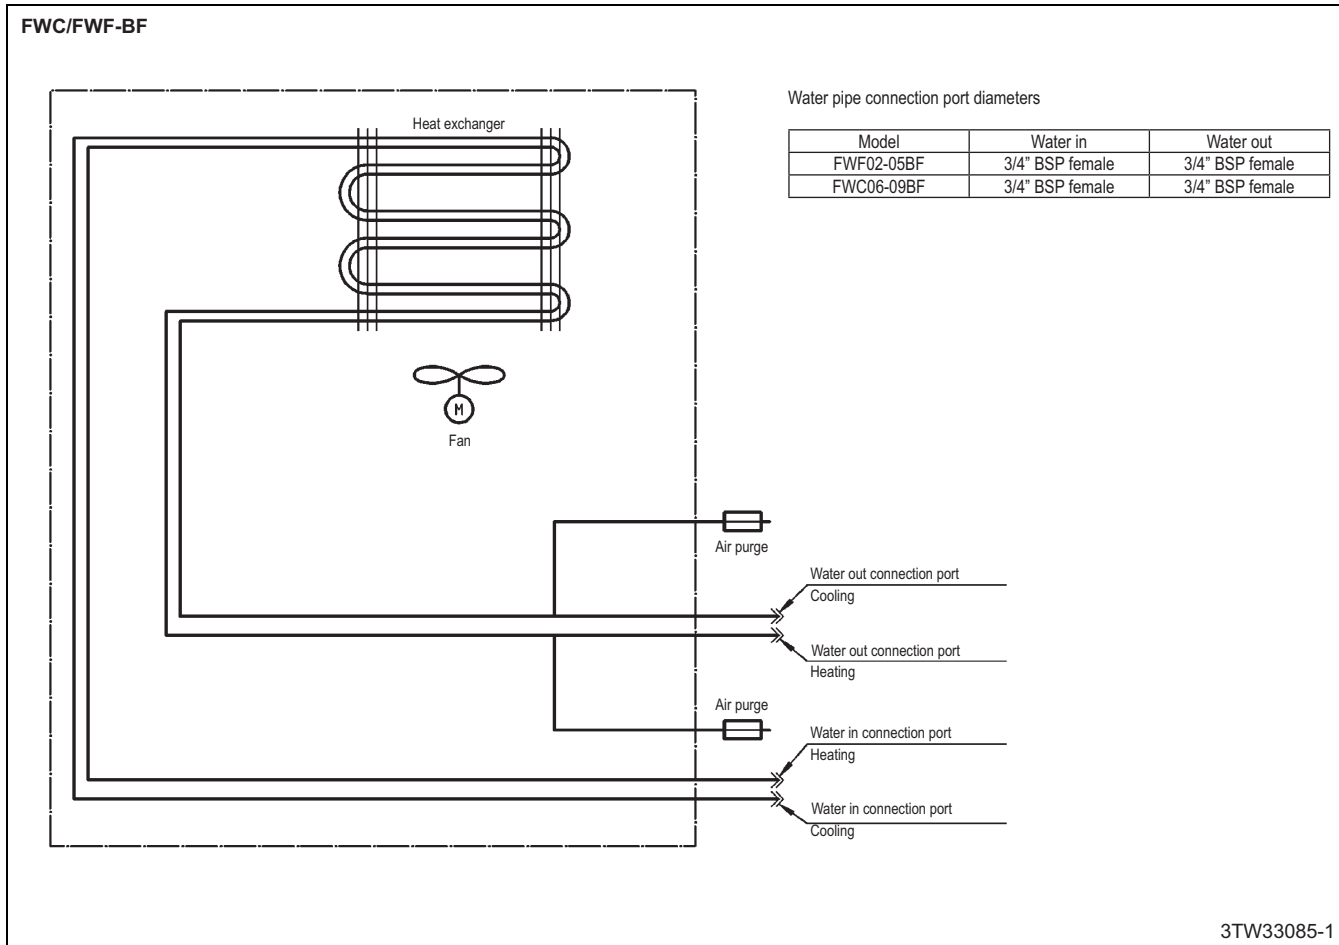



10 Sound data

10 - 1 Sound Power Spectrum

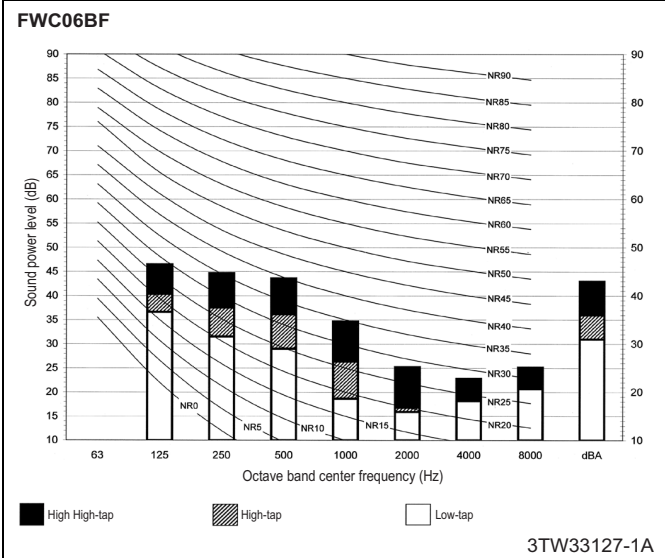


NOTES

1. dBA = A-weighted sound pressure level. (A-scale according to IEC)
2. Reference acoustic pressures 0dB = 10E-6μW/m²
3. Measured according to ISO 3744

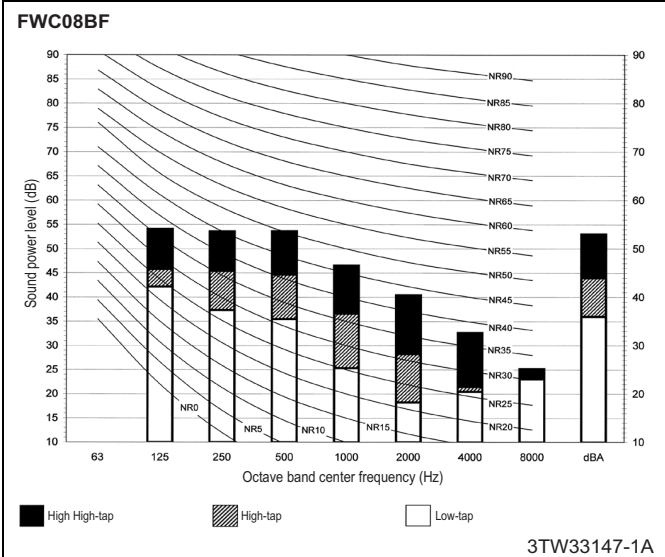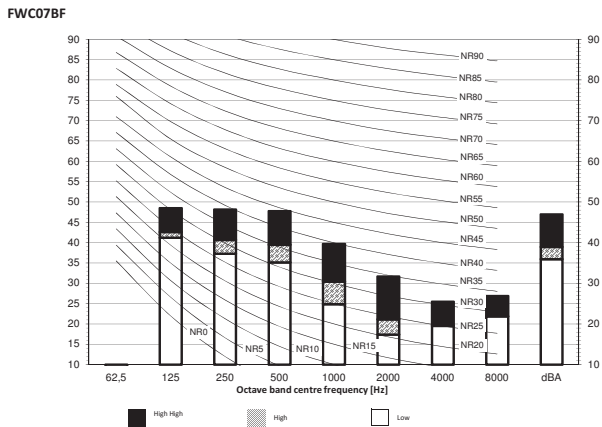

NOTES

1. dBA = A-weighted sound pressure level. (A-scale according to IEC)
2. Reference acoustic pressures 0dB = 10E-6μW/m²
3. Measured according to ISO 3744

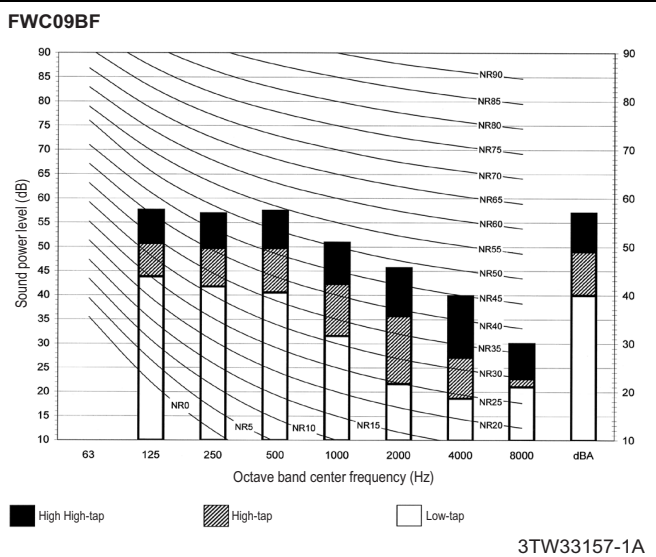





NOTES

1. dBA = A-weighted sound pressure level. (A-scale according to IEC)
2. Reference acoustic pressures 0dB = 10E-6μW/m²
3. Measured according to ISO 3744

10 Sound data

10 - 2 Sound Pressure Spectrum


10

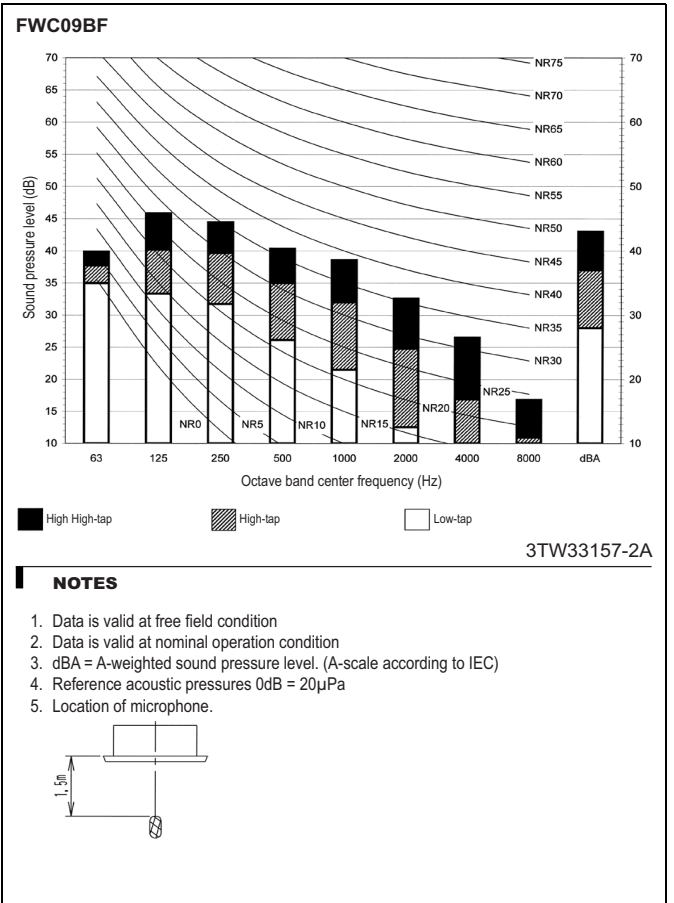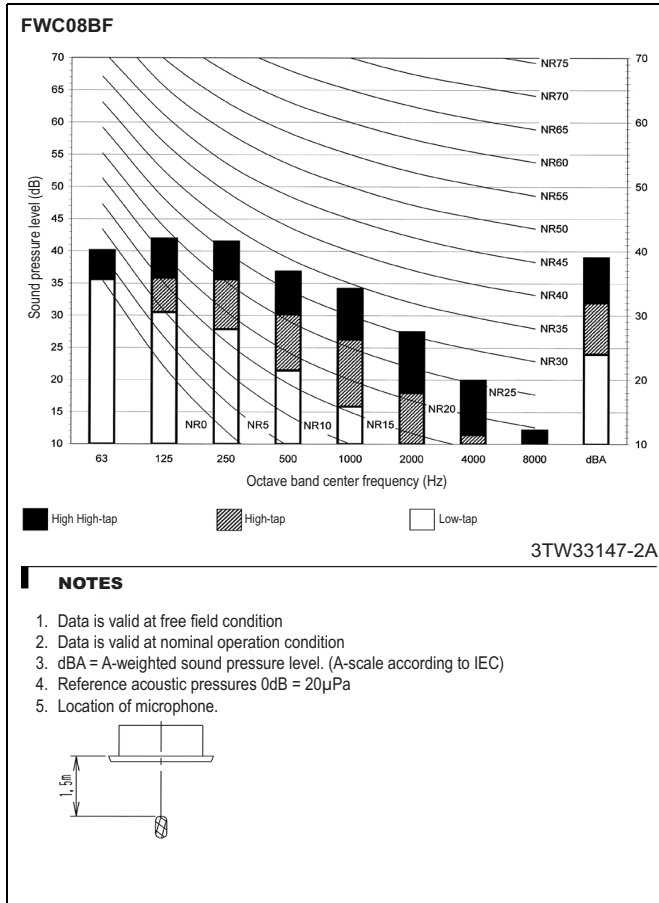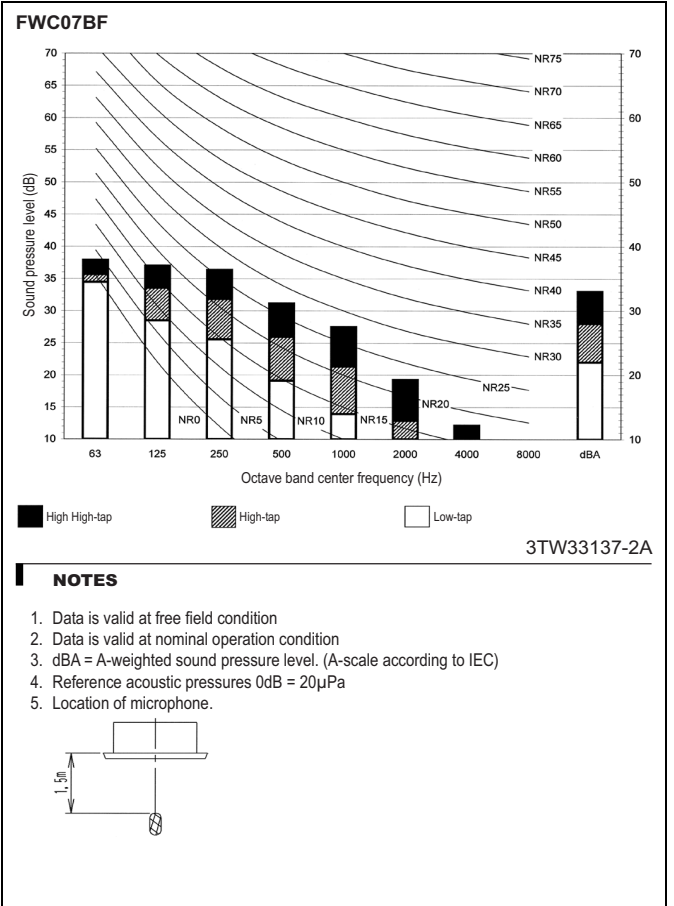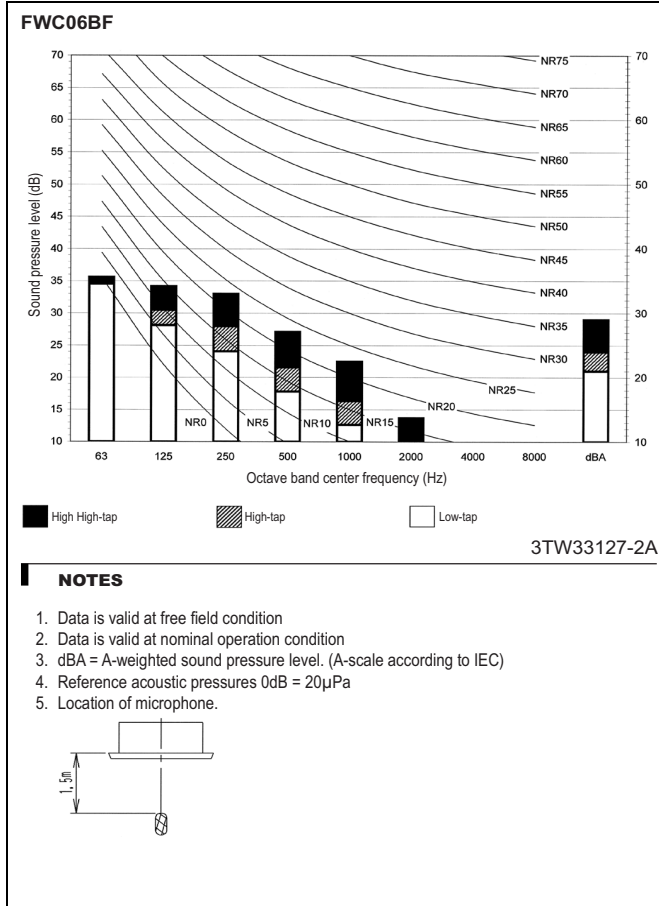

11 Hydraulic performance

11 - 1 Water Pressure Drop Curve Evaporator

FWC06-09BF

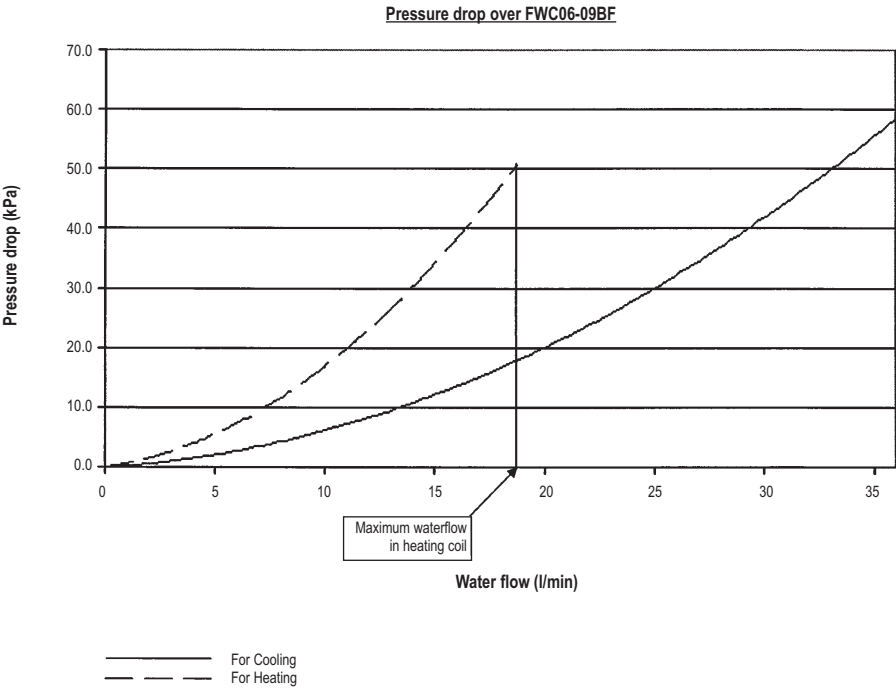

4TW33129-5

NOTES

1. This graph can be used to calculate the pressure drop over the fan coil unit. The pressure drop over the valve is not included.



Daikin Europe N.V. participates in the Eurovent Certification programme for Liquid Chilling Packages (LCP), Air handling units (AHU) and Fan coil units (FCU). Check on-going validity of certificate online: www.eurovent-certification.com or using: www.certiflash.com

The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.

BARCODE

Daikin products are distributed by: