

Applied Systems Technical Data

FWZ-AT/AF



- > FWZ02AATV3
- > FWZ03AATV3
- > FWZ06AATV3
- > FWZ08AT
- > FWZ02AAFV3
- > FWZ03AF

- > FWZ03AAFV3
- > FWZ06AAFV3

TABLE OF CONTENTS

FWZ-AT/AF

1	Features	2
	FWZ-AT	2
2	Specifications	3
	Technical Specifications	3
	Electrical Specifications	5
3	Options	6
4	Capacity tables	9
	Cooling Capacity Tables - 2-pipe	9
	Cooling Capacity Tables - 4-pipe	11
	Heating Capacity Tables - 2-pipe	13
	Heating Capacity Tables - 4-pipe	14
5	Dimensional drawings	15
6	Sound data	17
	Sound Level Data - 2-pipe	17
	Sound Level Data - 4-pipe	18
7	Hydraulic performance	19
	Water Pressure Drop Curve Evaporator - Cooling 2-pipe	19
	Water Pressure Drop Curve Evaporator - Heating 2-pipe	20
	Water Pressure Drop Curve Evaporator - Heating 4-pipe	21

1 Features

1 - 1 FWZ-AT

- Up to 70% energy savings with brushless DC motor technology compared to traditional technology
- Instant adjustment to temperature and relative humidity changes
- Low operating sound level
- Highly flexible solutions: multiple sizes, piping topologies and connection valves
- Requires very little installation space

2 Specifications

2-1 Technical Specifications				FWZ02AT	FWZ03AT	FWZ06AT	FWZ08AT	FWZ02AF	FWZ03AF	FWZ03AF	FWZ06AF	
Cooling capacity	Sensible capacity	Min.	kW	-			1.20 (1)	-	0.58 (1)	-		
		Max.	kW	-			7.43 (1)	-	3.60 (1)	-		
	Total capacity	Min.	kW	-			1.79 (1)	-	0.88 (1)	-		
		Max.	kW	-			10.08 (1)	-	4.96 (1)	-		
Cooling capacity (standard conditions)	Latent capacity 2-pipe	High	kW	0.54 (1)	0.82 (1)	0.98 (1)	-					
	Latent capacity 4-pipe	High	kW	-				0.33 (1)	-	0.80 (1)	1.19 (1)	
	Sensible capacity 2-pipe	Low	kW	1.04 (1)	1.25 (1)	2.31 (1)	-					
		Medium	kW	1.30 (1)	1.69 (1)	2.90 (1)	-					
		High	kW	1.49 (1)	2.09 (1)	3.62 (1)	-					
	Sensible capacity 4-pipe	Low	kW	-				0.97 (1)	-	1.23 (1)	2.27 (1)	
		Medium	kW	-				1.21 (1)	-	1.65 (1)	2.85 (1)	
		High	kW	-				1.44 (1)	-	2.06 (1)	3.54 (1)	
	Total capacity 2-pipe	Low	kW	1.35 (1)	1.75 (1)	2.99 (1)	-					
		Medium	kW	1.69 (1)	2.37 (1)	3.64 (1)	-					
		High	kW	1.94 (1)	2.91 (1)	4.48 (1)	-					
	Total capacity 4-pipe	Low	kW	-				1.25 (1)	-	1.72 (1)	3.10 (1)	
		Medium	kW	-				1.55 (1)	-	2.32 (1)	3.79 (1)	
		High	kW	-				1.77 (1)	-	2.86 (1)	4.64 (1)	
Heating capacity	2-Pipe	Min.	kW	-			1.92 (2)	-				
		Max.	kW	-			11.18 (2)	-				
	4-Pipe	Min.	kW	-				1.18 (2)	-			
		Max.	kW	-				4.19 (2)	-			
Heating capacity (standard conditions)	Capacity 2-pipe	Low	kW	1.50 (2)	1.76 (2)	3.36 (2)	-					
		Medium	kW	1.81 (2)	2.37 (2)	4.11 (2)	-					
		High	kW	2.15 (2)	2.94 (2)	4.88 (2)	-					
	Capacity 4-pipe	Low	kW	-				1.36 (3)	-	1.88 (3)	3.55 (3)	
		Medium	kW	-				1.56 (3)	-	2.31 (3)	4.07 (3)	
		High	kW	-				1.76 (3)	-	2.68 (3)	4.64 (3)	
Power input	Min.	W	-			4.2	-	2.2	-			
	Low	kW	0.01			-	0.01	-	0.01			
	Medium	kW	0.01		0.02	-	0.01	-	0.01	0.02		
	High	kW	0.019	0.016	0.033	-	0.019	-	0.016	0.033		
	Max.	W	-			147	-	82.7	-			
FCEER				B	A		-	B	-	A		
FCCOP				B	A		-	B	-	A		
Dimensions	Unit	Height	mm	564								
		Width	mm	774	984	1,190	1,404	774	987	984	1,190	
		Depth	mm	226			251	226				
Weight	Unit	kg	20.6	26.7	32.3	41	20.6	26	26.7	32.3		
Casing	Colour	White - RAL9010				Plastic and metal RAL9010	White - RAL9010	Plastic and metal RAL9010	White - RAL9010			
	Material	Plastic + sheet metal										
Heat exchanger	Type	Cross fin coil				-	Cross fin coil	-	Cross fin coil			
	Rows	Quantity	3									
	Fin	Type	Aluminium				-	Aluminium	-	Aluminium		
	Tube material		Copper				-	Copper	-	Copper		
	Water volume		l	1			2.1	1				
	Face area		m²	-			0.292	-	0.138	-		
	Fin pitch		mm	-			2.1	-	1.6	-		
	Stages	Quantity	-				12	-	10	-		
	Additional heat exchanger	Rows	Quantity	-				1				
Water volume		l	-				0	0.3	0			
Face area		m²	-				0.110		-			
Fin pitch		mm	-				1.6		-			
Stages		Quantity	-				8		-			

2 Specifications

2-1 Technical Specifications				FWZ02AT	FWZ03AT	FWZ06AT	FWZ08AT	FWZ02AF	FWZ03AF	FWZ03AF	FWZ06AF	
Water flow	Cooling	Low	l/h	234 (1)	302 (1)	515 (1)	-			297 (1)	535 (1)	
		Medium	l/h	292 (1)	408 (1)	628 (1)	-			400 (1)	654 (1)	
		High	l/h	337 (1)	503 (1)	774 (1)	-			493 (1)	802 (1)	
		Nom.	l/h	-			853 (4)		-			
	Heating	Low	l/h	260 (2)	301 (2)	575 (2)	-			165 (3)	311 (3)	
		Medium	l/h	315 (2)	408 (2)	709 (2)	-			202 (3)	357 (3)	
		High	l/h	373 (2)	506 (2)	866 (2)	-			234 (3)	406 (3)	
		Nom.	l/h	-			367 (4)		-			
	Water pressure drop	Cooling	Low	kPa	6 (1)	5 (1)	7 (1)	-	7 (1)	-	5 (1)	7 (1)
			Medium	kPa	9 (1)	8 (1)	10 (1)	-	10 (1)	-	8 (1)	10 (1)
			High	kPa	12 (1)	11 (1)	14 (1)	-	13 (1)	-	11 (1)	14 (1)
		Heating	Low	kPa	6 (2)	5 (2)	7 (2)	-	5 (3)	-	2 (3)	5 (3)
			Medium	kPa	9 (2)	8 (2)	10 (2)	-	5 (3)	-	3 (3)	6 (3)
High			kPa	12 (2)	11 (2)	14 (2)	-	6 (3)	-	4 (3)	8 (3)	
Water pressure drop	Cooling	Rated	kPa	-					29 (4)	-		
	Heating	Rated	kPa	-					9 (4)	-		
Fan	Type			Centrifugal			Centrifugal multi-blade, double suction	Centrifugal	Centrifugal multi-blade, double suction	Centrifugal		
	Quantity			1	2			1	2			
	Air flow rate	Low	m³/h	211	241	470	-	205	-	237	460	
		Medium	m³/h	271	341	605	-	261	-	332	593	
		High	m³/h	344	442	785	-	327	-	431	763	
		Max.	m³/h	-			1,660 (3)	-	900 (3)	-		
		Min.	m³/h	-			200 (3)	-	95 (3)	-		
Fan motor	Model			-			Permanent magnet rotor, F class insulation, electronic overload protection	-	Permanent magnet rotor, F class insulation, electronic overload protection	-		
Air filter	Type			Polypropylene net			Plastic	Polypropylene net	Plastic	Polypropylene net		
Sound power level	Max.		dBA	-			71	-	70	-		
	Min.		dBA	-			28	-	28	-		
Total sound power level	Low		dBA	40 (4)	36 (4)	43 (4)	-	38 (4)	-	33 (4)	48 (4)	
	Medium		dBA	44 (4)	42 (4)	49 (4)	-	44 (4)	-	41 (4)	53 (4)	
	High		dBA	50 (4)	48 (4)	56 (4)	-	50 (4)	-	47 (4)	58 (4)	
Sound pressure level	Low		dBA	35 (5)	31 (5)	38 (5)	-	33 (5)	-	28 (5)	43 (5)	
	Medium		dBA	39 (5)	37 (5)	44 (5)	-	39 (5)	-	36 (5)	48 (5)	
	High		dBA	45 (5)	43 (5)	51 (5)	-	45 (5)	-	42 (5)	54 (5)	
Piping connections	Water	Inlet		-			3/4"	-	1/2"	-		
		Outlet		-			3/4"	-	1/2"	-		
	Drain	OD	mm	16								
Insulation material				Closed cells poliethilene			Class 1 self-extinguishing	Closed cells poliethilene	Class 1 self-extinguishing	Closed cells poliethilene		
Vibration insulation				-			Rubber ring for fan motor	-	Rubber ring for fan motor	-		
Water connections	Primary coil		inch	1/2"			-	1/2"	-	1/2"		
	Additional coil		inch	-	1/2"	-		1/2"	-	1/2"		
Control systems	Wired remote control			-			FWEC3A	-	FWEC3A	-		

2 Specifications

2-1 Technical Specifications				FWZ02AT	FWZ03AT	FWZ06AT	FWZ08AT	FWZ02AF	FWZ03AF	FWZ03AF	FWZ06AF
Allowed water temperature	Cooling	Min.	°C	5			-	5	-	5	
		Max.	°C	95.0			-	95.0	-	95.0	
	Heating	Min.	°C	5.00			-	5.00	-	5.00	
		Max.	°C	95.000			-	95.000	-	95.000	
Water content	Primary coil		dm ³	0.70	1.06	1.43	-	0.70	-	1.06	1.43
	Additional coil		dm ³	-			-	0.18	-	0.29	0.40

2-2 Electrical Specifications				FWZ02AT	FWZ03AT		FWZ06AT	FWZ08AT	FWZ02AF	FWZ03AF	FWZ03AF	FWZ06AF		
Fan motor	Control Voltage	Low	V	5.2	3.8		5.0	-	5.2	-	3.8	5.0		
		Medium	V	6.9	5.7		6.7	-	6.9	-	5.7	6.7		
		High	V	8.4	7.3		8.9	-	8.4	-	7.3	8.9		
Electric heater	Type		230 / 1 / 50					-	230 / 1 / 50		-	230 / 1 / 50		
	Phase		1					-	1		-	1		
	Frequency		Hz	50					-	50		-	50	
	Voltage		V	230					-	230		-	230	
	Power input		kW	1.5	1.6	2.0	-	1.5		-	1.6	2.0		
	Current		A	6.8	7.3	9.1	-	6.8		-	7.3	9.1		
Power supply	Type		230 / 1 / 50					-	230 / 1 / 50		-	230 / 1 / 50		
	Phase		1~											
	Frequency		Hz	50										
	Voltage		V	230										
Current input	Max.		A	-					1.27	-	0.72	-		
	Min.		A	-					0.09	-	0.05	-		
Required wire section			mm²	0.5					1	0.5	1	0.5		
Required fuses			A	-					2	-	1	-		
Maximum absorbed current			A	0.520	0.650	0.910	-	0.520	-	0.650	0.910			

Notes

- (1) Cooling: indoor temp. 27°CDB, 19°CWB; entering water temp. 7°C, water temperature rise 5K.
 (2) Heating: indoor temp. 20°CDB, 15°CWB; entering water temp. 45°C, water temperature drop 5K.
 (3) Heating: indoor temp. 20°CDB, 15°CWB; entering water temp. 65°C, water temperature drop 10K.
 (4) Sound power level according to ISO3741
 (5) The sound pressure level is measured via a microphone at 1m distance of the unit.

SL: The silent fan level of the air flow rate setting

Cooling: 2 pipe: air 27°CDB, 19°CWB; entering water 7°C; leaving water 12°C

Heating: 2 pipe: air 20°CDB, entering water 50°C, water flow as per cooling mode

Air flow at 0Pa ESP

Water flow rate values and water pressure drop values are at maximum speed

The power consumption for the valve motor is 5W (peak). This is only during opening.

Cooling: 4 pipe: air 27°CDB, 19°CWB; entering water 7°C; leaving water 12°C

Heating: 4 pipe: air 20°CDB; entering water 70°C; leaving water 60°C

3 Options

3 - 1 Options

3

FWZ-AT/AF
FWR-AT/AF
FWS-AT/AF

Accessories table

Description	Daikin	F4	F6	F9	F10	FWZ	FWR	FWS	Notes/remarks
FCU unit	FWZ+FWR+FWS	2	3	6	8				
Additional single row heat exchanger	ESRH.A6	ESRH02A6	ESRH03A6	ESRH06A6	ESRH10A6	X	X	X	Can not be used in combination with electric heater
Electric heater	EEH.A6	EEH02A6	EEH03A6	EEH06A6	EEH10A6	X	X	X	Can not be used in combination with additional H/E requires electronic controller
2-pipe 230V ON-OFF 3 way motor driven valve complete with mounting kit	E2MV.A6	E2MV03A6	E2MV03A6	E2MV06A6	E2MV10A6	X	X	X	Requires electronic controller
4-pipe 230V ON-OFF 3 way motor driven valve complete with mounting kit	E4MV.A6	E4MV03A6	E4MV03A6	E4MV06A6	E4MV10A6	X	X	X	Requires electronic controller
2-pipe 230V ON-OFF 3 way motor driven valve complete with simplified mounting kit	E2MVD.A6	E2MVD03A6	E2MVD03A6	E2MVD06A6	E2MVD10A6	X	X	X	Requires electronic controller
4-pipe 230V ON-OFF 3 way motor driven valve complete with simplified mounting kit	E4MVD.A6	E4MVD03A6	E4MVD03A6	E4MVD06A6	E4MVD10A6	X	X	X	Requires electronic controller
2-pipe 24V ON-OFF 3 way motor driven valve complete with mounting kit	E2M2V.A6	E2M2V03A6	E2M2V03A6	E2M2V06A6	E2M2V10A6	X	X	X	Independent power supply is necessary as fan coil units have not any 230V-24V transformer
4-pipe 24V ON-OFF 3 way motor driven valve complete with mounting kit	E4M2V.A6	E4M2V03A6	E4M2V03A6	E4M2V06A6	E4M2V10A6	X	X	X	Independent power supply is necessary as fan coil units have not any 230V-24V transformer
230V ON-OFF 2 way motor driven valve complete with mounting kit (cooling h/e)	E2MV2B.A6		E2MV2B07A6		E2MV2B10A6	X	X	X	Requires electronic controller
24V ON-OFF 2 way motor driven valve complete with mounting kit (additional h/e)	E2MV2B.A6		E2MV2B07A6		E2MV2B10A6	X	X	X	Requires electronic controller
24V ON-OFF 2 way motor driven valve complete with mounting kit (cooling h/e)	E2MV2V.A6		E2MV2V07A6		E2MV2V10A6	X	X	X	Independent power supply is necessary as fan coil units have not any 230V-24V transformer
24V ON-OFF 2 way motor driven valve complete with mounting kit (additional h/e)	E2MV2V.A6		E2MV2V07A6		E2MV2V10A6	X	X	X	Independent power supply is necessary as fan coil units have not any 230V-24V transformer
Air intake & discharge grill + front Filter fixing kit for concealed models	EADF.A6	EADF02A6	EADF03A6	EADF06A6	EADF10A6			X	
Supporting feet (≈supporting brackets + covers)	ESFV.A6	ESFV06A6	ESFV06A6	ESFV06A6	ESFV10A6	X		X	Covers can not be used for FWS
Supporting feet + grill	ESFVG.A6	ESFVG02A6	ESFVG03A6	ESFVG06A6	ESFVG10A6	X			
Fresh air intake louvers (manual)	EFA.A6	EFA02A6	EFA03A6	EFA06A6	EFA10A6	X			
Rear panel for vertical mounted models	ERP.V.A6	ERP.V02A6	ERP.V03A6	ERP.V06A6	ERP.V10A6	X	X		Only for vertical mounted units
Plenum box with circular connections	EPCC.A6	EPCC02A6	EPCC03A6	EPCC06A6	EPCC10A6			X	
Vertical Drain Pan	EDP.VA6		EDP.VA6			X	X	X	
Horizontal Drain Pan	EDP.HA6		EDP.HA6				X	X	
Fcu controller - Advanced plus version	FWEC3A		FWEC3A			X	X	X	Water probe included
Fcu temperature sensor kit	FWT.SKA		FWT.SKA			X	X	X	
Fcu relative humidity sensor kit	FWH.SKA		FWH.SKA			X	X	X	
On board fcu controller installation kit	FWECKA		FWECKA			X	X		
Wall mounting kit for electronic controller	FWFCKA		FWFCKA				X	X	

4TW60019-2A(1/2)

6

3 Options

FWZ-AT/AF
FWR-AT/AF
FWS-AT/AF

Cross reference table

[illegible]

4TW60019-2A(2/2)

3 Options

3 - 1 Options

FWZ-AT
FWR-AT
FWS-AT

3

Accessory: electric heater

Unit	Electric heater	Power input electric heater	Current Absorption
		kW	A
FW02	EEH02A6	1.5	6.52
FW03	EEH03A6	1.6	6.95
FW06	EEH06A6	2.0	8.69
FW08	EEH10A6	3.0	13.00

Power supply = 230 V +/- 10% / 1~ / 50Hz

4TW60011-3A

4 Capacity tables

4 - 1 Cooling Capacity Tables - 2-pipe

FWZ-AT
FWR-AT
FWS-AT

Air Temperature (°C DB - °C WB)		22 - 16															
Water Temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop
		KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa
FW 02 T	Max	1.63	1.40	0.078	9	1.39	1.39	0.066	7	1.25	1.25	0.060	5	1.11	1.11	0.053	4
	Min	0.47	0.36	0.220	1	0.41	0.30	0.020	1	0.36	0.28	0.017	1	0.30	0.25	0.014	1
FW 03 T	Max	3.10	2.58	0.148	13	2.57	2.57	0.122	9	3.31	2.31	0.110	7	2.05	2.05	0.058	6
	Min	0.68	0.47	0.032	1	0.60	0.43	0.029	1	0.53	0.40	0.025	1	0.44	0.36	0.021	1
FW 06 T	Max	3.89	3.44	0.186	10	3.23	3.23	0.154	7	2.89	2.89	0.138	6	2.54	2.54	0.121	5
	Min	0.92	0.63	0.044	1	0.82	0.59	0.039	1	0.71	0.54	0.034	1	0.60	0.49	0.029	1
FW 08 T	Max	6.33	5.33	0.301	14	5.11	5.11	0.244	10	4.59	4.59	0.219	8	4.04	4.04	0.193	6
	Min	1.38	0.96	0.066	1	1.23	0.89	0.059	1	1.07	0.82	0.510	1	0.89	0.74	0.043	1

Air flow at 0Pa

4TW60012-1A(1/10)

FWZ-AT
FWR-AT
FWS-AT

Air Temperature (°C DB - °C WB)		27 - 19															
Water Temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop
		KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa
FW 02 T	Max	2.99	2.08	0.143	25	2.65	1.95	0.126	20	2.29	1.82	0.109	16	1.91	1.68	0.091	11
	Min	0.66	0.43	0.031	2	0.61	0.41	0.029	2	0.56	0.39	0.027	1	0.50	0.36	0.024	1
FW 03 T	Max	5.58	3.84	0.266	35	4.98	3.60	0.237	29	4.33	3.35	0.207	22	3.64	3.09	0.174	16
	Min	0.95	0.61	0.045	2	0.88	0.58	0.042	1	0.81	0.55	0.038	1	0.73	0.52	0.035	1
FW 06 T	Max	7.12	5.11	0.339	29	6.34	4.80	0.302	24	5.51	4.49	0.263	18	4.16	4.16	0.220	13
	Min	1.28	0.83	0.061	1	1.19	0.79	0.057	1	1.09	0.74	0.052	1	0.99	0.70	0.047	1
FW 08 T	Max	11.28	7.90	0.538	38	10.10	7.42	0.482	32	8.83	6.92	0.421	25	7.45	6.40	0.355	18
	Min	1.94	1.26	0.092	2	1.79	1.20	0.086	2	1.65	1.13	0.079	1	1.49	1.06	0.071	1

Air flow at 0Pa

4TW60012-1A(3/10)

4 Capacity tables

4 - 1 Cooling Capacity Tables - 2-pipe

FWZ-AT
FWR-AT
FWS-AT

4

Air Temperature (°C DB - °C WB)		30 - 22															
Water Temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop
		KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa
FW 02 T	Max	4.42	2.46	0.211	50	4.11	2.34	0.196	44	3.78	2.22	0.180	38	3.43	2.10	0.164	31
	Min	0.87	0.49	0.042	3	0.82	0.47	0.039	3	0.77	0.44	0.037	2	0.72	0.42	0.034	2
FW 03 T	Max	8.05	4.49	0.384	67	7.50	4.28	0.357	59	6.93	4.06	0.330	51	6.33	3.85	0.302	43
	Min	1.24	0.69	0.059	3	1.18	0.66	0.056	2	1.11	0.63	0.053	2	1.03	0.60	0.049	2
FW 06 T	Max	10.30	5.94	0.491	56	9.59	5.67	0.457	49	8.86	5.40	0.423	42	8.11	5.12	0.387	36
	Min	1.69	0.94	0.080	2	1.60	0.90	0.076	2	1.50	0.86	0.072	2	1.40	0.81	0.067	2
FW 08 T	Max	16.11	9.19	0.767	72	15.04	8.76	0.717	63	13.93	8.33	0.664	55	12.77	7.90	0.609	47
	Min	2.55	1.43	0.122	3	2.41	1.36	0.115	3	2.27	1.30	0.108	2	2.12	1.24	0.101	2

Air flow at 0Pa

4TW60012-1A(5/10)

4 Capacity tables

4 - 2 Cooling Capacity Tables - 4-pipe

FWZ-AF
FWR-AF
FWS-AF

Air Temperature (°C DB - °C WB)		22 - 16															
Water Temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop
		KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa
FW 02 F	Max	1.63	1.40	0.078	9	1.39	1.39	0.066	7	1.25	1.25	0.060	5	1.11	1.11	0.053	4
	Min	0.47	0.36	0.220	1	0.41	0.30	0.020	1	0.36	0.28	0.017	1	0.30	0.25	0.014	1
FW 03 F	Max	3.10	2.58	0.148	13	2.57	2.57	0.122	9	2.31	2.31	0.110	7	2.05	2.05	0.098	9
	Min	0.68	0.47	0.032	1	0.60	0.43	0.029	1	0.53	0.40	0.025	1	0.44	0.36	0.021	1
FW 06 F	Max	3.89	3.44	0.186	10	3.23	3.23	0.154	7	2.89	2.89	0.138	6	2.54	2.54	0.121	5
	Min	0.92	0.63	0.044	1	0.82	0.59	0.039	1	0.71	0.54	0.034	1	0.60	0.49	0.029	1
FW 08 F	Max	6.33	5.33	0.301	14	5.11	5.11	0.244	11	4.59	4.59	0.219	8	4.04	4.04	0.193	6
	Min	1.38	0.96	0.066	1	1.23	0.89	0.059	1	1.07	0.82	0.051	1	0.89	0.74	0.043	1

Air flow at 0Pa

4TW60012-1A(2/10)

FWZ-AF
FWR-AF
FWS-AF

Air Temperature (°C DB - °C WB)		27 - 19															
Water Temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop
		KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa
FW 02 F	Max	2.99	2.08	0.143	25	2.65	1.95	0.126	20	2.29	1.82	0.109	16	1.91	1.68	0.091	11
	Min	0.66	0.43	0.031	2	0.61	0.41	0.029	2	0.56	0.39	0.027	1	0.50	0.36	0.024	1
FW 03 F	Max	5.58	3.84	0.266	35	4.98	3.60	0.237	29	4.33	3.35	0.207	22	3.64	3.09	0.174	16
	Min	0.95	0.61	0.045	2	0.88	0.58	0.042	1	0.81	0.55	0.038	1	0.73	0.52	0.035	1
FW 06 F	Max	7.12	5.11	0.339	29	6.34	4.80	0.302	24	5.51	4.49	0.263	18	4.61	4.16	0.220	13
	Min	1.28	0.83	0.061	1	1.19	0.79	0.057	1	1.09	0.74	0.052	1	0.99	0.70	0.047	1
FW 08 F	Max	11.28	7.90	0.538	38	10.10	7.42	0.482	32	8.83	6.92	0.421	25	7.45	6.40	0.355	18
	Min	1.94	1.26	0.092	2	1.79	1.20	0.086	2	1.65	1.13	0.079	1	1.49	1.06	0.071	1

Air flow at 0Pa

4TW60012-1A(4/10)

4 Capacity tables

4 - 2 Cooling Capacity Tables - 4-pipe

FWZ-AF
FWR-AF
FWS-AF

Air Temperature (°C DB - °C WB)		30-22															
Water Temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop	Total cooling cap	Sensible cooling cap	Water flow	Water pressure drop
		KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa	KW	KW	l/sec	kPa
FW 02 F	Max	4.42	2.46	0.211	50	4.11	2.34	0.196	44	3.78	2.22	0.180	38	3.43	2.10	0.164	31
	Min	0.87	0.49	0.042	3	0.82	0.47	0.039	3	0.77	0.44	0.037	2	0.72	0.42	0.034	2
FW 03 F	Max	8.05	4.49	0.384	67	7.50	4.28	0.357	59	6.93	4.06	0.330	51	6.33	3.85	0.302	43
	Min	1.24	0.69	0.059	3	1.18	0.66	0.056	2	1.11	0.63	0.053	2	1.03	0.60	0.049	2
FW 06 F	Max	10.30	5.94	0.491	56	9.59	5.67	0.457	49	8.86	5.40	0.423	42	8.11	5.12	0.387	36
	Min	1.69	0.94	0.080	2	1.60	0.90	0.076	2	1.50	0.86	0.072	2	1.40	0.81	0.067	2
FW 08 F	Max	16.11	9.19	0.767	72	15.04	8.76	0.717	63	13.93	8.33	0.664	55	12.77	7.90	0.609	47
	Min	2.55	1.43	0.122	3	2.41	1.36	0.115	3	2.27	1.30	0.108	2	2.12	1.24	0.101	2

Air flow at 0Pa

4TW60012-1A(6/10)

4 Capacity tables

4 - 3 Heating Capacity Tables - 2-pipe

FWZ-AT
FWR-AT
FWS-AT

Air Temperature (° C)		20								
Water Temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60		
Model		Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
		KW	l/sec	kPa	KW	l/sec	kPa	KW	l/sec	kPa
FW 02 T	Max	3.61	0.175	29	4.56	0.111	13	5.94	0.145	20
	Min	0.69	0.033	2	0.90	0.022	1	1.15	0.028	1
FW 03 T	Max	6.62	0.321	39	8.40	0.204	17	10.91	0.266	27
	Min	0.95	0.046	1	1.26	0.030	1	1.59	0.039	1
FW 06 T	Max	7.93	0.384	29	10.43	0.243	13	13.05	0.318	20
	Min	1.29	0.063	1	1.69	0.041	1	2.15	0.052	1
FW 08 T	Max	11.32	0.548	32	14.35	0.348	14	18.63	0.454	22
	Min	1.93	0.930	1	2.48	0.060	1	3.20	0.078	1

Air flow at 0Pa

4TW60012-1A(7/10)

FWZ-AT
FWR-AT
FWS-AT

Air Temperature (° C)		22								
Water Temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60		
Model		Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
		KW	l/sec	kPa	KW	l/sec	kPa	KW	l/sec	kPa
FW 02 T	Max	3.33	0.161	25	4.27	0.104	11	5.66	0.138	18
	Min	0.06	0.031	1	0.09	0.021	1	1.09	0.027	1
FW 03 T	Max	6.11	0.296	34	7.88	0.191	16	10.38	0.253	24
	Min	0.88	0.043	1	1.18	0.029	1	1.51	0.037	1
FW 06 T	Max	7.32	0.354	25	9.41	0.228	11	12.42	0.303	18
	Min	1.20	0.058	1	1.59	0.039	1	2.05	0.050	1
FW 08 T	Max	10.45	0.506	28	13.46	0.327	13	17.74	0.432	20
	Min	1.78	0.086	1	2.33	0.056	1	3.05	0.074	1

Air flow at 0Pa

4TW60012-1A(8/10)

4 Capacity tables

4 - 4 Heating Capacity Tables - 4-pipe

FWZ-AF
FWR-AF
FWS-AF

Air Temperature (°C)		20								
Water Temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60		
Model		Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
		KW	l/sec	kPa	KW	l/sec	kPa	KW	l/sec	kPa
FW 02 F	Max	1.50	0.073	16	1.83	0.044	6	2.46	0.060	11
	Min	0.50	0.024	1	0.61	0.015	1	0.82	0.020	2
FW 03 F	Max	2.56	0.124	14	3.09	0.075	5	4.19	0.102	9
	Min	0.72	0.035	1	0.85	0.021	1	1.18	0.029	1
FW 06 F	Max	3.94	0.191	21	4.82	0.117	9	6.45	0.157	14
	Min	1.06	0.051	2	1.32	0.032	1	1.76	0.043	1
FW 08 F	Max	6.14	0.297	68	7.62	0.185	29	10.05	0.245	45
	Min	1.71	0.083	7	2.18	0.053	3	2.83	0.069	5

Air flow at 0Pa

4TW60012-1A(9/10)

FWZ-AF
FWR-AF
FWS-AF

Air Temperature (°C)		22								
Water Temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60		
Model		Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
		KW	l/sec	kPa	KW	l/sec	kPa	KW	l/sec	kPa
FW 02 F	Max	1.38	0.067	14	1.71	0.046	6	2.33	0.057	10
	Min	0.46	0.022	1	0.66	0.014	1	0.78	0.019	1
FW 03 F	Max	2.35	0.114	12	2.86	0.069	5	3.98	0.097	8
	Min	0.65	0.032	1	0.78	0.019	1	1.12	0.027	1
FW 06 F	Max	3.62	0.175	18	4.50	0.109	8	6.13	0.149	13
	Min	0.98	0.047	2	1.22	0.030	1	1.67	0.041	1
FW 08 F	Max	5.66	0.274	59	7.14	0.173	26	9.57	0.233	42
	Min	1.58	0.076	6	2.04	0.049	3	2.69	0.066	5


Air flow at 0Pa

4TW60012-1A(10/10)

5 Dimensional drawings

5 - 1 Dimensional Drawings

FWZ-AT/AF
FWR-AT/AF

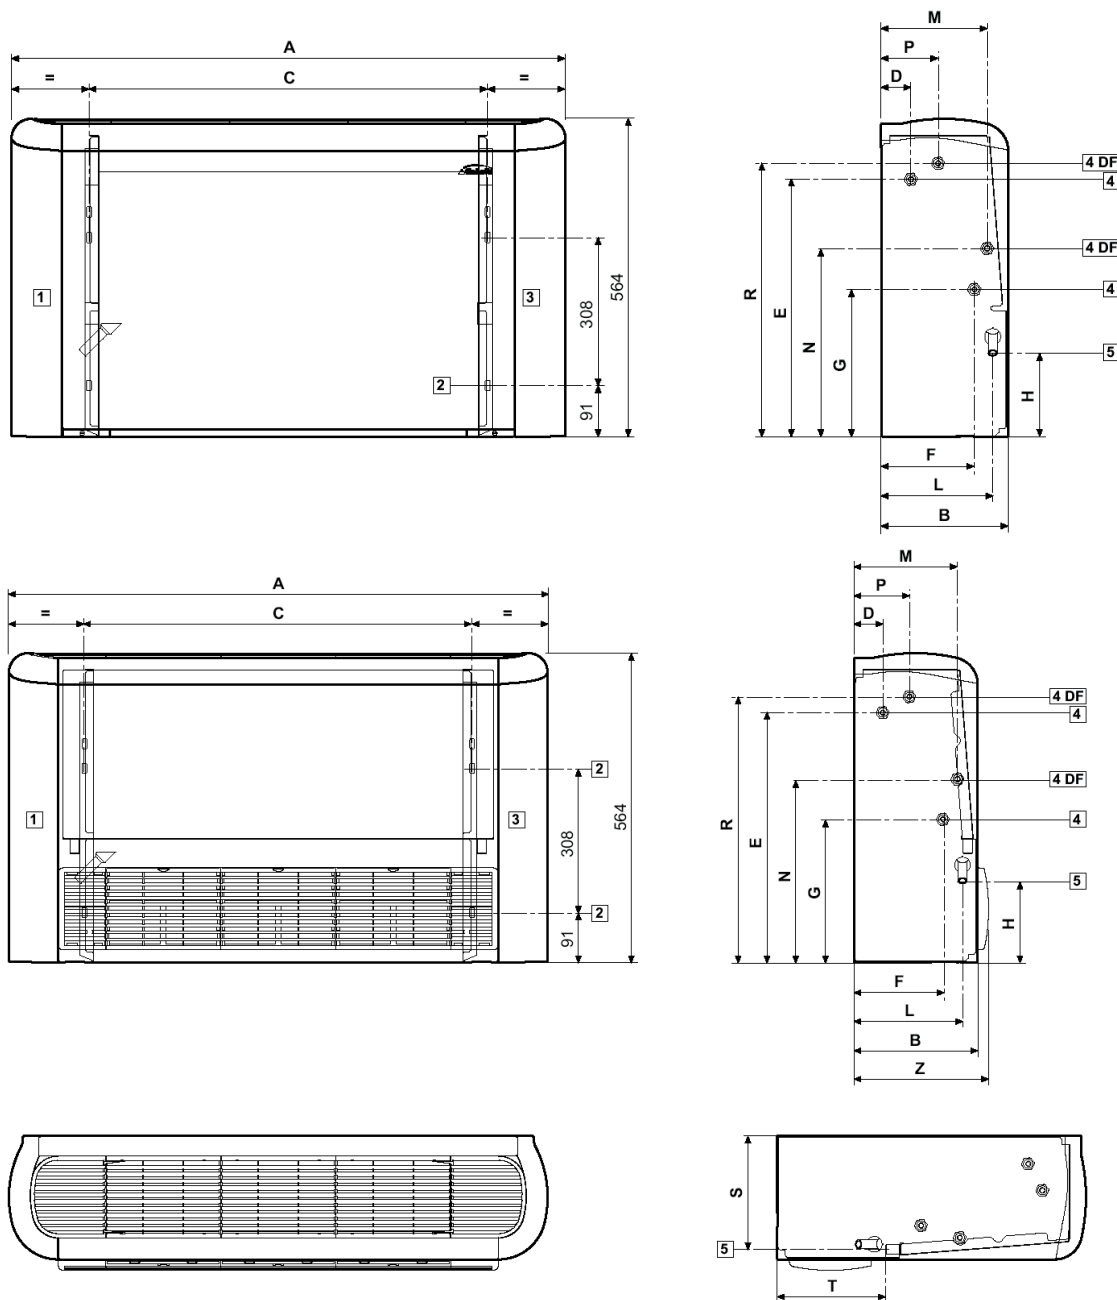

	A	B	C	D	E	F	G	H	L	M	N	P	R	S	T	Z
FWZ+FWR 02	774	226	498	51	458	163	263	149	198	187	335	99	486	208	198	246
FWZ+FWR 03	987	226	708	51	458	163	263	149	198	187	335	99	486	208	198	246
FWZ+FWR 06	1194	226	918	51	458	163	263	149	198	187	335	99	486	208	198	246
FWZ+FWR 08	1404	251	1128	48	497	185	259	155	220	195	348	120	478	234	208	271

4TW60014-1A(1/3)

5 Dimensional drawings

5 - 1 Dimensional Drawings

FWZ-AT/AF
FWR-AT/AF
FWS-AT/AF

5

Minimum required installation space

Keep at least 100 mm of free space at air inlet for a proper air suction and an easy removal of the filter.
For ducted units the outlet/inlet grill surface must be at least equal to the outlet/inlet surface of the unit to avoid extra noise and strong performances reduction.

Legenda

- 1 Clear space for hydraulic connections(*)
- 2 Slots for wall/ceiling mounting 9 x 20 mm
- 3 Clear space for electric connections(*)
- 4 Hydraulic connections (4 DF = 4 pipe system)
- 5 Condensate drainage for vertical installation
- 6 Air outlet for concealed models
- 7 Air suction for concealed models
- 8 Condensate draining for horizontal installation
- 9 Air outlet
- 10 Air inlet

(*) Indications applicable to units with hydraulic connections on the left side; in case of right side connections the indications for "clear space" are reversed.

Hydraulic connections

Standard Heat exchanger: connection female

FW02	FW03	FW06	FW08
1/2"	1/2"	1/2"	3/4"

Additional Heat exchanger: connection female

FW02	FW03	FW06	FW08
1/2"	1/2"	1/2"	1/2"

6 Sound data

6 - 1 Sound Level Data - 2-pipe

FWZ-AT
FWR-AT
FWS-AT

Sound power level and Spectrum								
FW02 T								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
max	41.8	55.1	57.2	56.8	53.5	45.2	31	62.0
min	-	19.9	25.3	21.6	16.1	-	-	28.0
FW03 T								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
max	47.2	59.6	65.2	65.9	63.3	55.8	43.6	70.3
min	-	20.8	25.4	21.2	14.3	-	-	28.0
FW06 T								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
max	41.1	55.0	59.2	59.3	56.4	48.4	36.1	64.0
min	-	21.0	24.9	21.1	17.8	-	-	28.0
FW08 T								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
max	46.6	61.0	65.3	66.7	63.8	56.7	46.7	70.9
min	-	21.5	24.7	21.9	15.2	-	-	28.0
Conditions of measurements	ISO3741: in case of (M) models the sound power is calculated WITHOUT any additional inlet or outlet grill or plenum!							

To calculate the sound pressure you must define some conditions and use this formula $L_p = L_w - 10 \times \log_{10} \left(\frac{4\pi \times d^2}{Q} \right)$

Where: Q = direction factor: is Q=4 if the FCU is installed near 2 walls (vertical or floor-ceiling), Q=2 if the FCU is installed near 1 wall (at floor or ceiling but faraway the 2nd wall)
d = distance (mt) from the sound source and the measure point
Lp = sound pressure (dB A)
Lw = sound power (dB A)

6 Sound data

6 - 2 Sound Level Data - 4-pipe

FWZ-AF
FWR-AF
FWS-AF

6

Sound power level and Spectrum								
FW02 F								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
max	41,8	55,1	57,2	56,8	53,5	45,2	31	62,0
min	-	19,9	25,3	21,6	16,1	-	-	28,0
FW03 F								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
max	47,2	59,6	65,2	65,9	63,3	55,8	43,6	70,3
min	-	20,8	25,4	21,2	14,3	-	-	28,0
FW06 F								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
max	41,1	55,0	59,2	59,3	56,4	48,4	36,1	64,0
min	-	21,0	24,9	21,1	17,8	-	-	28,0
FW08 F								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
max	46,6	61,0	65,3	66,7	63,8	56,7	46,7	70,9
min	-	21,5	24,7	21,9	15,2	-	-	28,0
Conditions of measurements	ISO3741: in case of (M) models the sound power is calculated WITHOUT any additional inlet or outlet grill or plenum!							

To calculate the sound pressure you must define some conditions and use this formula $L_p = L_w - 10 \times \log_{10} \left(\frac{4\pi \times d^2}{Q} \right)$

Where: Q = direction factor: is Q=4 if the FCU is installed near 2 walls (vertical or floor-ceiling), Q=2 if the FCU is installed near 1 wall (at floor or ceiling but faraway the 2° wall)
d = distance (mt) from the sound source and the measure point
Lp = sound pressure (dB A)
Lw = sound power (dB A)

4TW60017-1A(2/2)

7 Hydraulic performance

7 - 1 Water Pressure Drop Curve Evaporator - Cooling 2-pipe

FWZ-AT
FWR-AT
FWS-AT

Water Flow l/h	Water Pressure Drop			
	FW2	FW3	FW6	FW8
	kPa	kPa	kPa	kPa
50	0.41	0.19	0.1	0.05
100	1.42	0.66	0.35	0.16
200	4.81	2.25	1.21	0.56
300	9.81	4.6	2.46	1.14
400	16.27	7.63	4.09	1.9
500	24.09	11.3	6.06	2.82
600	33.19	15.57	8.35	3.89
800	55.02	25.82	13.84	6.44
1000	81.4	38.2	20.5	9.54
1500	165.77	77.83	41.8	19.46
2000		128.9	69.27	32.27
2500			102.47	47.75
3000			141.09	65.76
4000				108.92
5000				161.06

4TW60019-1A(1/3)

7 Hydraulic performance

7 - 2 Water Pressure Drop Curve Evaporator - Heating 2-pipe

FWZ-AT
FWR-AT
FWS-AT

Water Flow l/h	Water Pressure Drop			
	FW2	FW3	FW6	FW8
	kPa	kPa	kPa	kPa
50	0.36	0.17	0.09	0.04
100	1.19	0.56	0.31	0.14
200	3.94	1.86	1.01	0.47
300	7.97	3.75	2.04	0.96
400	13.14	6.18	3.36	1.57
500	19.39	9.12	4.95	2.32
600	26.64	12.53	6.79	3.18
800	44.01	20.69	11.2	5.24
1000	64.97	30.54	16.52	7.72
1500		62.01	33.49	15.64
2000		102.52	55.34	25.84
2500			81.71	38.15
3000			112.36	52.45
4000				86.7
5000				

4TW60019-1A(2/3)

7 Hydraulic performance


7 - 3 Water Pressure Drop Curve Evaporator - Heating 4-pipe

FWZ-AF
FWR-AF
FWS-AF

Water Flow l/h	Water Pressure Drop			
	FW2	FW3	FW6	FW8
	kPa	kPa	kPa	kPa
50	0.84	0.28	0.25	0.32
100	2.78	0.94	0.82	1.05
200	9.27	3.13	2.72	3.47
300	18.76	6.33	5.48	6.99
400	30.96	10.43	9.03	11.49
500	45.69	15.39	13.3	16.9
600	62.8	21.14	18.26	23.19
800	103.76	34.91	30.12	38.2
1000		51.53	44.43	56.31
1500		104.6	90.1	114.07

4TW60019-1A(3/3)

Daikin Europe N.V. Naamloze Vennootschap - Zandvoordestraat 300, B-8400 Oostende - Belgium - www.daikin.eu - BE 0412 120 336 - RPR Oostende



EEDEN17

06/17



Daikin Europe N.V. participates in the Eurovent Certification programme for Liquid Chilling Packages (LCP), Air handling units (AHU), Fan coil units (FCU) and variable refrigerant flow systems (VRF) Check ongoing validity of certificate online: www.eurovent-certification.com or using: www.certiflash.com



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.