

Replacement VRV Technical data book RQCEQ-P3



RQCEQ280PY13
RQCEQ360PY13
RQCEQ460PY13
RQCEQ500PY13
RQCEQ540PY13
RQCEQ636PY13
RQCEQ712PY13
RQCEQ744PY13
RQCEQ816PY13
RQCEQ848PY13
RQEQ140PY13
RQEQ180PY13
RQEQ212PY13

Table of contents

RQCEQ-P3

1	Features	4
	RQCEQ-P3	4
2	Specifications	5
3	Electrical data	10
4	Options	11
5	Capacity tables	12
	Capacity Table Legend	12
	Capacity Correction Factor	13
6	Dimensional drawings	19
7	External connection diagrams	23
8	Installation	25
	Service Space	25
	Refrigerant Pipe Selection	26
	Fixation and Foundation of Units	29
9	Operation range	30
10	Appropriate Indoors	31
11	Centre of gravity	32
12	Piping diagrams	33
13	Wiring diagrams	34
	Wiring Diagrams - Three Phase	34
14	Sound data	35
	Sound Pressure Spectrum	35

1 Features

1 - 1 RQCEQ-P3

Quick & quality replacement for R-22 and R-407C systems

1

- › Cost effective and fast replacement as only the outdoor and indoor unit needs to be replaced, meaning almost no work has to be carried out inside the building
- › Efficiency gains of more than 40% can be realized, thanks to technological developments in heat pump technology and the more efficient R-410A refrigerant
- › Less intrusive and time consuming installation compared to installing a new system, as the refrigerant piping can be maintained
- › Unique automatic refrigerant charge eliminates the need to calculate refrigerant volume and allows safe replacement of competitor replacement
- › Automatic cleaning of refrigerant piping ensures a clean piping network, even when a compressor breakdown has occurred
- › Possibility to add indoor units and increase capacity without changing the refrigerant piping
- › Possibility to spread the various stages of replacement thanks to the modular design of the VRV system
- › Keep your system in top condition via the Daikin Cloud Service: 24/7 monitoring for maximum efficiency, extended lifetime and immediate service support thanks to failure prediction



Inverter



2 Specifications

1 - 1 RQCEQ-P3

Technical specifications System					RQCEQ280P3	RQCEQ360P3	RQCEQ460P3	RQCEQ500P3	RQCEQ540P3	
System	Outdoor unit module 1				RQEQ140P3	RQEQ180P3	RQEQ140P3		RQEQ180P3	
	Outdoor unit module 2				RQEQ140P3	RQEQ180P3	RQEQ140P3	RQEQ180P3		
	Outdoor unit module 3				RQEQ180P3					
Recommended combination					4 x FXMQ63P7VEB	4 x FXMQ50P7VEB + 2 x FXMQ63P7VEB	4 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	4 x FXSQ32A2VEB + 8 x FXSQ40A2VEB	12 x FXSQ40A2VEB	
Cooling capacity	Prated,c	kW			28.0	36.0	46.0	50.0	54.0	
	Nom. 35°CDB	kW			28.0 (1)	36.0 (1)	45.0 (1)	50.0 (1)	54.0 (1)	
Heating capacity	Nom. 6°CWB	kW			32.0 (2)	40.0 (2)	52.0 (2)	56.0 (2)	60.0 (2)	
	Prated,h	kW			32.0	40.0	52.0	56.0	60.0	
Power input - 50Hz	Cooling Nom. 35°CDB	kW			7.04	10.3	12.2	13.9	15.5	
	Heating Nom. 6°CWB	kW			8.00	10.7	13.4	14.7	16.1	
EER at nom. capacity	35°CDB				kW/kW	3.98	3.48	3.77	3.61	
COP at max. capacity	6°CWB				kW/kW	4.00	3.72	3.89	3.80	
ηs,c					%	200	185	191	201	
ηs,h					%	159	157	161	150	
Space cooling	A Condition (35°C - 27/19)	EERd				2.29	1.81	2.01	2.30	2.22
		Pdc	kW			28.0	36.0	46.0	50.0	54.0
	B Condition (30°C - 27/19)	EERd				4.37	3.90	4.09	4.00	3.86
		Pdc	kW			20.6	26.5	33.9	36.8	39.8
	C Condition (25°C - 27/19)	EERd				7.19	6.84	6.93	7.00	6.89
		Pdc	kW			13.3	17.1	21.8	23.7	25.6
	D Condition (20°C - 27/19)	EERd				9.32	8.03	8.87	10.2	
		Pdc	kW			5.89	7.58	9.69	10.5	11.4
Space heating (Average climate)	TBivalent	COPd (declared COP)			2.22	2.25	2.41	1.85	1.83	
		Pdh (declared heating cap)			kW	17.0	21.2	27.6	29.7	31.9
		Tbiv (bivalent temperature)			°C	-10				
	TOL	COPd (declared COP)			2.22	2.25	2.41	1.85	1.83	
		Pdh (declared heating cap)			kW	17.0	21.2	27.6	29.7	31.9
	A Condition (-7°C)	COPd (declared COP)			2.62	2.46	2.56	2.21		
		Pdh (declared heating cap)			kW	15.0	18.8	24.4	26.3	28.2
	B Condition (2°C)	COPd (declared COP)			3.73	3.55	3.70	3.51	3.56	
		Pdh (declared heating cap)			kW	9.15	11.4	14.9	16.0	17.2
	C Condition (7°C)	COPd (declared COP)			5.83	6.29	6.07	5.85	5.26	
		Pdh (declared heating cap)			kW	5.88	7.36	9.56	10.3	11.0
	D Condition (12°C)	COPd (declared COP)			8.04	8.50	8.88	8.16	8.48	
		Pdh (declared heating cap)			kW	5.08	6.22	5.64	5.16	5.36
	Capacity range	HP				10	13	16	18	20
	Maximum number of connectable indoor units					21	28	34	39	43
	Indoor index connection	Min.				140	180	230	250	270
Nom.				280	360	500		540		
Max.				364	468	598	650	702		
Casing	Colour				Ivory white (Munsell code: 5Y7.5/1)					
Heat exchanger	Air flow rate	Cooling Rated	m ³ /h		11,400	13,200	18,000	18,900	19,800	
		Heating Rated	m ³ /h		11,400	13,200	18,000	18,900	19,800	
Operation range	Cooling	Min.			°CDB					
		Max.			°CDB					
	Heating	Min.			°CWB					
		Max.			°CWB					
Sound power level	Cooling Nom.	dB			82	87	88	89		
Refrigerant	Type				R-410A					
	GWP				2,087.5					
	Control				Electronic expansion valve					
Piping connections	Liquid	Type				Braze connection				
		OD	mm			9.52	12.7	15.9		
	Gas	Type				Braze connection				
		OD	mm			22.2	25.4	28.6		
	Total piping length	System	Actual		m					
Level difference	OU - IU	Outdoor unit in highest position		m						
Capacity control	Method				Inverter controlled					
Supplementary heater	Back-up capacity	Heating	elbu kW		0.000					

2 Specifications

1 - 1 RQCEQ-P3

2

Technical specifications System					RQCEQ280P3	RQCEQ360P3	RQCEQ460P3	RQCEQ500P3	RQCEQ540P3
Power consumption in other than active mode	Crankcase heater mode	Heating	PCK	kW	0.083			0.125	
		Off mode	Cooling	POFF	kW	0.289			0.433
	Standby mode	Heating	POFF	kW	0.084			0.125	
		Cooling	PSB	kW	0.289			0.433	
	Thermostat-off mode	Heating	PSB	kW	0.084			0.125	
		Cooling	PTO	kW	0.089			0.134	
		Heating	PTO	kW	0.161			0.241	
Cooling	Cdc (Degradation cooling)				0.25				
Heating	Cdh (Degradation heating)				0.25				
Piping connections	Discharge gas	OD		mm	19.1			22.2	
		Type	Braze connection						
	Piping length	OU - IU	Max.	m	120				
Refrigerant	Circuits	Quantity			1				

Technical specifications System					RQCEQ636P3	RQCEQ712P3	RQCEQ744P3	RQCEQ816P3	RQCEQ848P3	
System	Outdoor unit module 1				RQEQ212P3		RQEQ140P3		RQEQ180P3	RQEQ212P3
	Outdoor unit module 2				RQEQ212P3		RQEQ180P3		RQEQ212P3	
	Outdoor unit module 3				RQEQ212P3		RQEQ180P3	RQEQ212P3		
	Outdoor unit module 4				RQEQ212P3					
Recommended combination					3 x FXSQ40A2VEB + 9 x FXSQ50A2VEB	4 x FXSQ32A2VEB + 9 x FXSQ40A2VEB + 3x	4 x FXSQ32A2VEB + 6 x FXSQ40A2VEB + 6x	7 x FXSQ40A2VEB + 9 x FXSQ50A2VEB	4 x FXSQ40A2VEB + 12 x FXSQ50A2VEB	
Cooling capacity	Prated,c			kW	60.0	70.0	72.0	78.0	80.0	
	Nom.	35°CDB		kW	63.6 (1)	71.2 (1)	74.4 (1)	81.6 (1)	84.8 (1)	
Heating capacity	Nom. 6°CWB			kW	67.2 (2)	78.4 (2)	80.8 (2)	87.2 (2)	89.6 (2)	
	Prated,h			kW	67.2	78.4	80.8	87.2	89.6	
Power input - 50Hz	Cooling	Nom.	35°CDB	kW	21.9	21.2	23.3	27.1	29.2	
	Heating	Nom.	6°CWB	kW	17.7	20.7	21.2	23.1	23.6	
EER at nom. capacity	35°CDB			kW/kW	2.90	3.36	3.19	3.01	2.90	
COP at max. capacity	6°CWB			kW/kW	3.79	3.80	3.81	3.77	3.79	
ηs,c					%	186	194		204	187
ηs,h					%	157	153	155		157
Space cooling	A Condition (35°C - 27/19)	EERd		kW	1.74	2.11	1.97	1.83	1.74	
		Pdc		kW	60.0	70.0	72.0	78.0	80.0	
	B Condition (30°C - 27/19)	EERd		kW	3.63	3.88	3.82	3.68	3.63	
		Pdc		kW	44.2	51.6	53.1	57.5	59.0	
	C Condition (25°C - 27/19)	EERd		kW	6.57	6.87	6.78	6.64	6.57	
		Pdc		kW	28.4	33.2	34.1	37.0	37.9	
	D Condition (20°C - 27/19)	EERd		kW	9.90	9.56		10.20		
		Pdc		kW	13.4	15.0	15.7	17.2	17.9	
Space heating (Average climate)	TBivalent	COPd (declared COP)			1.63	1.78	1.73	1.67	1.63	
		Pdh (declared heating cap)			kW	35.7	41.6	42.9	46.3	47.6
		Tbiv (bivalent temperature)			°C	-10				
	TOL	COPd (declared COP)			1.63	1.78	1.73	1.67	1.63	
		Pdh (declared heating cap)			kW	35.7	41.6	42.9	46.3	47.6
		A			COPd (declared COP)	2.19		2.20		2.19
	Condition (-7°C)	Pdh (declared heating cap)			kW	31.6	36.8	38.0	41.0	42.1
		B	COPd (declared COP)			3.92	3.62	3.72	3.83	3.92
			Pdh (declared heating cap)			kW	19.2	22.4	23.1	25.0
	Condition (2°C)	C			COPd (declared COP)	5.40	5.81	5.83	5.36	5.40
		Pdh (declared heating cap)			kW	12.4	14.4	14.9	16.0	16.5
	Condition (7°C)	D			COPd (declared COP)	8.53	8.45	8.84	9.09	9.07
Pdh (declared heating cap)			kW	5.49	6.41	6.60	7.13	7.32		
Capacity range					HP	22	24	26	28	30
Maximum number of connectable indoor units						47	52	56	60	64
Indoor index connection	Min.				318	356	372	408	424	
	Nom.				636	712	744	816	848	
	Max.				827	926	967.0	1,061	1,102	
Casing	Colour				Ivory white (Munsell code: 5Y7.5/1)					
Heat exchanger	Air flow rate	Cooling	Rated	m ³ /h	19,800	25,500		26,400		
		Heating	Rated	m ³ /h	19,800	25,500		26,400		
Operation range	Cooling	Min.			°CDB					
		Max.			°CDB					
	Heating	Min.			°CWB					
		Max.			°CWB					
Sound power level	Cooling	Nom.			dBA	93	92	93	95	

2 Specifications

1 - 1 RQCEQ-P3

Technical specifications System				RQCEQ636P3	RQCEQ712P3	RQCEQ744P3	RQCEQ816P3	RQCEQ848P3	
Refrigerant	Type	R-410A							
	GWP	2,087.5							
	Control	Electronic expansion valve							
Piping connections	Liquid	Type	Braze connection						
		OD	mm	15.9		19.1			
	Gas	Type	Braze connection						
		OD	mm	28.6		34.9			
	Total piping length	System	Actual	m		300			
Level difference	OU - IU	Outdoor unit in highest position	m		50				
Capacity control	Method Inverter controlled								
Supplementary heater	Back-up capacity	Heating	elbu	kW		0.000			
Power consumption in other than active mode	Crankcase heater mode	Heating	PCK	kW		0.125		0.167	
		Off mode	Cooling	POFF	kW		0.433	0.577	0.144
	Standby mode	Heating	POFF	kW		0.125	0.167		
		Cooling	PSB	kW		0.433	0.577	0.144	0.577
	Thermostat-off mode	Heating	PSB	kW		0.125	0.167		
		Cooling	PTO	kW		0.134	0.179	0.045	0.179
	Heating	PTO	kW		0.241	0.322			
Cooling	Cdc (Degradation cooling)				0.25				
Heating	Cdh (Degradation heating)				0.25				
Piping connections	Discharge gas	OD	mm		25.4		28.6		
	Type	Braze connection							
	Piping length	OU - IU	Max.	m		120			
Refrigerant	Circuits	Quantity		1					

Electrical specifications System				RQCEQ280P3	RQCEQ360P3	RQCEQ460P3	RQCEQ500P3	RQCEQ540P3
Power supply	Name	Y1						
	Phase	3~						
	Frequency	Hz	50					
	Voltage	V	400					
Voltage range	Min.	%						
	Max.	%						
Current - 50Hz	Minimum circuit amps (MCA)	A	23.8		34.5	41.0	46.4	51.7
	Maximum fuse amps (MFA)	A	30		40	50	60	
	Total overcurrent amps (TOCA)	A	31.2			46.8		

Electrical specifications System				RQCEQ636P3	RQCEQ712P3	RQCEQ744P3	RQCEQ816P3	RQCEQ848P3
Power supply	Name	Y1						
	Phase	3~						
	Frequency	Hz	50					
	Voltage	V	400					
Voltage range	Min.	%						
	Max.	%						
Current - 50Hz	Minimum circuit amps (MCA)	A	55.5		64.9	66.1	72.7	74.0
	Maximum fuse amps (MFA)	A	70		80		90	
	Total overcurrent amps (TOCA)	A	46.8			62.4		

(1)Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB; equivalent piping length: 7.5m; level difference: 0m |

(2)Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 7.5m; level difference: 0m |

TOCA means the total value of each OC set. |

MSC means the maximum current during start up of the compressor |

Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits. |

Maximum allowable voltage range variation between phases is 2%. |

Select wire size based on the larger value of MCA or TOCA |

MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker). |

Contains fluorinated greenhouse gases

Technical specifications Module			RQEQ140P3	RQEQ180P3	RQEQ212P3
Cooling capacity	Prated,c	kW	14.0	18.0	20.0
Heating capacity	Prated,h	kW	16.0	20.0	22.4
ηs,c		%	194	190	182
ηs,h		%	137	145	153
Space cooling	A Condition (35°C -27/19)	EERd	2.54	2.22	1.74
		Pdc	14.0	18.0	20.0
	B Condition (30°C -27/19)	EERd	4.40	3.86	3.63
		Pdc	10.3	13.3	14.7
	C Condition (25°C -27/19)	EERd	7.31	6.89	6.57
		Pdc	6.63	8.53	9.47
	D Condition (20°C -27/19)	EERd	9.29	9.54	9.64
		Pdc	5.01	4.94	4.95

2 Specifications

1 - 1 RQCEQ-P3

2

Technical specifications Module					RQEQ140P3	RQEQ180P3	RQEQ212P3	
Space heating (Average climate)	TBivalent	COPd (declared COP)			1.92	1.84	1.64	
		Pd _h (declared heating cap) kW			8.5	10.6	11.9	
		T _{biv} (bivalent temperature) °C				-10		
	TOL	COPd (declared COP)			1.92	1.84	1.64	
		Pd _h (declared heating cap) kW			8.5	10.6	11.9	
	A	COPd (declared COP)			2.20	2.22	2.20	
		Pd _h (declared heating cap) kW			7.52	9.40	10.5	
	Condition (-7°C)	B	COPd (declared COP)			3.42	3.56	3.92
			Pd _h (declared heating cap) kW			4.58	5.72	6.41
	Condition (2°C)	C	COPd (declared COP)			4.84	5.26	5.40
Pd _h (declared heating cap) kW			3.29	3.68	4.12			
Condition (7°C)	D	COPd (declared COP)			6.43	6.82	6.88	
		Pd _h (declared heating cap) kW			4.18	4.40	4.44	
Dimensions	Unit	Height	mm		1,680			
		Width	mm		635			
		Depth	mm		765			
Weight	Unit	kg		175		179		
Casing	Colour Ivory white (Munsell code: 5Y7.5/1)							
Heat exchanger	Type Cross fin coil							
	Air flow rate	Cooling	Rated	m ³ /h	5,700	6,600		
		Heating	Rated	m ³ /h	5,700	6,600		
Fan	Air flow rate	Cooling	Nom.	m ³ /min	95	110		
Fan motor	Quantity 1							
	Output W 350							
Compressor	Quantity 1							
	Type Hermetically sealed scroll compressor							
Operation range	Cooling	Min.	°CDB		-5			
		Max.	°CDB		43			
	Heating	Min.	°CWB		-20			
		Max.	°CWB		15.5			
Sound power level	Cooling	Nom.	dBA		79	83	87	
Refrigerant	Type R-410A							
	GWP 2,087.5							
	Charge	TCO ₂ Eq			21.5	22.1	23.4	
	Charge	kg			10.3	10.6	11.2	
	Control Electronic expansion valve							
Piping connections	Liquid	Type	Braze connection					
		OD	mm		9.52			
	Gas	Type	Braze connection					
		OD	mm		15.9	19.1		
Defrost method	Deicer							
Capacity control	Method Inverter controlled							
Supplementary heater	Back-up capacity	Heating	elbu	kW		0.000		
		Heating	PCK	kW		0.042		
Power consumption in other than active mode	Crankcase heater mode	Heating	kW		0.042			
		Off mode	Cooling	POFF	kW		0.144	
	Standby mode	Heating	POFF	kW		0.042		
		Cooling	PSB	kW		0.144		
	Thermostat-off mode	Heating	PSB	kW		0.042		
		Cooling	PTO	kW		0.045		
Cooling	C _{dc} (Degradation cooling)			0.25				
Heating	C _{dh} (Degradation heating)			0.25				
Safety devices	Item	01	High pressure switch					
		02	Fan driver overload protector					
		03	Overcurrent relay					
		04	Inverter overload protector					
Capacity control	Steps	%		25 ~ 100	21 ~ 100			
Compressor	Output W			2,800	3,300	3,600		
	Piston displacement m ³ /h			13.34	15.75	16.89		
	Speed rpm			6,300	7,440	7,980		
	Starting method Soft start							
Cooling capacity	Nom. kW			14.0 (1)	18.0 (1)	21.2 (1)		
Fan	Type Propeller fan							
Fan motor	Drive Direct drive							
Heating capacity	Nom. kW			16.0 (2)	20.0 (2)	22.4 (2)		

2 Specifications

1 - 1 RQCEQ-P3

Technical specifications Module			RQEQ140P3	RQEQ180P3	RQEQ212P3
Piping connections	Discharge OD	mm	12.7	15.9	
	gas Type		Braze connection		
Refrigerant	Circuits	Quantity	1		

Electrical specifications Module			RQEQ140P3	RQEQ180P3	RQEQ212P3	
Power supply	Name		Y1			
	Phase		3~			
	Frequency	Hz	50			
	Voltage	V	380-415			
Voltage range	Min.	%	-10			
	Max.	%	10			
Current - 50Hz	Minimum circuit amps (MCA)	A	11.9	17.25	18.5	
	Maximum fuse amps (MFA)	A	15	20	22.5	
	Full load amps (FLA)	Fan motor	A	0.7	0.8	
Current	Nominal running current (RLA)	Compressor1 Cooling	A	4.8	7.2	10.7

(1)Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB; equivalent piping length: 7.5m; level difference: 0m |

(2)Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 7.5m; level difference: 0m |

TOCA means the total value of each OC set. |

MSC means the maximum current during start up of the compressor |

Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits. |

Maximum allowable voltage range variation between phases is 2%. |

Select wire size based on the larger value of MCA or TOCA |

MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker). |

Contains fluorinated greenhouse gases

3 Electrical data

3 - 1 Electrical Data


3

RQCEQ-P3

Model Name				Units				Power Supply Comp.					OFM	
Combination Unit	Independent Unit			Hz	Volts	Min.	Max.	MCA	TOCA	MFA	MSC	RLA	kW	FLA
RQCEQ280P3	RQE140P3	RQE140P3		50	380	342	456	23.8	31.2	30	-	4.6x2	0.35x2	0.7x2
											-	4.8x2		
											-	5.1x2		
RQCEQ360P3	RQE180P3	RQE180P3		50	380	342	456	34.5	31.2	40	-	6.9x2	0.35x2	0.8x2
											-	7.2x2		
											-	7.6x2		
RQCEQ460P3	RQE140P3	RQE140P3	RQE180P3	50	380	342	456	41.0	46.8	50	-	(4.6x2)+6.9	0.35x3	0.7x2+0.8
											-	(4.8x2)+7.2		
											-	(5.1x2)+7.6		
RQCEQ500P3	RQE140P3	RQE180P3	RQE180P3	50	380	342	456	46.4	46.8	60	-	4.6+(6.9x2)	0.35x3	0.7+0.8x2
											-	4.8+(7.2x2)		
											-	5.1+(7.6x2)		
RQCEQ540P3	RQE180P3	RQE180P3	RQE180P3	50	380	342	456	51.7	46.8	60	-	6.9x3	0.35x3	0.8x3
											-	7.2x3		
											-	7.6x3		
RQCEQ636P3	RQE212P3	RQE212P3	RQE212P3	50	380	342	456	55.5	46.8	70	-	10.3x3	0.35x3	0.8x3
											-	10.7x3		
											-	11.3x3		
RQCEQ712P3	RQE140P3	RQE180P3	RQE180P3	50	380	342	456	64.9	62.4	80	-	4.6+(6.9x2)+10.3	0.35x4	0.7+0.8x3
											-	4.8+(7.2x2)+10.7		
											-	5.1+(7.6x2)+11.3		
RQCEQ744P3	RQE140P3	RQE180P3	RQE212P3	50	380	342	456	66.1	62.4	80	-	4.6+6.9+(10.3x2)	0.35x4	0.7+0.8x3
											-	4.8+7.2+(10.7x2)		
											-	5.1+7.6+(11.3x2)		
RQCEQ816P3	RQE180P3	RQE212P3	RQE212P3	50	380	342	456	72.7	62.4	90	-	6.9+(10.3x3)	0.35x4	0.8x4
											-	7.2+(10.7x3)		
											-	7.6+(11.3x3)		
RQCEQ848P3	RQE212P3	RQE212P3	RQE212P3	50	380	342	456	74.0	62.4	90	-	10.3x4	0.35x4	0.8x4
											-	10.7x4		
											-	11.3x4		

SYMBOLS

- MCA : Min. Circuit Amps. (A)
- TOCA : Total Over-current Amps. (A)
- MFA : Max. Fuse Amps. (A)
- MSC : Max. Starting current
- RLA : Rated Load Amps. (A)
- OFM : Outdoor Fan Motor
- FLA : Full Load Amps. (A)
- kW : Rated Motor Output (kW)



The relationship between the starting time and the starting current

NOTES

1. RLA is based on the following conditions, Indoor temperature, 27°C DB/19.0°C WB Outdoor temperature, 35°C DB
2. TOCA means the total value of each OC set.
3. MSC means the Max. current during the starting of compressor.
4. Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
5. Maximum allowable voltage variation between phases is 2%
6. Select wire size based on the value of MCA or TOCA.
7. MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker).

3D066809B

4 Options

4 - 1 Options

RQCEQ-P3

Series		VRV III - Q			
Model		RQCEQ280P3 RQCEQ360P3	RQCEQ460P3 RQCEQ500P3	RQCEQ540P3 RQCEQ636P3	RQCEQ712P3 RQCEQ744P3 RQCEQ816P3 RQCEQ848P3
Option name					
Cool/heater selector					
Fixing box		KJB11A			
Distributive piping	Refnet header	KHRQ23M29H KHRQ23M64H		KHRQ23M29H KHRQ23M64H KHRQ23M75H	
	Refnet joint	KHRQ23M20T KHRQ23M29T9 KHRQ23M64T		KHRQ23M20T KHRQ23M29T9 KHRQ23M64T KHRQ23M75T	
Pipe size reducer					
Outdoor unit multi Connection piping kit		BHFP26P36C	BHFP26P63C		BHFP26P84C

3D066354A

5 Capacity tables

5 - 1 Capacity Table Legend

5

In order to fulfill more your requirements on quick access of data in the format you require, we have developed a tool to consult capacity tables.

Below you can find the link to the capacity table database and an overview of all the tools we have to help you select the correct product:

- **Capacity table database:** lets you find back and export quickly the capacity information you are looking for based upon unit model, refrigerant temperature and connection ratio.
- You can access the capacity table viewer here:
https://my.daikin.eu/content/denv/en_US/home/applications/software-finder/capacity-table-viewer.html



- An overview of **all software tools** that we offer can be found here:
https://my.daikin.eu/denv/en_US/home/applications/software-finder.html




5 Capacity tables


5 - 2 Capacity Correction Factor

RQCEQ280P3

1. Rate of change in cooling capacity

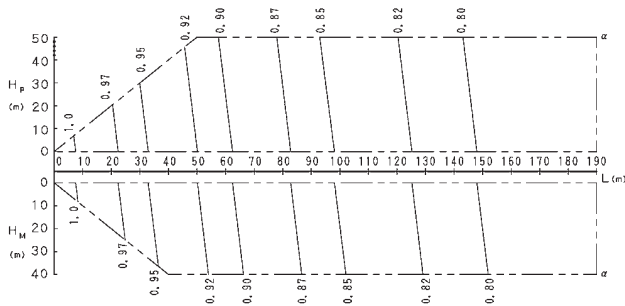

2. Rate of change in heating capacity

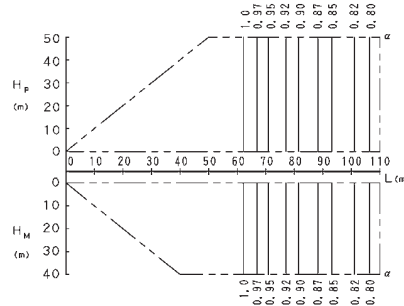

[Diameter of the main pipes (standard size)]

Model	Liquid
RQCEQ280P3	ø 9.5

[Explanation of symbols]

- Hp: Level difference (m) between indoor and outdoor units where indoor unit in inferior position
- Hm: Level difference (m) between indoor and outdoor units where indoor unit in superior position
- L: Equivalent pipe length (m)
- α: Capacity correction factor

3D066851A

NOTES

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units.

- Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \left[\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination} \right] \times \left[\text{Capacity change rate due to piping length to the farthest indoor unit} \right]$$

- Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \left[\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination} \right] \times \left[\text{Capacity change rate due to piping length to the farthest indoor unit} \right]$$

- When overall equivalent pipe length is 90m or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.


[Diameter of above case]

Model	Liquid
RQCEQ280P3	ø 12.7

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows, (heating only)

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.2 + (\text{Equivalent length after branching})$$

(example)

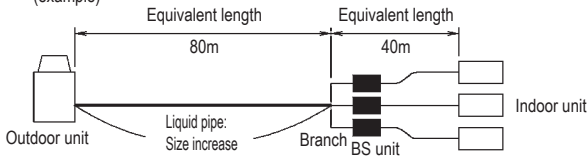


In the above case (Heating) Overall equivalent length = 80m x 0.2 + 40m = 56m. The correction factor in capacity when Hp=0m is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.5 + (\text{Equivalent length after branching})$$

(example)

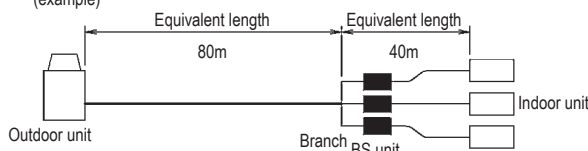

In the above case (Cooling) Overall equivalent length = 80m x 0.5 + 40m = 80m. The correction factor in capacity when Hp=0m is thus approximately 0.88.


5 Capacity tables

5 - 2 Capacity Correction Factor


5

RQCEQ360,500P3

1. Rate of change in cooling capacity

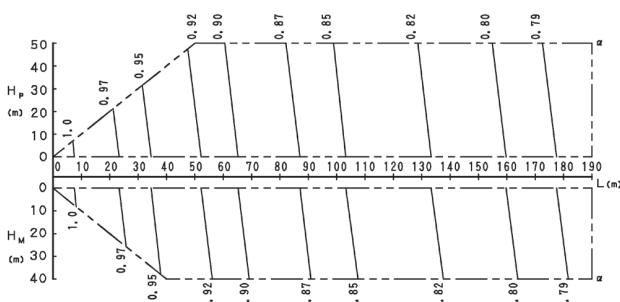

2. Rate of change in heating capacity

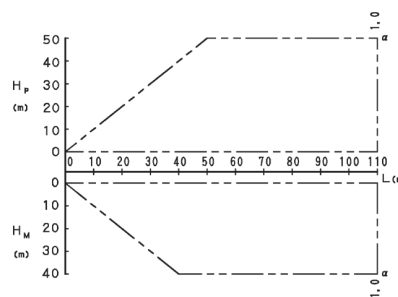

[Diameter of the main pipes (standard size)]

Model	Liquid
RQCEQ360P3	ø 12.7
RQCEQ500P3	ø 15.9

[Explanation of symbols]

H_p: Level difference (m) between indoor and outdoor units where indoor unit in inferior position

H_m: Level difference (m) between indoor and outdoor units where indoor unit in superior position

L: Equivalent pipe length (m)

α: Capacity correction factor

3D066852A

NOTES

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units.

- Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$

- Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$

- When overall equivalent pipe length is 90m or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.


[Diameter of above case]

Model	Liquid
RQCEQ360P3	ø 15.9
RQCEQ500P3	ø 19.1

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows, (heating only)

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times \text{Correction factor} + (\text{Equivalent length after branching})$$

(example)

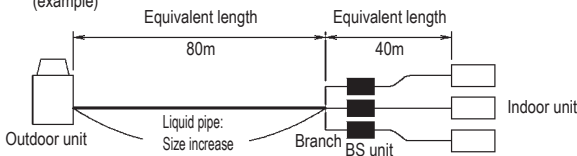


Model	Correction factor
RQCEQ360P3	ø 0.3
RQCEQ500P3	ø 0.4

In the above case (Heating) Overall equivalent length = 80m x 0.4 + 40m = 72m. The correction factor in capacity when H_p=0m is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.5 + (\text{Equivalent length after branching})$$

(example)

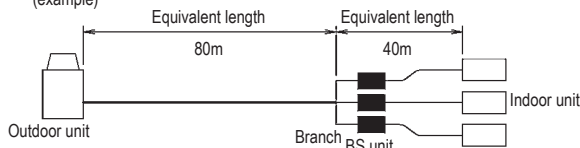


In the above case (Cooling) Overall equivalent length = 80m x 0.5 + 40m = 80m. The correction factor in capacity when H_p=0m is thus approximately 0.88.

5 Capacity tables


5 - 2 Capacity Correction Factor

RQCEQ460P3

1. Rate of change in cooling capacity

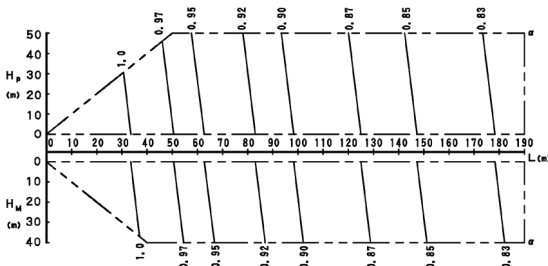

2. Rate of change in heating capacity

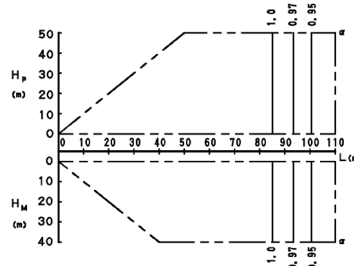

[Diameter of pipe (standard size)]

Model	Liquid
RQCEQ460P3	ø 12.7

[Explanation of symbols]

Hp: Level difference (m) between indoor and outdoor units where indoor unit in inferior position

Hm: Level difference (m) between indoor and outdoor units where indoor unit in superior position

L: Equivalent pipe length (m)

Q: Capacity correction factor

3D066870A

NOTES

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units.

- Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \left[\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination} \right] \times \left[\text{Capacity change rate due to piping length to the farthest indoor unit} \right]$$

- Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \left[\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination} \right] \times \left[\text{Capacity change rate due to piping length to the farthest indoor unit} \right]$$

- When overall equivalent pipe length is 90m or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.


[Diameter of above case]

Model	Liquid
RQCEQ460P3	ø 15.9

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows, (heating only)

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.3 + (\text{Equivalent length after branching})$$

(example)

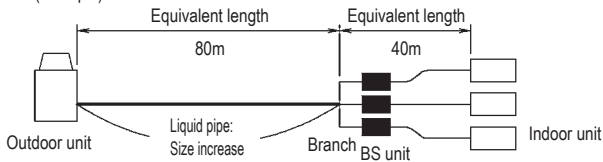


In the above case (Heating) Overall equivalent length = 80m x 0.3 + 30m = 64m. The correction factor in capacity when Hp=0m is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.5 + (\text{Equivalent length after branching})$$

(example)

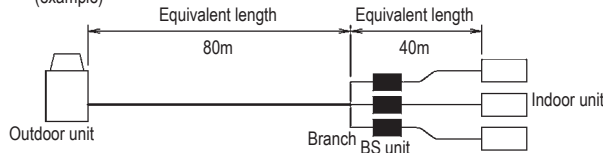

In the above case (Cooling) Overall equivalent length = 80m x 0.5 + 40m = 80m. The correction factor in capacity when Hp=0m is thus approximately 0.93.


5 Capacity tables

5 - 2 Capacity Correction Factor


5

RQCEQ540,744P3

1. Rate of change in cooling capacity

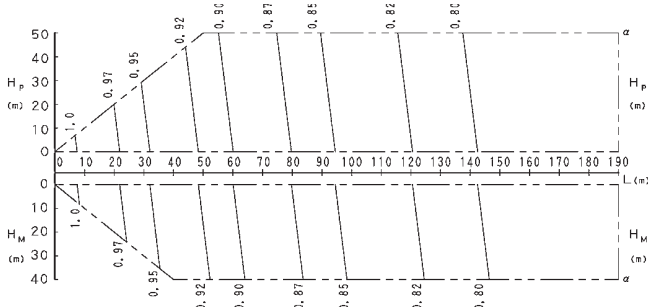

2. Rate of change in heating capacity

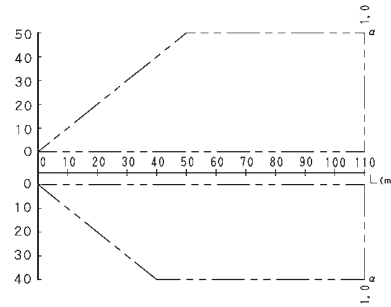

[Diameter of the main pipes (standard size)]

Model	Liquid
RQCEQ540P3	ø 15.9
RQCEQ744P3	ø 19.1

[Explanation of symbols]
 Hp: Level difference (m) between indoor and outdoor units where indoor unit is in inferior position
 Hm: Level difference (m) between indoor and outdoor units where indoor unit is in superior position
 L: Equivalent pipe length (m)
 α: Capacity correction factor

3D066853A

NOTES

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- Method of calculating A/C (cooling/heating) capacity:
 The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units.

- Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$

- Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination} \times \text{Capacity change rate due to piping length to the farthest indoor unit}$$


- When overall equivalent pipe length is 90m or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.
 [Diameter of above case]

Model	Liquid
RQCEQ540P3	ø 19.1
RQCEQ744P3	ø 22.2

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows, (heating only)

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.4 + (\text{Equivalent length after branching})$$

(example)

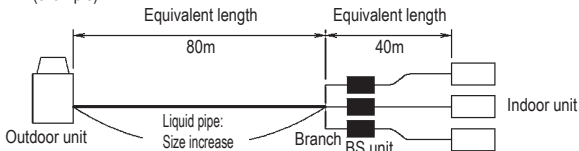


In the above case (Heating) Overall equivalent length = 80m x 0.4 + 40m = 72m. The correction factor in capacity when Hp=0m is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.5 + (\text{Equivalent length after branching})$$

(example)

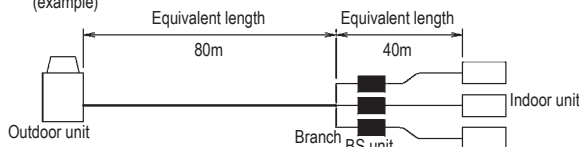


In the above case (Cooling) Overall equivalent length = 80m x 0.5 + 40m = 80m. The correction factor in capacity when Hp=0m is thus approximately 0.87.

5 Capacity tables


5 - 2 Capacity Correction Factor

RQCEQ636-848P3

1. Rate of change in cooling capacity

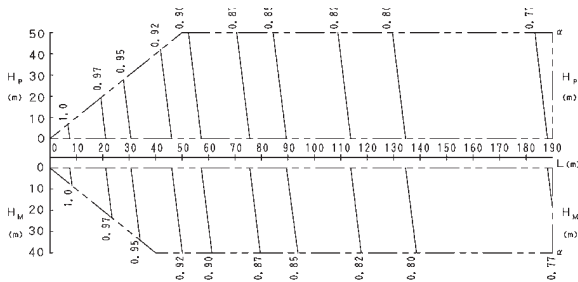

2. Rate of change in heating capacity

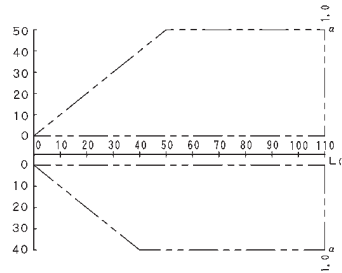

[Diameter of the main pipes (standard size)]

Model	Liquid
RQCEQ636P3	ø 15.9
RQCEQ712P3	ø 15.9
RQCEQ848P3	ø 19.1

[Explanation of symbols]

- Hp: Level difference (m) between indoor and outdoor units where indoor unit in inferior position
- Hm: Level difference (m) between indoor and outdoor units where indoor unit in superior position
- L: Equivalent pipe length (m)
- α: Capacity correction factor

3D066855A

NOTES

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units.

- Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \left[\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination} \right] \times \left[\text{Capacity change rate due to piping length to the farthest indoor unit} \right]$$

- Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \left[\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination} \right] \times \left[\text{Capacity change rate due to piping length to the farthest indoor unit} \right]$$

- When overall equivalent pipe length is 90m or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.


[Diameter of above case]

Model	Liquid
RQCEQ636P3	ø 19.1
RQCEQ712P3	ø 19.1
RQCEQ848P3	ø 22.2

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows, (heating only)

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.4 + (\text{Equivalent length after branching})$$

(example)

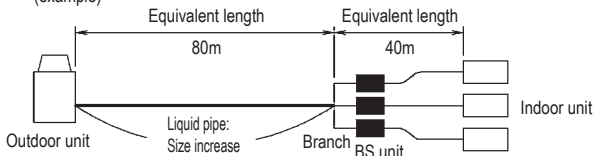


In the above case (Heating) Overall equivalent length = 80m x 0.4 + 40m = 72m. The correction factor in capacity when Hp=0m is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.5 + (\text{Equivalent length after branching})$$

(example)

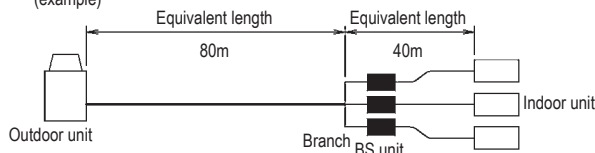

In the above case (Cooling) Overall equivalent length = 80m x 0.5 + 40m = 80m. The correction factor in capacity when Hp=0m is thus approximately 0.86.


5 Capacity tables

5 - 2 Capacity Correction Factor


5

RQCEQ816P3

1. Rate of change in cooling capacity

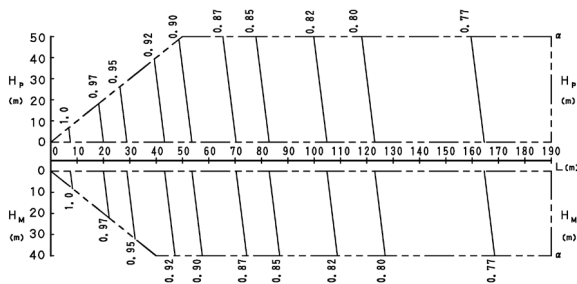

2. Rate of change in heating capacity

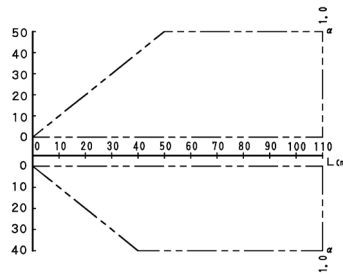

[Diameter of the main pipes (standard size)]

Model	Liquid
RQCEQ816P3	ø 19.1

[Explanation of symbols]

- Hp: Level difference (m) between indoor and outdoor units where indoor unit in inferior position
- Hm: Level difference (m) between indoor and outdoor units where indoor unit in superior position
- L: Equivalent pipe length (m)
- C: Capacity correction factor

3D066854A

NOTES

- These figures illustrate the rate of change in capacity of a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions there is only a minor deviation from the rate of change in capacity shown in the above figures.
- Method of calculating A/C (cooling/heating) capacity:
The maximum A/C capacity of the system will be either the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units as mentioned below, whichever smaller.

Calculating A/C capacity of outdoor units.

- Condition: Indoor unit combination ratio does not exceed 100%.

$$\text{Maximum A/C capacity of outdoor units} = \left[\text{A/C capacity of outdoor units obtained from capacity characteristic table at the 100\% combination} \right] \times \left[\text{Capacity change rate due to piping length to the farthest indoor unit} \right]$$

- Condition: Indoor unit combination ratio exceeds 100%.

$$\text{Maximum A/C capacity of outdoor units} = \left[\text{A/C capacity of outdoor units obtained from capacity characteristic table at the combination} \right] \times \left[\text{Capacity change rate due to piping length to the farthest indoor unit} \right]$$

- When overall equivalent pipe length is 90m or more, the diameter of the main liquid pipes (outdoor unit-branch sections) must be increased.


[Diameter of above case]

Model	Liquid
RQCEQ816P3	ø 22.2

- When the main sections of the interunit liquid pipe diameters are increased the overall equivalent length should be calculated as follows, (heating only)

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.4 + (\text{Equivalent length after branching})$$

(example)

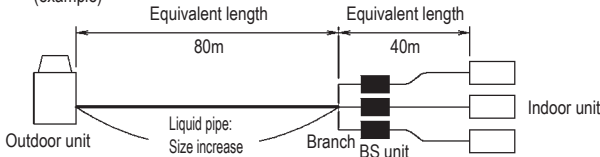


In the above case (Heating) Overall equivalent length = 80m x 0.4 + 40m = 72m. The correction factor in capacity when Hp=0m is thus approximately 1.0.

- In the combination which does not include cooling only indoor unit, Calculate the equivalent length pipe by the following when you calculate cooling capacity

$$\text{Overall equivalent length} = (\text{Equivalent length to main pipe}) \times 0.5 + (\text{Equivalent length after branching})$$

(example)



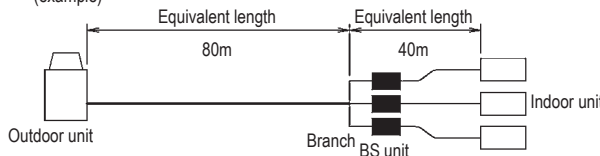


In the above case (Cooling) Overall equivalent length = 80m x 0.5 + 40m = 80m. The correction factor in capacity when Hp=0m is thus approximately 0.86.

6 Dimensional drawings

6 - 1 Dimensional Drawings

RQCEQ280-360P3

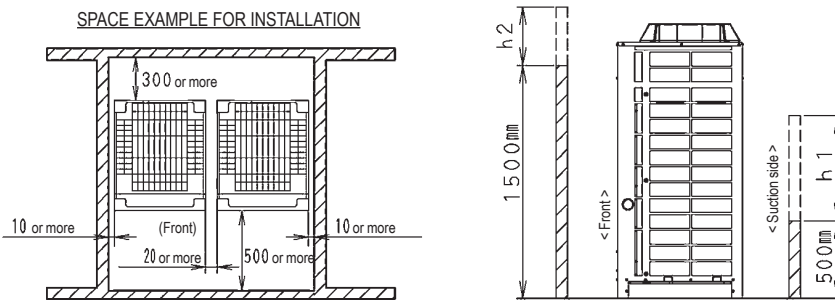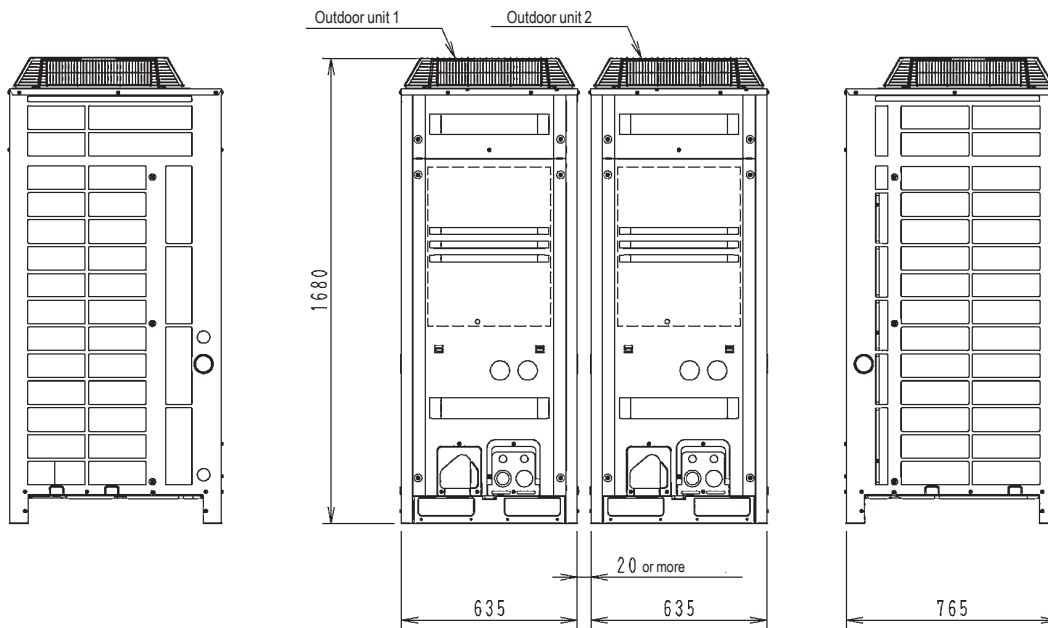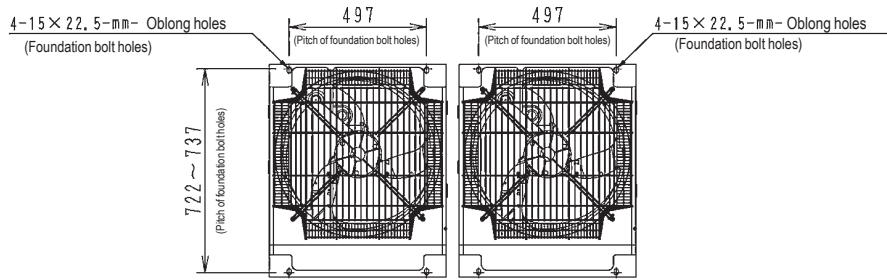

Model name	Outdoor unit 1	Drawing N°.	Outdoor Unit 2	Drawing N°.
RQCEQ280P3	RQE140P3	3D066441A	RQE140P3	3D066441A
RQCEQ360P3	RQE180P3	3D066441A	RQE180P3	3D066441A

Unit:mm

NOTES

- Heights of walls
 Front: 1500mm
 Suction side: 500mm
 Side: Height unrestricted
 The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 35°C.
 The installation space of suction side shown above must be expanded in the following case.
 - Design outdoor temperature becomes over 35°C.
 - Operating over Max. operating load
 (In case of causing a heavy heating load at indoor unit side)
- If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.
- When installing the units the most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall for the air to circulate freely. (If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuits.)
- The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.



3D066856A

6 Dimensional drawings

6 - 1 Dimensional Drawings

6

RQCEQ460-636P3

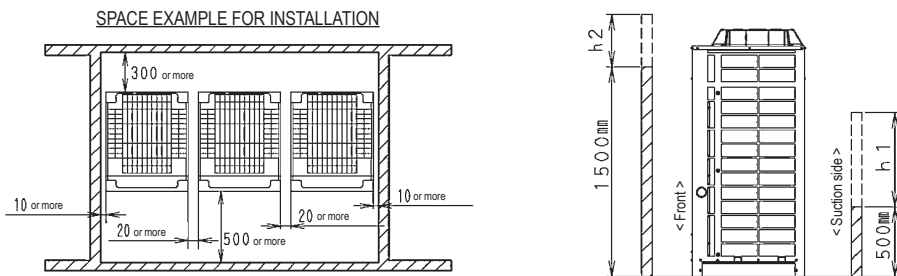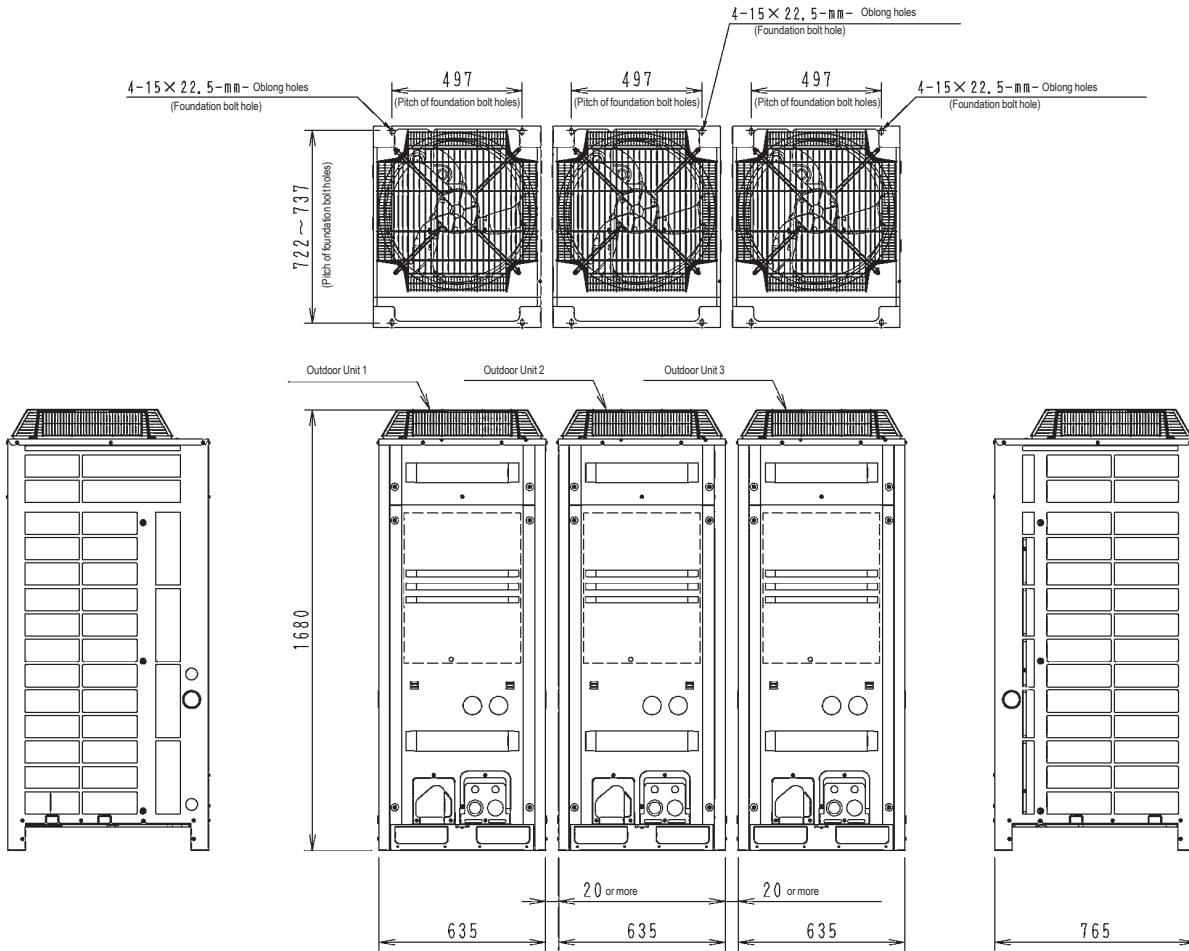

Unit:mm

Model name	Outdoor unit 1	Drawing N°.	Outdoor Unit 2	Drawing N°.	Outdoor unit 1	Drawing N°.
RQCEQ460P3	RQEQ180P3	3D066441A	RQEQ140P3	3D066441A	RQEQ140P3	3D066441A
RQCEQ500P3	RQEQ180P3	3D066441A	RQEQ180P3	3D066441A	RQEQ140P3	3D066441A
RQCEQ540P3	RQEQ180P3	3D066441A	RQEQ180P3	3D066441A	RQEQ180P3	3D066441A
RQCEQ636P3	RQEQ212P3	3D066441A	RQEQ212P3	3D066441A	RQEQ212P3	3D066441A

NOTES


- Heights of walls
Front: 1500mm
Suction side: 500mm
Side: Height unrestricted
The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 35°C.
The installation space of suction side shown above must be expanded in the following case.
- Design outdoor temperature becomes over 35°C.
- Operating over Max. operating load
(In case of causing a heavy heating load at indoor unit side)
- If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.
- When installing the units the most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall for the air to circulate freely. (If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuits.)
- The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.

3D066860A

6 Dimensional drawings

6 - 1 Dimensional Drawings

RQCEQ712-848P3

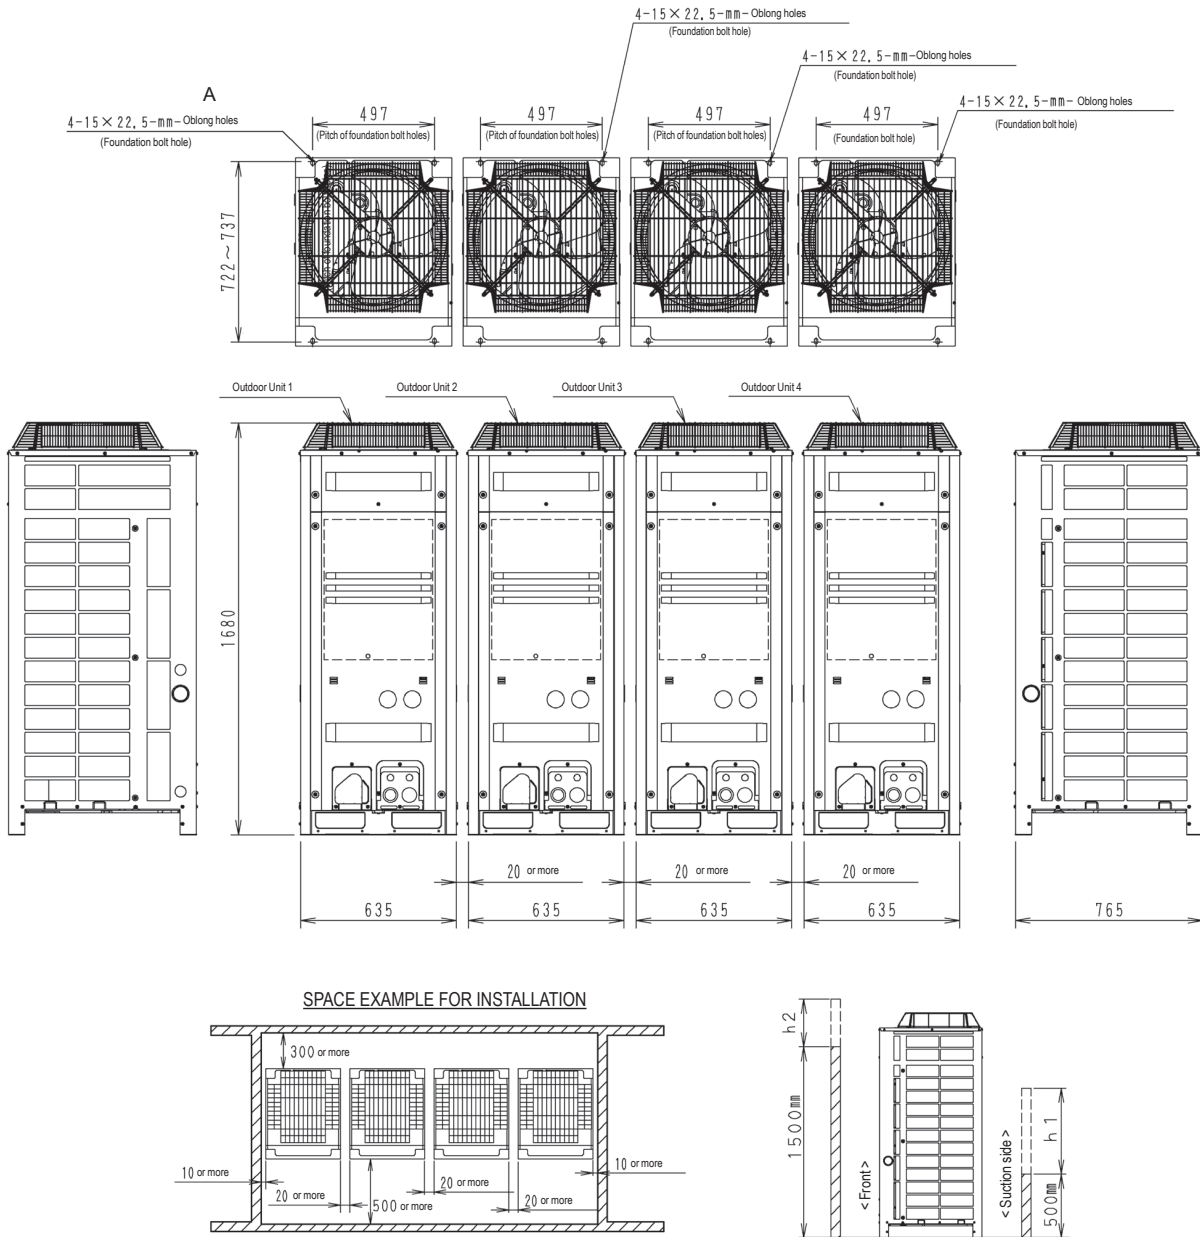

Unit: mm

Model name	Outdoor unit 1	Drawing N°.	Outdoor Unit 2	Drawing N°.	Outdoor unit 3	Drawing N°.	Outdoor unit 4	Drawing N°.
RQCEQ712P3	RREQ212P3	3D066441A	RREQ180P3	3D0664413	RREQ180PA	3D066441A	RREQ140P3	3D066441A
RQCEQ744P3	RREQ212P3	3D066441A	RREQ212P3	3D0664413	RREQ180PA	3D066441A	RREQ140P3	3D066441A
RQCEQ816P3	RREQ212P3	3D066441A	RREQ212P3	3D0664413	RREQ212PA	3D066441A	RREQ180P3	3D066441A
RQCEQ848P3	RREQ212P3	3D066441A	RREQ212P3	3D0664413	RREQ212PA	3D066441A	RREQ212P3	3D066441A

NOTES

- Heights of walls
 Front: 1500mm
 Suction side: 500mm
 Side: Height unrestricted
 The installation space shown in this figure is based on the condition of cooling operation at the outdoor air temperature of 35°C.
 The installation space of suction side shown above must be expanded in the following case.
 - Design outdoor temperature becomes over 35°C.
 - Operating over Max. operating load
 (In case of causing a heavy heating load at indoor unit side)
- If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the following figure.
- When installing the units the most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough room for a person to pass between units and wall for the air to circulate freely. (If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuits.)
- The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.


3D066865A

6 Dimensional drawings

6 - 1 Dimensional Drawings

6

RQEQ140P3

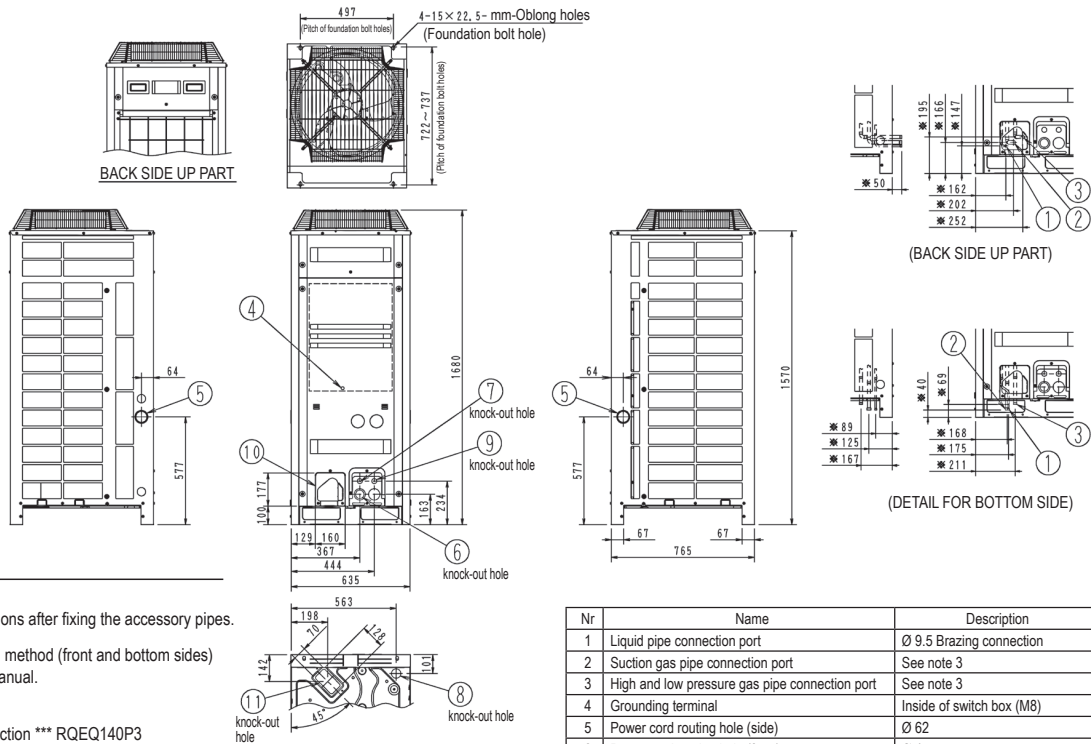

NOTES

- 1 ※ Shows the dimensions after fixing the accessory pipes.
- 2 For piping connection method (front and bottom sides) see the installation manual.
- 3 Suction gas pipe
 ø 15.9 Brazing connection *** RQEQ140P3
 ø 19.1 Brazing connection *** RQEQ180,212P3
 HP/LP gas pipe
 ø 12.7 Brazing connection *** RQEQ140P3
 ø 15.9 Brazing connection *** RQEQ180,212P3


Nr	Name	Description
1	Liquid pipe connection port	Ø 9.5 Brazing connection
2	Suction gas pipe connection port	See note 3
3	High and low pressure gas pipe connection port	See note 3
4	Grounding terminal	Inside of switch box (M8)
5	Power cord routing hole (side)	Ø 62
6	Power cord routing hole (front)	Ø 45
7	Power cord routing hole (front)	Ø 27
8	Power cord routing hole (bottom)	Ø 50
9	Wire routing hole (front)	Ø 27
10	Pipe routing hole (front)	See note 2
11	Pipe routing hole (bottom)	See note 2

3D066441A

7 External connection diagrams

7 - 1 External Connection Diagrams


RQCEQ280-360P3

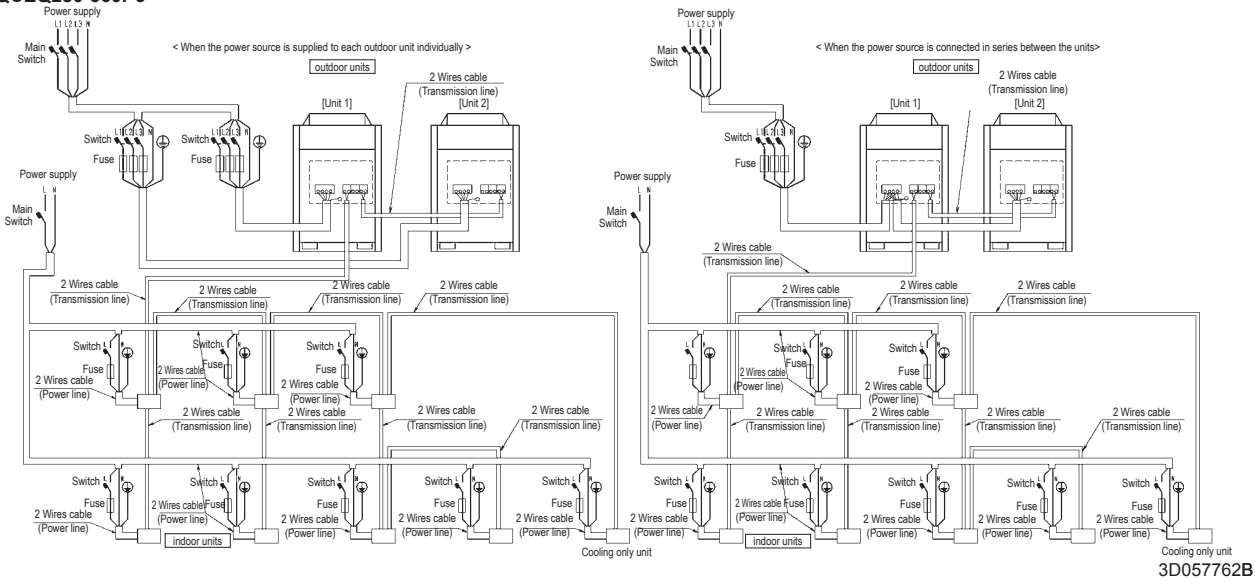

NOTES

1. All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
2. Use copper conductors only.
3. As for details, see wiring diagram.
4. Install circuit breaker for safety.
5. All field wiring and components must be provided by licensed electrician.
6. Unit shall be grounded in compliance with the applicable local and national codes.
7. Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
8. Be sure to install the switch and the fuse to the power line of each equipment.
9. Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
10. the capacity of UNIT1 must be larger than UNIT2 when the power source is connected in series between the units.
11. If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally. Running the product in reversed phase may break the compressor and other parts.
12. Must install earth leakage circuit breaker.

RQCEQ460-636P3

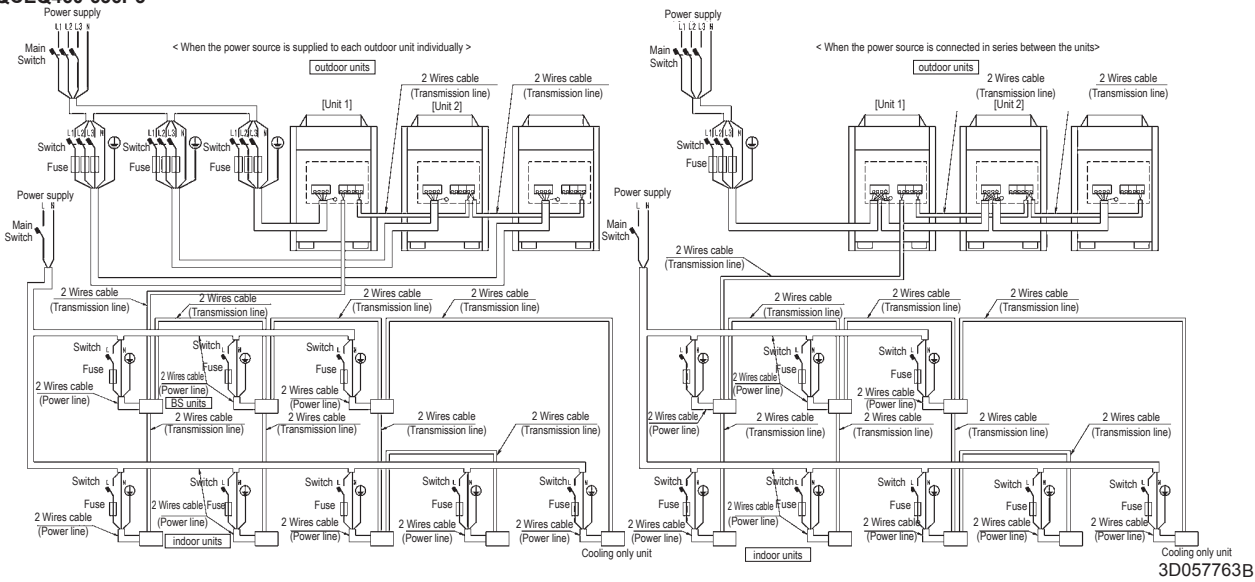

NOTES


1. All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
2. Use copper conductors only.
3. As for details, see wiring diagram.
4. Install circuit breaker for safety.
5. All field wiring and components must be provided by licensed electrician.
6. Unit shall be grounded in compliance with the applicable local and national codes.
7. Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
8. Be sure to install the switch and the fuse to the power line of each equipment.
9. Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
10. the capacity of UNIT1 must be larger than UNIT2 when the power source is connected in series between the units.
11. If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally. Running the product in reversed phase may break the compressor and other parts.
12. Must install earth leakage circuit breaker.

7 External connection diagrams

7 - 1 External Connection Diagrams

7

RQCEQ-712-848P3

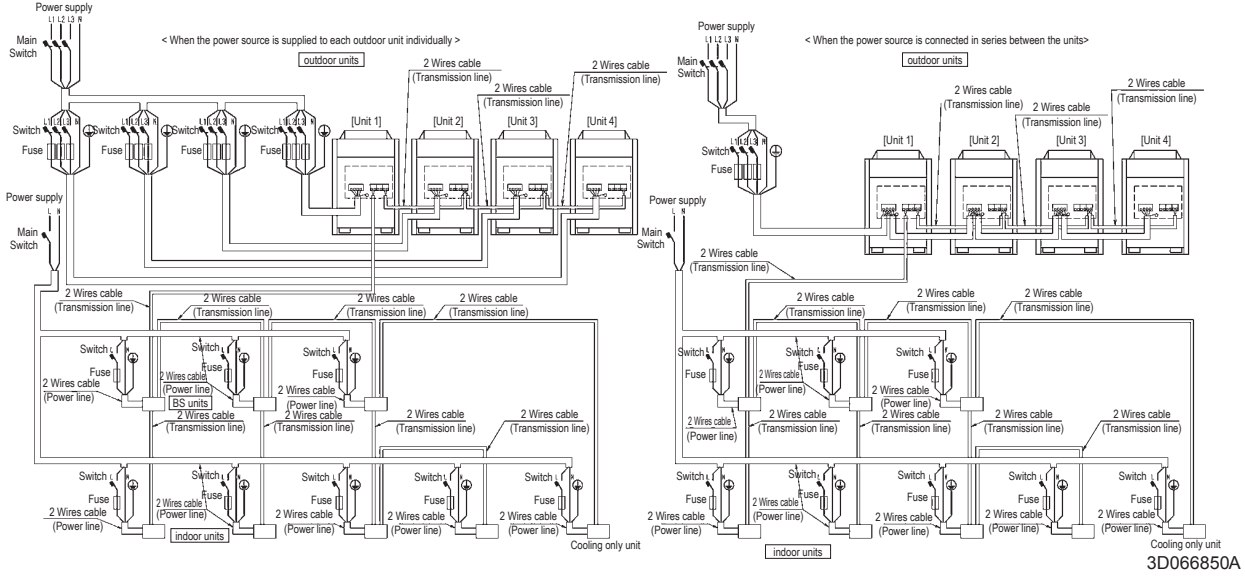


NOTES

1. All wiring, components and materials to be procured on the site must comply with the applicable local and national codes.
2. Use copper conductors only.
3. As for details, see wiring diagram.
4. Install circuit breaker for safety.
5. All field wiring and components must be provided by licensed electrician.
6. Unit shall be grounded in compliance with the applicable local and national codes.
7. Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
8. Be sure to install the switch and the fuse to the power line of each equipment.
9. Install the main switch that can interrupt all the power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
10. the capacity of UNIT1 must be larger than UNIT2 when the power source is connected in series between the units.
11. If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally. Running the product in reversed phase may break the compressor and other parts.
12. Must install earth leakage circuit breaker.

8 Installation


8 - 1 Service Space

RQ(C)EQ-P3

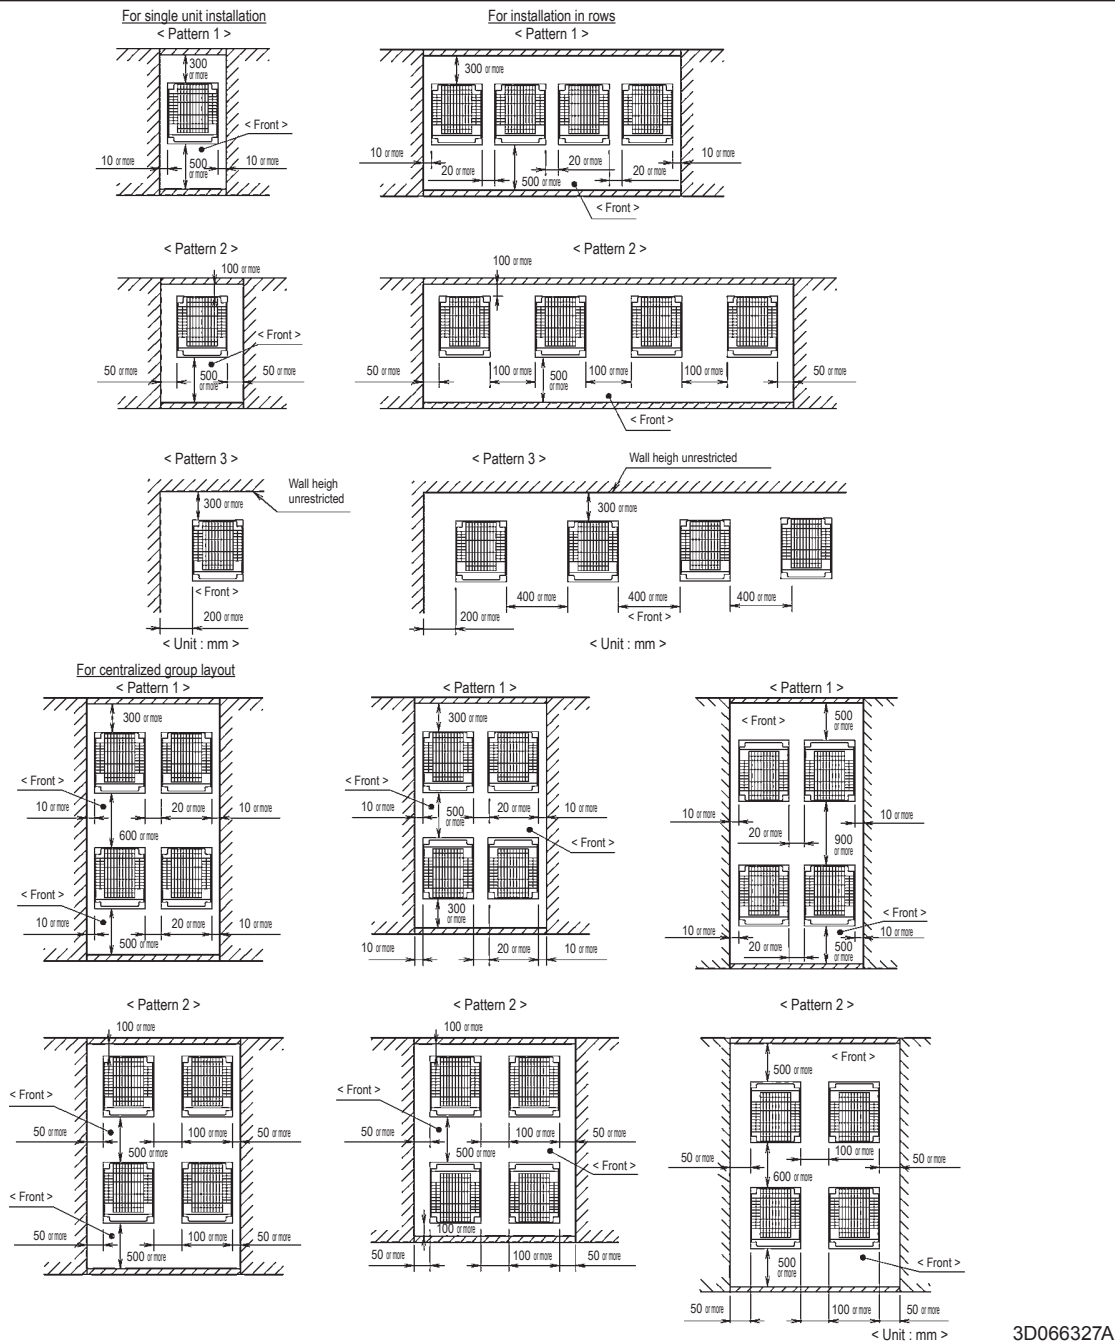

NOTES

- Heights of walls in case of patterns 1 and 2:
 Front: 1500 mm
 Suction side: 500mm
 Side: Height unrestricted.
 Installation space to be shown in this drawing is based on the cooling operation at 35 degrees outdoor air temperature.
 When the design outdoor air temperature exceeds 35 degrees or the load exceeds maximum ability because of much generation load of heat in all outdoor unit, take the suction side space more broadly than the space to be shown in this drawing.
- If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service spaces respectively as shown in the figure on the right.
- When installing the units most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough space for a person to pass between units and wall and for the air to circulate freely.
 (If more units are to be installed than are catered for in the above patterns your layout should take account to the possibility of short circuits.)
- The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.



8 Installation

8 - 2 Refrigerant Pipe Selection

RQCEQ-P


<p>Example of connection (Connection of 8 indoor units) (*) → indicates the Outdoor unit multi connection piping kit (*) In case of multi outdoor system, re-read to the first Outdoor unit multi connection piping kit as seen from the indoor unit.</p>	<p>Example refrigerant branch using REFINET joint</p>	<p>Example refrigerant branch using REFINET joint and REFINET header</p>	<p>Example refrigerant branch using REFINET header</p>																																																																								
<p>Between outdoor (*)2 and indoor units</p> <p>Between outdoor unit and Outdoor unit multi connection piping kit (Only for multi system)</p> <p>Between outdoor and indoor units</p> <p>Between indoor and indoor units</p> <p>Between outdoor and outdoor units</p>	<p>Actual pipe length</p> <p>Equivalent length</p> <p>Total extension length</p> <p>Actual pipe length</p> <p>Equivalent length</p> <p>Difference in height</p> <p>Difference in height</p> <p>Difference in height</p> <p>Actual pipe length</p>	<p>Pipe length between outdoor (*)2 and indoor units: 120 m</p> <p>Example unit (B): a + b + c + d + e + f + g + p : 120 m</p> <p>Equivalent pipe length between outdoor (*)2 and indoor units: 150 m (assume equivalent pipe length of REFINET joint to be 0.5 m, that of REFINET header to be 1 m, calculation purposes) (See Note 1 - Next page)</p> <p>Total pipe length from outdoor unit (*)2 to all indoor units: 300 m</p> <p>Pipe length between outdoor unit and outdoor unit multi connection piping kit: 10 m, equivalent length between outdoor unit and outdoor unit multi connection piping kit: 13 m</p> <p>Difference in height between outdoor and indoor units (H1): 50 m (- 40 m if the outdoor unit is below)</p> <p>Difference in height between indoor units (H2): 15 m</p> <p>Difference in height between outdoor unit (H3): 5 m</p> <p>Pipe length from first refrigerant branch kit (either REFINET joint or REFINET header) to indoor unit: 40 m</p> <p>Example unit (B): b + c + d + e + f + g + p : 40 m</p>	<p>Pipe length between outdoor (*)2 and indoor units: 120 m</p> <p>Example unit (B): a + b + h : 165 m, unit (B): a + i + k : 120 m</p> <p>Equivalent pipe length between outdoor (*)2 and indoor units: 150 m (assume equivalent pipe length of REFINET joint to be 0.5 m, that of REFINET header to be 1 m, calculation purposes) (See Note 1 - Next page)</p> <p>Total pipe length from outdoor unit (*)2 to all indoor units: 300 m</p> <p>Pipe length between outdoor unit and outdoor unit multi connection piping kit: 10 m, equivalent length between outdoor unit and outdoor unit multi connection piping kit: 13 m</p> <p>Difference in height between outdoor and indoor units (H1): 50 m (- 40 m if the outdoor unit is below)</p> <p>Difference in height between indoor units (H2): 15 m</p> <p>Difference in height between outdoor unit (H3): 5 m</p> <p>Pipe length from first refrigerant branch kit (either REFINET joint or REFINET header) to indoor unit: 40 m</p> <p>Example unit (B): b + h : 40 m, unit (B): i + k : 40 m</p>																																																																								
<p>Refrigerant branch kit selection</p> <p>Refrigerant branch kits can only be used with R410A.</p> <p>△ When multi outdoor system are installed, be sure to use the special separately sold Outdoor unit multi connection piping kit. The table at right shows how to select the proper kit.</p>	<p>How to select the REFINET joint</p> <ul style="list-style-type: none"> When using REFINET joint at the first branch counted from the outdoor unit side. Choose the following table in accordance with the outdoor unit capacity type. (Example: REFINET joint A) <table border="1"> <thead> <tr> <th>Outdoor unit capacity type</th> <th>Refrigerant branch kit name</th> </tr> </thead> <tbody> <tr> <td>Q140-180 type</td> <td>KHRP26A22T</td> </tr> <tr> <td>Q280 type</td> <td>KHRP26A33T</td> </tr> <tr> <td>Q360-540 type</td> <td>KHRP26A72T</td> </tr> </tbody> </table> <p>How to select the REFINET header</p> <ul style="list-style-type: none"> Choose from the following table in accordance with the total capacity index of all the indoor units connected below the REFINET header. Note: 250 type indoor unit cannot be connected below the REFINET header. <table border="1"> <thead> <tr> <th>Indoor unit total capacity index</th> <th>Refrigerant branch kit name</th> </tr> </thead> <tbody> <tr> <td>< 200</td> <td>KHRP26M33H</td> </tr> <tr> <td>200 · x < 290</td> <td>KHRP26M33H</td> </tr> <tr> <td>290 · x < 640</td> <td>KHRP26M72H</td> </tr> <tr> <td>640 ·</td> <td>KHRP26M73H + KHRP26M73HP</td> </tr> </tbody> </table> <p>How to select the Outdoor unit multi connection piping kit (This is required when the system is multi outdoor unit system.)</p> <ul style="list-style-type: none"> Choose from the following table in accordance with the number of outdoor units. <table border="1"> <thead> <tr> <th>Number of outdoor units</th> <th>Connection piping kit name</th> </tr> </thead> <tbody> <tr> <td>2 units</td> <td>BHFP22P36C</td> </tr> <tr> <td>3 units</td> <td>BHFP22P54C</td> </tr> </tbody> </table>	Outdoor unit capacity type	Refrigerant branch kit name	Q140-180 type	KHRP26A22T	Q280 type	KHRP26A33T	Q360-540 type	KHRP26A72T	Indoor unit total capacity index	Refrigerant branch kit name	< 200	KHRP26M33H	200 · x < 290	KHRP26M33H	290 · x < 640	KHRP26M72H	640 ·	KHRP26M73H + KHRP26M73HP	Number of outdoor units	Connection piping kit name	2 units	BHFP22P36C	3 units	BHFP22P54C	<p>How to select the REFINET joint</p> <ul style="list-style-type: none"> When using REFINET joint at the first branch counted from the outdoor unit side. Choose the following table in accordance with the outdoor unit capacity type. (Example: REFINET joint A) <table border="1"> <thead> <tr> <th>Outdoor unit capacity type</th> <th>Refrigerant branch kit name</th> </tr> </thead> <tbody> <tr> <td>Q140-180 type</td> <td>KHRP26A22T</td> </tr> <tr> <td>Q280 type</td> <td>KHRP26A33T</td> </tr> <tr> <td>Q360-540 type</td> <td>KHRP26A72T</td> </tr> </tbody> </table> <p>How to select the REFINET header</p> <ul style="list-style-type: none"> Choose from the following table in accordance with the total capacity index of all the indoor units connected below the REFINET header. Note: 250 type indoor unit cannot be connected below the REFINET header. <table border="1"> <thead> <tr> <th>Indoor unit total capacity index</th> <th>Refrigerant branch kit name</th> </tr> </thead> <tbody> <tr> <td>< 200</td> <td>KHRP26M33H</td> </tr> <tr> <td>200 · x < 290</td> <td>KHRP26M33H</td> </tr> <tr> <td>290 · x < 640</td> <td>KHRP26M72H</td> </tr> <tr> <td>640 ·</td> <td>KHRP26M73H + KHRP26M73HP</td> </tr> </tbody> </table> <p>How to select the Outdoor unit multi connection piping kit (This is required when the system is multi outdoor unit system.)</p> <ul style="list-style-type: none"> Choose from the following table in accordance with the number of outdoor units. <table border="1"> <thead> <tr> <th>Number of outdoor units</th> <th>Connection piping kit name</th> </tr> </thead> <tbody> <tr> <td>2 units</td> <td>BHFP22P36C</td> </tr> <tr> <td>3 units</td> <td>BHFP22P54C</td> </tr> </tbody> </table>	Outdoor unit capacity type	Refrigerant branch kit name	Q140-180 type	KHRP26A22T	Q280 type	KHRP26A33T	Q360-540 type	KHRP26A72T	Indoor unit total capacity index	Refrigerant branch kit name	< 200	KHRP26M33H	200 · x < 290	KHRP26M33H	290 · x < 640	KHRP26M72H	640 ·	KHRP26M73H + KHRP26M73HP	Number of outdoor units	Connection piping kit name	2 units	BHFP22P36C	3 units	BHFP22P54C	<p>How to select the REFINET joint</p> <ul style="list-style-type: none"> When using REFINET joint at the first branch counted from the outdoor unit side. Choose the following table in accordance with the outdoor unit capacity type. (Example: REFINET joint A) <table border="1"> <thead> <tr> <th>Outdoor unit capacity type</th> <th>Refrigerant branch kit name</th> </tr> </thead> <tbody> <tr> <td>Q140-180 type</td> <td>KHRP26A22T</td> </tr> <tr> <td>Q280 type</td> <td>KHRP26A33T</td> </tr> <tr> <td>Q360-540 type</td> <td>KHRP26A72T</td> </tr> </tbody> </table> <p>How to select the REFINET header</p> <ul style="list-style-type: none"> Choose from the following table in accordance with the total capacity index of all the indoor units connected below the REFINET header. Note: 250 type indoor unit cannot be connected below the REFINET header. <table border="1"> <thead> <tr> <th>Indoor unit total capacity index</th> <th>Refrigerant branch kit name</th> </tr> </thead> <tbody> <tr> <td>< 200</td> <td>KHRP26M33H</td> </tr> <tr> <td>200 · x < 290</td> <td>KHRP26M33H</td> </tr> <tr> <td>290 · x < 640</td> <td>KHRP26M72H</td> </tr> <tr> <td>640 ·</td> <td>KHRP26M73H + KHRP26M73HP</td> </tr> </tbody> </table> <p>How to select the Outdoor unit multi connection piping kit (This is required when the system is multi outdoor unit system.)</p> <ul style="list-style-type: none"> Choose from the following table in accordance with the number of outdoor units. <table border="1"> <thead> <tr> <th>Number of outdoor units</th> <th>Connection piping kit name</th> </tr> </thead> <tbody> <tr> <td>2 units</td> <td>BHFP22P36C</td> </tr> <tr> <td>3 units</td> <td>BHFP22P54C</td> </tr> </tbody> </table>	Outdoor unit capacity type	Refrigerant branch kit name	Q140-180 type	KHRP26A22T	Q280 type	KHRP26A33T	Q360-540 type	KHRP26A72T	Indoor unit total capacity index	Refrigerant branch kit name	< 200	KHRP26M33H	200 · x < 290	KHRP26M33H	290 · x < 640	KHRP26M72H	640 ·	KHRP26M73H + KHRP26M73HP	Number of outdoor units	Connection piping kit name	2 units	BHFP22P36C	3 units	BHFP22P54C
Outdoor unit capacity type	Refrigerant branch kit name																																																																										
Q140-180 type	KHRP26A22T																																																																										
Q280 type	KHRP26A33T																																																																										
Q360-540 type	KHRP26A72T																																																																										
Indoor unit total capacity index	Refrigerant branch kit name																																																																										
< 200	KHRP26M33H																																																																										
200 · x < 290	KHRP26M33H																																																																										
290 · x < 640	KHRP26M72H																																																																										
640 ·	KHRP26M73H + KHRP26M73HP																																																																										
Number of outdoor units	Connection piping kit name																																																																										
2 units	BHFP22P36C																																																																										
3 units	BHFP22P54C																																																																										
Outdoor unit capacity type	Refrigerant branch kit name																																																																										
Q140-180 type	KHRP26A22T																																																																										
Q280 type	KHRP26A33T																																																																										
Q360-540 type	KHRP26A72T																																																																										
Indoor unit total capacity index	Refrigerant branch kit name																																																																										
< 200	KHRP26M33H																																																																										
200 · x < 290	KHRP26M33H																																																																										
290 · x < 640	KHRP26M72H																																																																										
640 ·	KHRP26M73H + KHRP26M73HP																																																																										
Number of outdoor units	Connection piping kit name																																																																										
2 units	BHFP22P36C																																																																										
3 units	BHFP22P54C																																																																										
Outdoor unit capacity type	Refrigerant branch kit name																																																																										
Q140-180 type	KHRP26A22T																																																																										
Q280 type	KHRP26A33T																																																																										
Q360-540 type	KHRP26A72T																																																																										
Indoor unit total capacity index	Refrigerant branch kit name																																																																										
< 200	KHRP26M33H																																																																										
200 · x < 290	KHRP26M33H																																																																										
290 · x < 640	KHRP26M72H																																																																										
640 ·	KHRP26M73H + KHRP26M73HP																																																																										
Number of outdoor units	Connection piping kit name																																																																										
2 units	BHFP22P36C																																																																										
3 units	BHFP22P54C																																																																										
	<p>Example REFINET joint C: indoor units (B), (D), (E), (F), (G), (H)</p>	<p>Example REFINET joint B: indoor units (A), (B), (C), (D), (E), (F), (G), (H)</p>	<p>Example REFINET header: indoor units (A), (B), (C), (D), (E), (F), (G), (H)</p>																																																																								

8 Installation

8 - 2 Refrigerant Pipe Selection

RQCEQ-P

Pipe size selection
 ⚠ Caution
 Refer to the diagram below and select the appropriate piping from the tables on the right.

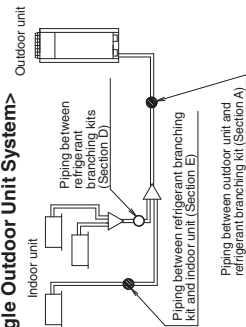

Piping between outdoor unit (*2) and refrigerant branch kit (part A)
 • Choose from the following table in accordance with the outdoor unit system capacity type. (Note 1)

Outdoor capacity index	Suction gas size		Piping size (O.D.)		Liquid pipe	
	Standard size	Maximum size	Standard size	Maximum size	Standard size	Maximum size
Q140	φ15.9	φ25.4	φ9.5	φ12.7	φ9.5	φ12.7
Q180	φ19.1	φ28.6	φ12.7	φ15.9	φ12.7	φ15.9
Q280	φ22.2	φ41.3	φ15.9	φ19.1	φ15.9	φ19.1
Q360	φ25.4					
Q460	φ28.6					
Q500						
Q540						


Piping between outdoor unit multi connection piping kits (part B)
 • Choose from the following table in accordance with the total capacity of all the outdoor units connected upstream

Outdoor unit capacity type	Suction gas pipe		Piping size (O.D.)		Liquid pipe	
	Standard size	Maximum size	Standard size	Maximum size	Standard size	Maximum size
280	φ22.2	φ25.4	φ9.5	φ12.7	φ9.5	φ12.7
360	φ25.4					

Piping between outdoor unit multi connection piping kit and outdoor unit (part C)
 • Choose from the following table in accordance with the capacity type of the outdoor unit connected

Outdoor capacity index	Gas pipe		Piping size (O.D.)		Liquid pipe	
	Standard size	Maximum size	Standard size	Maximum size	Standard size	Maximum size
Q140	φ15.9	φ19.1	φ9.5	φ12.7	φ9.5	φ12.7
Q180	φ19.1					

<Multiple Outdoor Unit System>

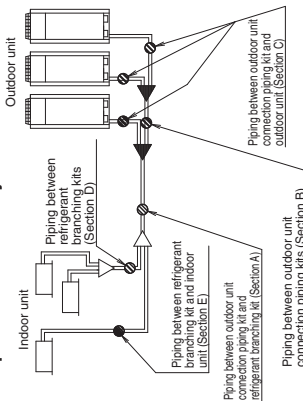

Piping between refrigerant branch kits
 • Choose from the following table in accordance with the total capacity index of all the indoor units connected below this. (part D)
 • Do not let the connection piping exceed the main refrigerant piping size.

Indoor capacity index	Suction gas pipe		Piping size (O.D.)		Liquid pipe	
	Standard size	Maximum size	Standard size	Maximum size	Standard size	Maximum size
< 11.2 kW	φ15.9	φ19.1	φ9.5	φ12.7	φ9.5	φ12.7
11.2 kW ≤ x < 22.4 kW	φ15.9	φ25.4	φ9.5	φ12.7	φ9.5	φ12.7
22.4 kW ≤ x < 33.0 kW	φ22.2	φ28.6	φ12.7	φ15.9	φ12.7	φ15.9
33.0 kW ≤ x < 37.0 kW	φ25.4	φ34.9	φ15.9	φ19.1	φ15.9	φ19.1
37.0 kW ≤ x < 47.0 kW	φ28.6	φ41.3	φ19.1	φ22.2	φ19.1	φ22.2
47.0 kW ≤ x < 71.0 kW	φ34.9	φ41.3	φ19.1	φ22.2	φ19.1	φ22.2
71.0 kW ≤	φ34.9	φ41.3	φ19.1	φ22.2	φ19.1	φ22.2

Piping between refrigerant branch kit and indoor unit
 • Match to the size of the connection piping on the indoor unit. (part E)

Indoor capacity index	Suction gas pipe		Piping size (O.D.)		Liquid pipe	
	Standard size	Maximum size	Standard size	Maximum size	Standard size	Maximum size
Q20	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q25	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q32	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q40	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q50	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q63	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q80	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q100	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q125	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q200	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5
Q250	φ12.7	φ15.9	φ6.4	φ9.5	φ6.4	φ9.5

3P226891-9T

8 Installation

8 - 2 Refrigerant Pipe Selection

RQCEQ-P

How to calculate the additional refrigerant to be charged
 Additional refrigerant to be charged R (kg)
 (R should be rounded off in units of 0.1kg.)

$$R = \left(\frac{\text{Total length (m) of liquid piping size at } \phi 19.1}{\times 0.26} \right) \text{ kg/m} + \left(\frac{\text{Total length (m) of liquid piping size at } \phi 15.9}{\times 0.18} \right) \text{ kg/m} + \left(\frac{\text{Total length (m) of liquid piping size at } \phi 12.7}{\times 0.12} \right) \text{ kg/m} + \left(\frac{\text{Total length (m) of liquid piping size at } \phi 9.5}{\times 0.059} \right) \text{ kg/m} + \left(\frac{\text{Total length (m) of liquid piping size at } \phi 6.4}{\times 0.022} \right) \text{ kg/m} + \left(\frac{\text{Total length (m) of liquid piping size at } \phi 4.0}{\times 0.012} \right) \text{ kg/m}$$

RQYQ140	2.4 kg	RQCYQ460	11.2 kg
RQYQ180	2.4 kg	RQCYQ500	11.2 kg
RQCYQ280	6.8 kg	RQCYQ540	11.2 kg
RQCYQ360	6.8 kg		

+ -

(A: The ratio of total capacity index of connectable indoor units to outdoor capacity index (%))

Example for refrigerant branch using REFNET joint and REFNET header

In case the outdoor unit is RQCYQ540PY1 type and the piping lengths are as at right

a: φ15.9 × 30m	d: φ9.5 × 20m	g: φ9.5 × 20m	j: φ6.4 × 10m	s: φ9.5 × 1m
b: φ15.9 × 10m	e: φ9.5 × 20m	h: φ9.5 × 20m	k: φ6.4 × 10m	t: φ9.5 × 1m
c: φ9.5 × 20m	f: φ9.5 × 20m	i: φ9.5 × 10m	r: φ9.5 × 1m	u: φ12.7 × 3m

Total capacity of indoor unit: 116%

$$R = \left(\frac{40 \times 0.18}{\uparrow a, b} + \frac{3 \times 0.12}{\uparrow u} + \frac{1.33 \times 0.059}{\uparrow c-i, r-t} + \frac{20 \times 0.022}{\uparrow j, k} + \frac{11.2}{\uparrow RQCYQ540PY1} + \frac{0.5}{\uparrow 116\%} \right) = 5.147 \Rightarrow 5.1 \text{ kg}$$

***Note 1**

When the equivalent pipe length between outdoor unit multi connection piping kit and indoor units is 90m or more, the size of main pipes (both gas-side and liquid-side) must be increased to the following table.
 Depending on the length of the piping, the capacity may drop, but even in such case it is able to increase the size of main pipes.

(Refer to figure 10.1)



1. Outdoor unit
2. Main pipes
3. Increase
4. The first refrigerant branch kit
5. Indoor unit

Model name of outdoor unit system	Piping size (O.D.)	
	Gas pipe	Liquid pipe
RQYQ140	φ15.9 → φ19.1	φ9.5 → Not increased
RQYQ180	φ19.1 → φ22.2	φ9.5 → Not increased
RQCYQ280	φ22.2 → φ25.4	φ9.5 → φ12.7
RQCYQ360	φ25.4 → φ28.6	φ12.7 → φ15.9
RQCYQ460	φ28.6 → φ34.9	
RQCYQ500, 540		φ15.9 → φ19.1


8 Installation

8 - 3 Fixation and Foundation of Units

RQEQ-P3

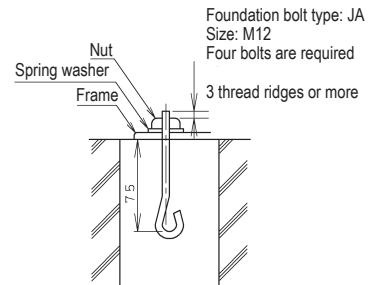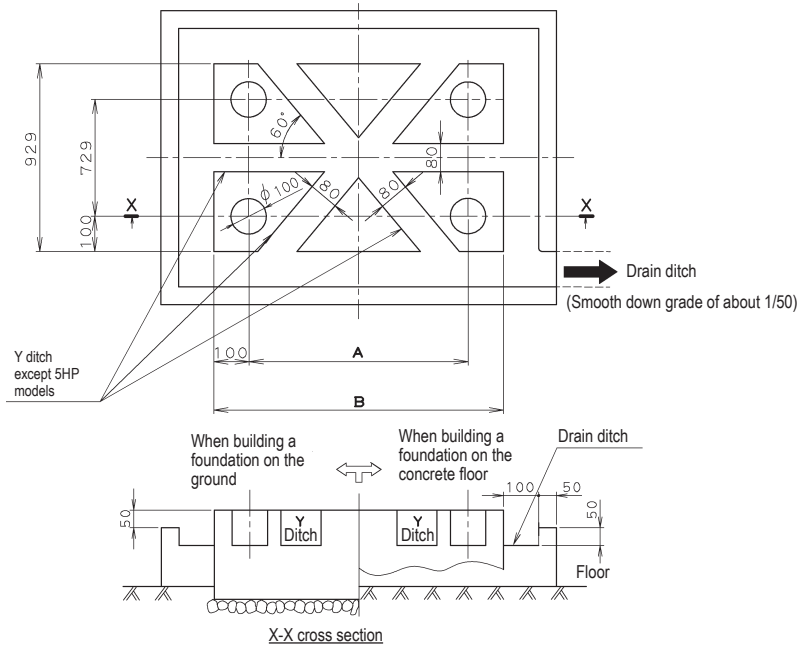

Foundation bolt executing method

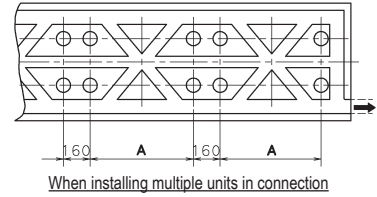

Model	A	B
RQEQ140P3	497	697
RQEQ180P3	497	697
RQEQ212P3	497	697

NOTES


1. The proportions of cement: sand: gravel for the concrete shall be 1:2:4, and the reinforcement bars that their diameter are 10mm, (approx. 300 mm intervals) shall be placed.
2. The surface shall be finished with mortar. The corner edges shall be chamfered.
3. When the foundation is built on a concrete floor, rubble is not necessary. However, the surface of the section on which the foundation is built shall have rough finish.
4. A drain ditch shall be made around the foundation to thoroughly drain water from the equipment installation area.
5. When installing the equipment on a roof, the floor strength shall be checked, and water-proofing measures shall be taken.
6. Y ditch is not necessary for 5HP Models.

3D065400H

9 Operation range

9 - 1 Operation Range

9

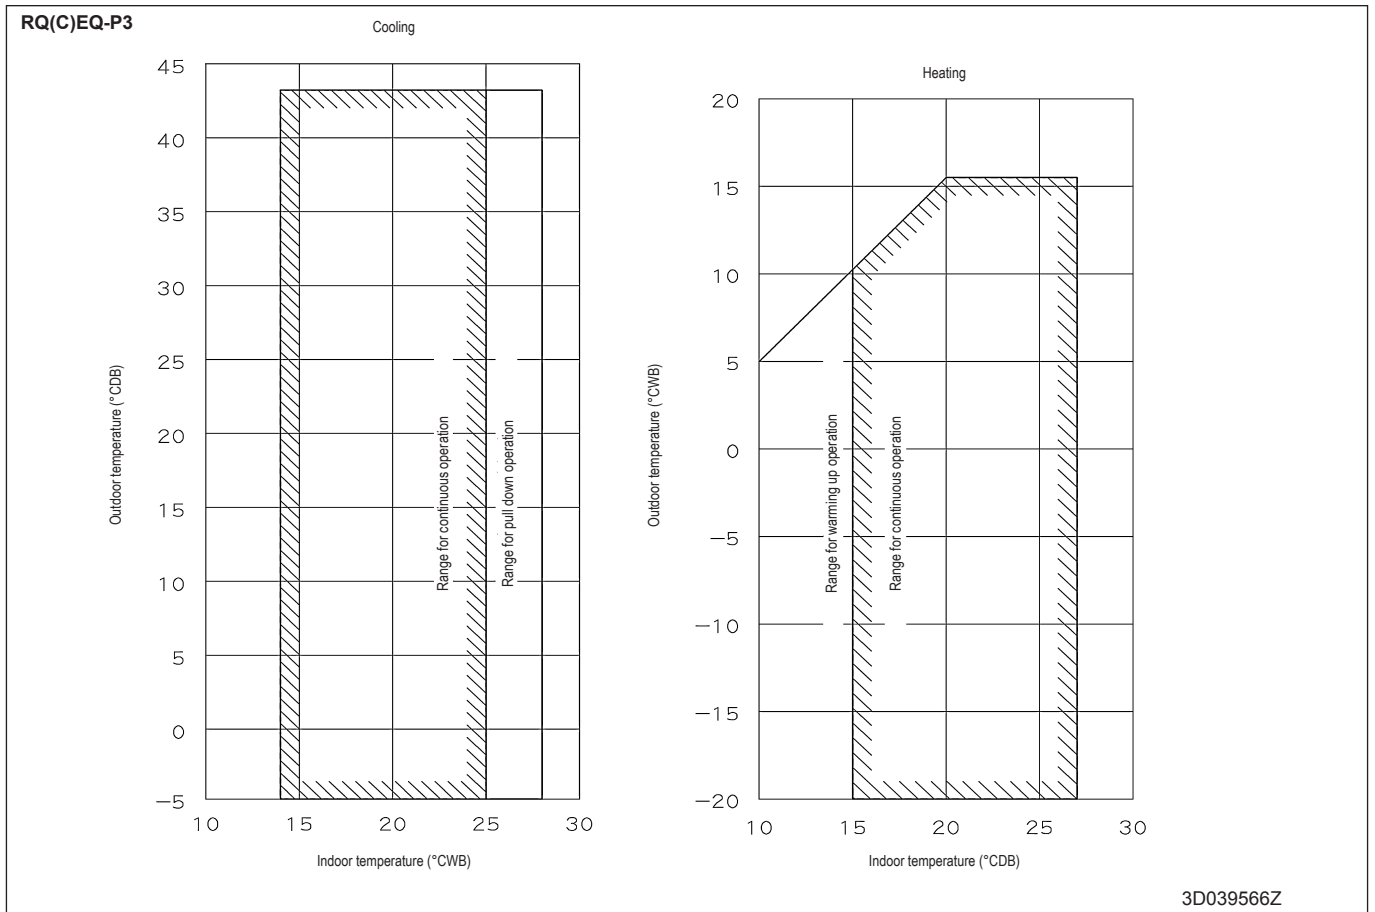

10 Appropriate Indoors

10 - 1 Appropriate Indoors

RQYQ-P
RQEQ-P
RQCEQ-P


FXFQ20-25-32-40-50-63-80-100-125
FXZQ15-20-25-32-40-50
FXCQ20-25-32-40-50-63-80-125
FXKQ25-32-40-63
FXDQ15-20-25-32-40-50-63
FXSQ15-20-25-32-40-50-63-80-100-125-140
FXMQ50-63-80-100-125-200-250
FXAQ15-20-25-32-40-50-63
FXHQ32-63-100
FXUQ71-100
FXNQ20-25-32-40-50-63
FXLQ20-25-32-40-50-63

11 Centre of gravity

11 - 1 Centre of Gravity

11


RQEQ140-212P3

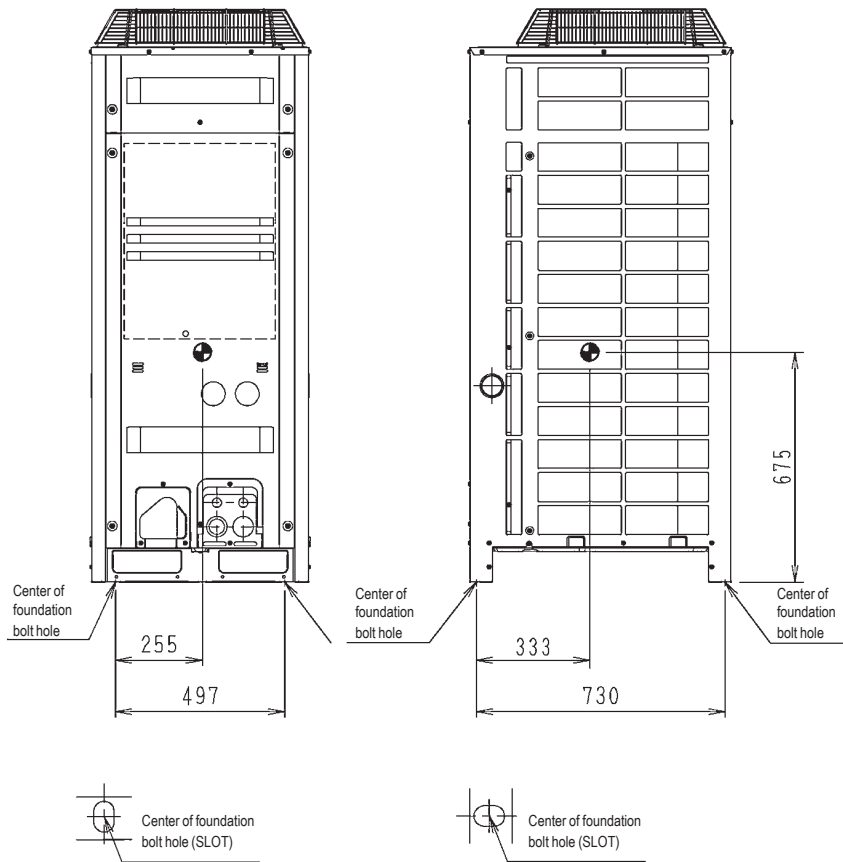

4D066325A

12 Piping diagrams

12 - 1 Piping Diagrams

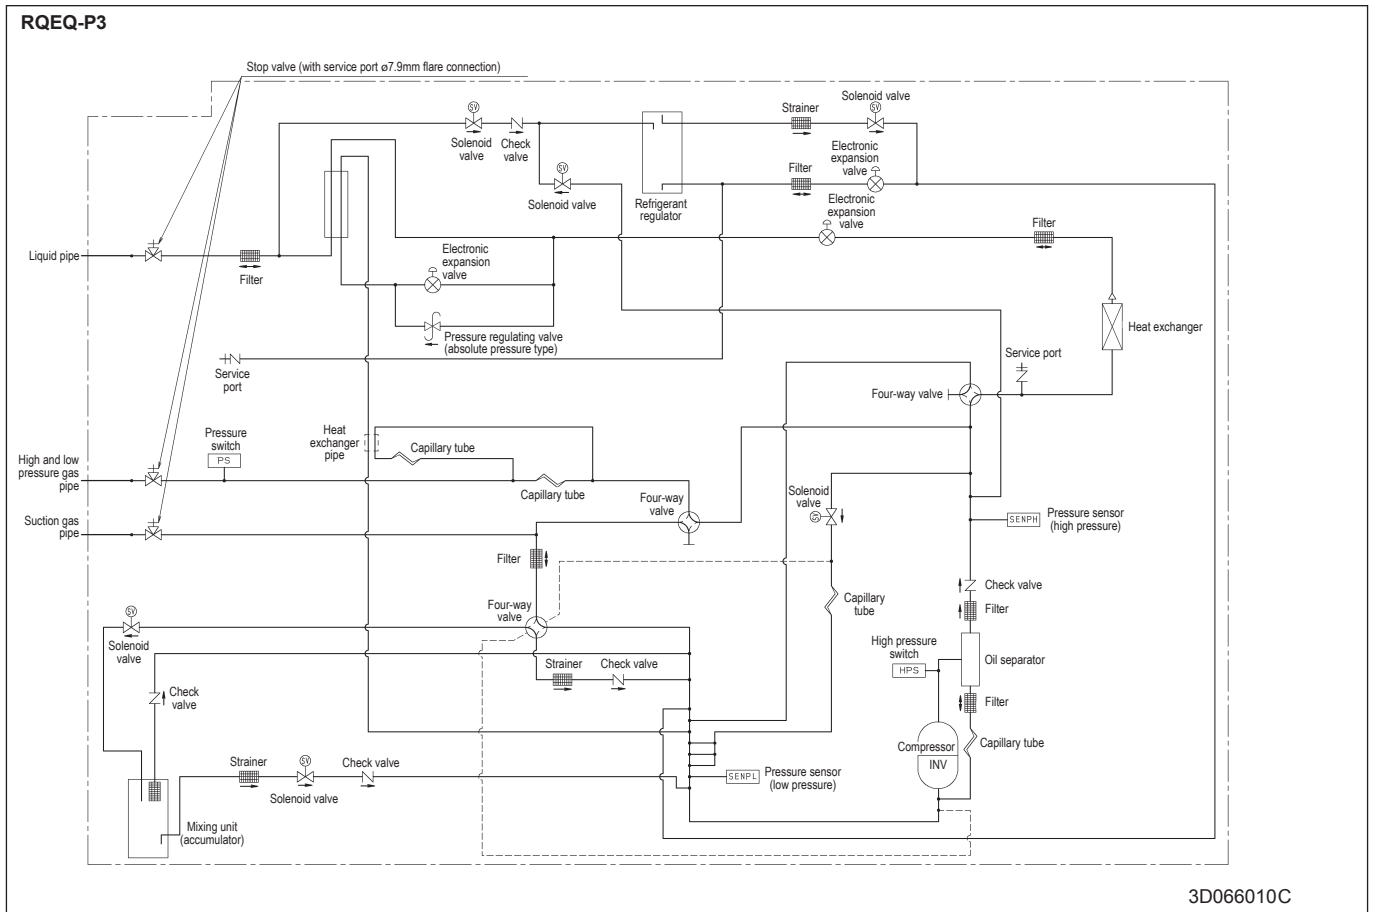


13 Wiring diagrams

13 - 1 Wiring Diagrams - Three Phase

13

RQEQ-P3

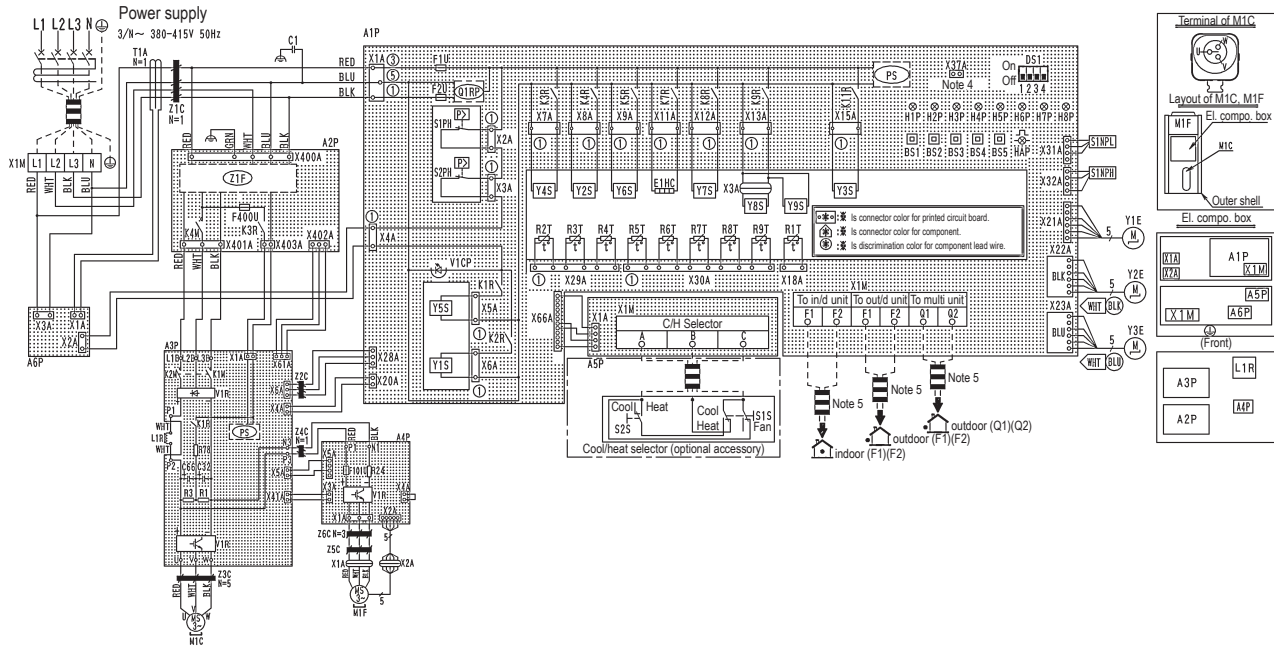

A1P	Printed circuit board (main)	R3T	Thermistor (heat exc. liquid)
A2P	Printed circuit board (noise filter)	R4T	Thermistor (heat exc. gas pipe)
A3P	Printed circuit board (inv)	R5T	Thermistor (suction)
A4P	Printed circuit board (fan)	R6T	Thermistor (heatexc. deicer)
A5P	Printed circuit board (ABC I/P)	R7T	Thermistor (subcooling gas)
A6P	Printed circuit board (SUB)	R8T	Thermistor (subcooling liquid)
BS1-5	Push button switch (mode, set, return, test, reset)	R9T	Thermistor (liquid)
C1	Capacitor	S1NPH	Pressure sensor (high)
C32,C66	Capacitor	S1NPL	Pressure sensor (low)
DS1	Dip switch	S1PH	Pressure switch (high)
E1HC	Crankcase heater	S2PH	Pressure switch (high)
F1U,F2U	Fuse (T, 3.15A, 250V) (A1P)	T1A	Current sensor (A6P)
F101U	Fuse (A4P)	V1CP	Safety devices input
F400U	Fuse (T, 6.3A, 250V) (A2P)	V1R	Diode bridge (A3P)
H1P-8P	Pilotlamp (service monitor-orange) [H2P] Prepare, test — Flickering Malfunction detection — Light up	V1R	Power module (A3P)
HAP	Pilotlamp (service monitor-green)	V1R	Power module (A4P)
K1M, K2M	Magnetic contactor (M1C) (A3P)	X1A, X2A	Connector (M1F)
K4M	Magnetic contactor (M1C) (A2P)	X3A	Relaying connector (Y8S)
K1R	Magnetic relay (A3P)	X1M	Terminal strip (power supply)
K1R	Magnetic relay (Y5S)	X1M	Terminal strip (control) (A1P)
K2R	Magnetic relay (Y1S)	X1M	Terminal strip (ABC I/P) (A5P)
K3R	Magnetic relay (A2P)	Y1E	Electronic expansion valve (main)
K3R	Magnetic relay (Y4S)	Y2E	Electronic expansion valve (charge)
K4R	Magnetic relay (Y2S)	Y3E	Electronic expansion valve (subcool)
K5R	Magnetic relay (Y6S)	Y1S	Solenoid valve (refrigerant regulator hot gas)
K7R	Magnetic relay (E1HC)	Y2S	Solenoid valve (refrigerant regulator liquid pipe)
K8R	Magnetic relay (Y7S)	Y3S	Solenoid valve (refrigerant regulator gas purge pipe)
K9R	Magnetic relay (Y8S, Y9S)	Y4S	Solenoid valve (hot gas)
K11R	Magnetic relay (Y3S)	Y5S	Solenoid valve (oil)
L1R	Reactor	Y6S	Solenoid valve (4 way valve - heat exc.)
M1C	Motor (compressor)	Y7S	Solenoid valve (4 way valve - piping)
M1F	Motor (fan)	Y8S	Solenoid valve (4 way valve - mix)
PS	Switching power supply (A1P, A3P)	Y9S	Solenoid valve (mix in)
Q1RP	Phase reversal detect circuit (A1P)	Z1C-6C	Noise filter (ferrite core)
R1,R3	Resistor (A3P)	Z1F	Noise filter (with surge absorber)
R24	Resistor (current sensor) (A4P)		
R78	Resistor (current limiting)		
R1T	Thermistor (air) (A1P)	Cool/heat selector	
R2T	Thermistor (M1C discharge)	S1S	Selector switch (fan/cool • heat)
		S2S	Selector switch (cool / heat)

NOTES


- This wiring diagram is applied only to the outdoor unit.
- : field wiring.
- : terminal strip, □□□: connector, ○: terminal, ⊕: protective earth (screw), -□-: Connector
- When using the optional adapter, refer to the installation manual of the optional adapter.
- For connection wiring to indoor-outdoor transmission F1•F2, outdoor-outdoor transmission F1•F2, refer to the installation manual.
- How to use BS1-5 and DS1 switch, refer to "service precaution" label on el. compo. box cover.
- When operating, don't shortcircuit the protection device (S1PH, S2P).
- Colors BLK: BLACK, RED: RED, BLU: BLUE, WHT: WHITE, PNK: PINK, YLW: YELLOW, BRN: BROWN, GRY: GRAY, GRN: GREEN, ORG: ORANGE.

3D090667

14 Sound data

14 - 1 Sound Pressure Spectrum

RQE140P3

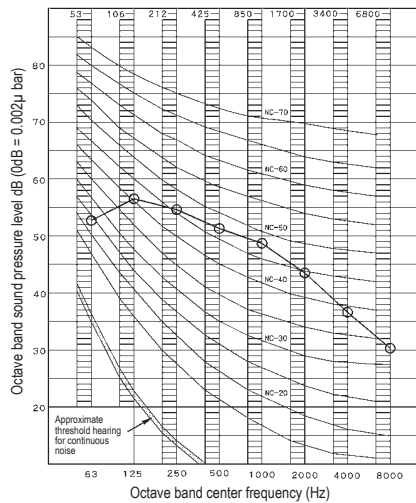


4D066849A


NOTES

- 1 Over All (dB):
(B,G,N is already rectified)
- 2 Operating conditions:
Power source: 380-415V 50Hz
JIS standard
- 3 Measuring place: Anechoic chamber (conversion value)
- 4 The operating sound is measured in anechoic chamber,
if it is measured under the actual installation conditions,
it is normally over the set value due to enviromental noise and sound reflection.
- 5 Location of microphone.

Scale	50 Hz
A	54
C	60



RQE180P3

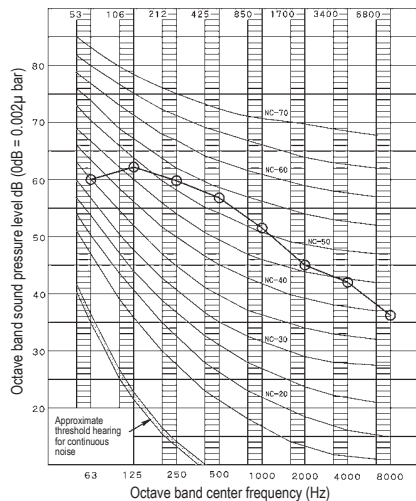


4D066836A

NOTES

- 1 Over All (dB):
(B,G,N is already rectified)
- 2 Operating conditions:
Power source: 380-415V 50Hz
JIS standard
- 3 Measuring place: Anechoic chamber (conversion value)
- 4 The operating sound is measured in anechoic chamber,
if it is measured under the actual installation conditions,
it is normally over the set value due to enviromental noise and sound reflection.
- 5 Location of microphone.

Scale	50 Hz
A	58
C	66




14 Sound data

14 - 1 Sound Pressure Spectrum

14

RQEQ212P3

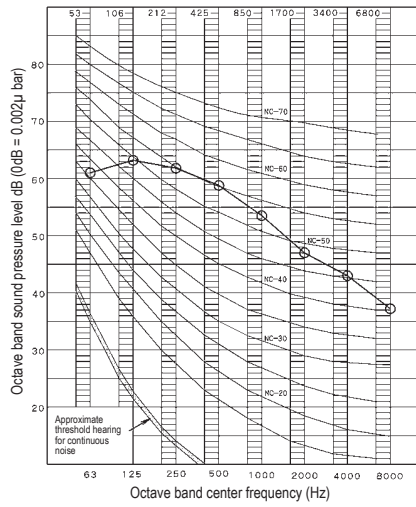



4D066834A

NOTES

- 1 Over All (dB):
(B,G,N is already rectified)
- 2 Operating conditions:
Power source: 380-415V 50Hz
JIS standard
- 3 Measuring place: Anechoic chamber (conversion value)
- 4 The operating sound is measured in anechoic chamber,
if it is measured under the actual installation conditions,
it is normally over the set value due to enviromental noise and sound reflection.
- 5 Location of microphone.

Scale	50 Hz
A	60
C	68





EEDEN20

10/2020



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.