

Air Conditioning
Technical Data

RZQSG-L(8)Y1



TABLE OF CONTENTS

RZQSG-L(8)Y1

1	Features	2
2	Specifications	3
	Capacity and Power input	3
	Capacity and Power input	3
	Capacity and Power input	3
	Capacity and Power input	4
	Capacity and Power input	4
	Capacity and Power input	5
	Capacity and Power input	5
	Capacity and Power input	6
	Technical Specifications	6
	Electrical Specifications	8
3	Electrical data	9
4	Options	16
5	Combination table	17
6	Capacity tables	18
	Cooling/Heating Capacity Tables	18
	Capacity Correction Factor	20
7	Dimensional drawings	21
8	Centre of gravity	22
9	Piping diagrams	23
	Piping Diagrams	23
	Piping Diagram Twin Application	24
	Piping Diagram Triple Application	25
	Piping Diagram Double Twin Application	26
10	Wiring diagrams	27
	Wiring Diagrams - Three Phase	27
11	Sound data	28
	Sound Power Spectrum	28
	Sound Pressure Spectrum - Cooling	30
	Sound Pressure Spectrum - Heating	32
	Sound Pressure Spectrum Quiet Mode	34
12	Installation	36
	Installation Method	36
13	Operation range	38

1 Features

Technology and comfort combined for commercial applications

- Top efficiency: - Energy labels up to A++ (cooling) /A+ (heating) for RZQG71/100L9V1 + FCQG71/100F - compressor that offers substantial efficiency improvements - control logic that optimises efficiency at the most frequently encountered operating conditions
- Replace existing R-22 or R-407C systems without having to replace the piping
- Guarantees operation in both heating and cooling mode down to -15°C
- With a gas cooled PCB reliable cooling is guaranteed as it is not influenced by ambient temperature
- Maximum piping length up to 50m, minimum piping length is 5m.
- Outdoor units for pair, twin, triple, double twin application
- Daikin outdoor units are neat, sturdy and can easily be mounted on a roof or terrace or simply placed against an outside wall
- Units optimized for seasonal efficiency give an indication on how efficient an air conditioner operates over an entire heating or cooling season.



Inverter



Auto cooling-
heating
changeover

2 Specifications

2-1 Capacity and Power input				FCQG100F/RZQSG100L8Y1	FCQG125F/RZQSG125L8Y1	FCQG140F/RZQSG140LY1
Cooling capacity	Nom.		kW	9.5	12.0	13.4
Heating capacity	Nom.		kW	10.8	13.5	15.5
Power input	Cooling	Nom.	kW	2.88	3.74	4.45
	Heating	Nom.	kW	3.05	3.96	4.54
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A++	A	-
		Pdesign	kW	9.5	12	-
		SEER		6.5	5.3	-
		Annual energy consumption	kWh	512	793	-
	Heating (Average climate)	Energy label		A+		-
		Pdesign	kW	7.6	8.03	-
		SCOP/A		4.1	4.01	-
		Annual energy consumption	kWh	2,596	2,804	-
Nominal efficiency	EER			3.30	3.21	3.01
	COP			3.54	3.41	
	Annual energy consumption		kWh	1,440	1,870	2,225
	Energy label	Cooling		A		-

Notes

EER/COP according to Eurovent 2012, for use outside EU only

Nominal efficiency: cooling at 35°/27° nominal load, heating at 7°/20° nominal load

Annual energy consumption is according to Energy labeling directive 2002/31/EC

SEER and SCOP are according to EN 14825

2-2 Capacity and Power input				FHQ100C/RZQSG100L8Y1	FHQ125C/RZQSG125L8Y1	FHQ140C/RZQSG140LY1
Cooling capacity	Nom.		kW	9.5	12.0	13.4
Heating capacity	Nom.		kW	10.8	13.5	15.5
Power input	Cooling	Nom.	kW	2.96	4.15	4.45
	Heating	Nom.	kW	2.99	3.73	4.54
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A+		-
		Pdesign	kW	9.5	12	-
		SEER		5.61		-
		Annual energy consumption	kWh	593	749	-
	Heating (Average climate)	Energy label		A	A+	-
		Pdesign	kW	7.6		-
		SCOP/A		3.91	4.01	-
		Annual energy consumption	kWh	2,722	2,654	-
Nominal efficiency	EER			3.21	2.89	3.01
	COP			3.61	3.62	3.41
	Annual energy consumption		kWh	1,480	2,075	2,225
	Energy label	Cooling		A	C	-
		Heating		A		-

Notes

EER/COP according to Eurovent 2012, for use outside EU only

Nominal efficiency: cooling at 35°/27° nominal load, heating at 7°/20° nominal load

2-3 Capacity and Power input				FDQ125C/RZQSG125L8Y1
Cooling capacity	Nom.		kW	12.0
Heating capacity	Nom.		kW	13.5
Power input	Cooling	Nom.	kW	3.74
	Heating	Nom.	kW	3.85

2 Specifications

2-3 Capacity and Power input				FDQ125C/RZQSG125L8Y1	
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A	
		Pdesign	kW	12	
		SEER		5.2	
		Annual energy consumption	kWh	808	
	Heating (Average climate)	Energy label		A	
		Pdesign	kW	7.6	
		SCOP/A		3.9	
		Annual energy consumption	kWh	2,729	
Nominal efficiency	EER			3.21	
	COP			3.51	
	Annual energy consumption		kWh	1,870	
	Energy label	Cooling		A	
		Heating		B	

Notes

EER/COP according to Eurovent 2012, for use outside EU only

Nominal efficiency: cooling at 35°/27° nominal load, heating at 7°/20° nominal load

2-4 Capacity and Power input				FCQHG100F/RZQSG100L8Y1	FCQHG125F/RZQSG125L8Y1	FCQHG140F/RZQSG140LY1
Cooling capacity	Nom.		kW	9.5	12.0	-
Heating capacity	Nom.		kW	10.8	13.5	-
Power input	Cooling	Nom.	kW	2.57	3.71	-
	Heating	Nom.	kW	2.51	3.60	-
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A++	A	-
		Pdesign	kW	9.5	12	-
		SEER		6.7	5.4	-
		Annual energy consumption	kWh	497	778	-
	Heating (Average climate)	Energy label		A+		-
		Pdesign	kW	8.03		-
		SCOP/A		4.3	4.1	-
		Annual energy consumption	kWh	2,615	2,742	-
Nominal efficiency	EER			3.70	3.23	-
	COP			4.30	3.75	-
	Annual energy consumption		kWh	1,285	1,855	-
	Energy label	Cooling		A		-
		Heating		A		-

Notes

EER/COP according to Eurovent 2012, for use outside EU only

Nominal efficiency: cooling at 35°/27° nominal load, heating at 7°/20° nominal load

2-5 Capacity and Power input				FVQ100C/RZQSG100L8Y1	FVQ125C/RZQSG125L8Y1	FVQ140C/RZQSG140LY1
Cooling capacity	Nom.		kW	9.5	12.0	13.4
Heating capacity	Nom.		kW	10.8	13.5	15.5
Power input	Cooling	Nom.	kW	2.96	4.27	4.45
	Heating	Nom.	kW	2.99	3.96	4.54

2 Specifications

2-5 Capacity and Power input				FVQ100C/RZQSG100L8Y1	FVQ125C/RZQSG125L8Y1	FVQ140C/RZQSG140LY1
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A		-
		Pdesign	kW	9.5	12	-
		SEER		5.5		-
		Annual energy consumption	kWh	605	764	-
	Heating (Average climate)	Energy label		A+	A	-
		Pdesign	kW	7.6		-
		SCOP/A		4.01	3.85	-
		Annual energy consumption	kWh	2,654	2,764	-
Nominal efficiency	EER			3.21	2.81	3.01
	COP			3.61	3.41	
	Annual energy consumption		kWh	1,480	2,135	2,225
	Energy label	Cooling		A	C	-
		Heating		A	B	-

Notes

EER/COP according to Eurovent 2012, for use outside EU only

Nominal efficiency: cooling at 35°/27° nominal load, heating at 7°/20° nominal load

2-6 Capacity and Power input				FBQ100D/RZQSG100L8Y1	FBQ125D/RZQSG125L8Y1	FBQ140D/RZQSG140LY1
Indoor unit				FBQ100D	FBQ125D	FBQ140D
Outdoor unit				RZQSG100L8Y1	RZQSG125L8Y1	RZQSG140LY1
Cooling capacity	Nom.		kW	9.5 (1)	12.0 (1)	13.4 (1)
Heating capacity	Nom.		kW	10.80 (1)	13.50 (1)	15.50 (1)
Power input	Cooling	Nom.	kW	2.84 (1)	3.72 (1)	4.38 (1)
	Heating	Nom.	kW	2.94 (1)	3.72 (1)	4.56 (1)
Seasonal efficiency (according to EN14825)	Cooling	Energy label		A+	A	-
		Pdesign	kW	9.50	12.00	-
		SEER		5.61	5.47	-
		Annual energy consumption	kWh	593	768	-
	Heating (Average climate)	Energy label		A+		-
		Pdesign	kW	7.60		-
		SCOP/A		4.15	4.01	-
		Annual energy consumption	kWh	2,564	2,653	-
Nominal efficiency	EER			3.35 (2)	3.23 (2)	3.06 (2)
	COP			3.67 (2)	3.63 (2)	3.40 (2)
	Annual energy consumption		kWh	1,418	1,858	-
	Energy label	Cooling		A		-

Notes

(1) Nominal efficiency: cooling at 35°/27° nominal load, heating at 7°/20° nominal load

(2) EER/COP according to Eurovent 2012, for use outside EU only

Annual energy consumption is according to Energy labeling directive 2002/31/EC

SEER and SCOP are according to EN 14825

2-7 Capacity and Power input				FUQ100C/RZQSG100L8Y1	FUQ125C/RZQSG125L8Y1
Indoor unit				FUQ100C	FUQ125C
Outdoor unit				RZQSG100L8Y1	RZQSG125L8Y1
Cooling capacity	Nom.		kW	9.5	12.0
Heating capacity	Nom.		kW	10.8	13.5
Power input	Cooling	Nom.	kW	2.96	4.53
	Heating	Nom.	kW	2.99	3.95

2 Specifications

2-7 Capacity and Power input					FUQ100C/RZQSG100L8Y1		FUQ125C/RZQSG125L8Y1	
Seasonal efficiency (according to EN14825)	Cooling	Energy label			A+		A	
		Pdesign		kW	9.50		12.00	
		SEER			5.61		5.30	
		Annual energy consumption		kWh	593		793	
	Heating (Average climate)	Energy label			A+		A	
		Pdesign		kW	7.60			
		SCOP/A			4.01		3.85	
		Annual energy consumption		kWh	2,654		2,764	
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	69		70	
	Sound power level indoor	Cooling	Nom.	dBA	64		65	
Nominal efficiency	EER				3.21		2.65	
	COP				3.61		3.41	
	Annual energy consumption			kWh	1,480		2,265	
	Energy label	Cooling			A		D	
		Heating			A		B	

2-8 Capacity and Power input					FAQ100C9/RZQSG100L8Y1	
Cooling capacity	Nom.			kW	9.5	
Heating capacity	Nom.			kW	10.8	
Power input	Cooling	Nom.		kW	3.16	
	Heating	Nom.		kW	3.17	
Seasonal efficiency (according to EN14825)	Cooling	Energy label			A+	
		Pdesign		kW	9.50	
		SEER			5.61	
		Annual energy consumption		kWh	593	
	Heating (Average climate)	Energy label			A+	
		Pdesign		kW	6.81	
		SCOP/A			4.01	
		Annual energy consumption		kWh	2,378	
Eurovent	Sound power level outdoor	Cooling	Nom.	dBA	69	
	Sound power level indoor	Cooling	Nom.	dBA	65	
Nominal efficiency	EER				3.01	
	COP				3.41	
	Annual energy consumption			kWh	1,580	
	Energy label	Cooling			B	
		Heating			B	

Notes

EER/COP according to Eurovent 2012, for use outside EU only

Nominal efficiency: cooling at 35°/27° nominal load, heating at 7°/20° nominal load

2-9 Technical Specifications				RZQSG100L8Y1	RZQSG125L8Y1	RZQSG140LY1
Capacity control	Method			Inverter controlled		
Casing	Colour			Ivory white		
	Material			Painted galvanized steel plate		
Dimensions	Unit	Height	mm	990		1,430
		Width	mm	940		
		Depth	mm	320		
	Packed unit	Height	mm	1,170		1,610
		Width	mm	1,015		
		Depth	mm	422		

2 Specifications

2-9 Technical Specifications					RZQSG100L8Y1		RZQSG125L8Y1		RZQSG140LY1	
Weight	Unit			kg	82			101		
	Packed unit			kg	88			114		
Packing	Weight			kg	6			-		
Heat exchanger	Fin		Type		WF fin					
			Treatment		Anti-corrosion treatment (PE)					
Compressor	Quantity				1					
	Type				Hermetically sealed swing compressor					
	Starting method				Inverter driven					
Fan	Type				Propeller fan					
	Discharge direction				Horizontal					
	Quantity				1			2		
	Air flow rate	Cooling	Nom.	m³/min	76		77		83	
			Moderate	m³/min	55			-		
		Heating	Nom.	m³/min	83				62	
			Moderate	m³/min	55			-		
Fan motor	Quantity				1			2		
	Model				Brushless DC motor					
	Output			W	200			94		
	Drive				Direct drive					
	Speed	Cooling	Super low	rpm	-					
		Heating	Super low	rpm	-					
Sound power level	Cooling			dBA	69		70		69	
	Heating			dBA	-					
Sound pressure level	Cooling	Nom.		dBA	53		54		53	
	Heating	Nom.		dBA	57		58		54	
	Night quiet mode	Level 1		dBA	49					
Operation range	Cooling	Ambient	Min.	°CDB	-15					
			Max.	°CDB	46					
	Heating	Ambient	Min.	°CWB	-15					
			Max.	°CWB	15.5					
Refrigerant	Type				R-410A					
	Charge			kg	2.9			4.0		
				TCO ₂ eq	6.1			8.4		
	Control				Expansion valve (electronic type)					
	GWP				2,087.5					
	Circuits	Quantity			1					

2 Specifications

2-9 Technical Specifications					RZQSG100L8Y1	RZQSG125L8Y1	RZQSG140LY1
Piping connections	Liquid	Quantity			1		
		Type			Flare connection		
		OD	mm		9.52		
	Gas	Quantity			1		
		Type			Flare connection		
		OD	mm		15.9		
	Drain	Quantity			5		
		Type			Hole		
		ID	mm		-		
		OD	mm		26		
	Piping length	OU - IU	Min.	m	5		
			Max.	m	50		
		System	Equivalent	m	70		
			Chargel ess	m	30		
	Additional refrigerant charge			kg/m	See installation manual		
Level difference	IU - OU	Max.	m	30			
	IU - IU	Max.	m	0.5			
Heat insulation				Both liquid and gas pipes			
Refrigerant oil	Type				FVC50K		
	Charged volume			l	0.9		1.35
Defrost method					Reversed cycle		
Defrost control					Sensor for outdoor heat exchanger temperature		
Safety devices	Item	01			High pressure switch		
		02			Fan driver overload protector		
		03			Fuse		

Standard Accessories : Tie-wraps; Quantity : 2;

Standard Accessories : Installation manual; Quantity : 1;

2-10 Electrical Specifications				RZQSG100L8Y1	RZQSG125L8Y1	RZQSG140LY1
Power supply	Name			Y1		
	Phase			3N~		
	Frequency		Hz	50		
	Voltage		V	380-415		
	Voltage range	Min.	%	342		-10
		Max.	%	456		10
Current - 50Hz	Maximum fuse amps (MFA)		A	16		20
Current	Zmax	List		Complies to EN61000-3-11		
	Recommended fuses		A	20		
Current - 60Hz	Maximum fuse amps (MFA)		A	-		
Wiring connections	For power supply	Remark		See installation manual outdoor unit		
	For connection with indoor	Remark		See installation manual outdoor unit		
Power supply intake				Outdoor unit only		

Notes

PED: assembly = category I : excluded from scope of PED due to article 1, item 3.6 of 97/23/EC

See separate drawing for electrical data

Contains fluorinated greenhouse gases

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. Data for standard efficiency series

Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m. Data for standard efficiency series

3 Electrical data

3 - 1 Electrical Data

RZQSG100L8Y1

							Compressor		OFM		IFM		
Indoor	Outdoor	Power supply	Voltage range		MCA	TOCA	MFA	MSC	RLA	kW	FLA	kW	FLA
FCQG100EVEB		3N~ 50Hz 380-415V	Minimum: 342 V Maximum: 456 V		14,5	—	16	—	11,4	0,2	0,6	0,106	1
FCQHG100FVEB					14,8	—	16	—	11,4	0,2	0,6	0,221	1,3
FCQG35FVEB	x3				14,3	—	16	—	11,4	0,2	0,6	0,044x3	0,3x3
FCQG50FVEB	x2				14,0	—	16	—	11,4	0,2	0,6	0,039x2	0,3x2
FCQG100FVEB					14,1	—	16	—	11,4	0,2	0,6	0,117	0,7
FFQ35C2VEB	x3				14,7	—	16	—	11,4	0,2	0,6	0,05x3	0,4x3
FFQ50C2VEB	x2				14,2	—	16	—	11,4	0,2	0,6	0,05x2	0,4x2
FDXS35F2VEB	x3				14,3	—	16	—	11,4	0,2	0,6	0,034x3	0,3x3
FDXS50F2VEB9	x2				14,5	—	16	—	11,4	0,2	0,6	0,06x2	0,5x2
FBQ35C8VEB	x3				17,7	—	20	—	11,4	0,2	0,6	0,140x3	1,2x3
FBQ50C8VEB	x2				16,2	—	20	—	11,4	0,2	0,6	0,140x2	1,2x2
FBQ100C8VEB					15,2	—	16	—	11,4	0,2	0,6	0,350	1,6
FAQ100C8VEB9					13,7	—	16	—	11,4	0,2	0,6	0,064	0,4
FVQ100C8VEB					14,7	—	16	—	11,4	0,2	0,6	0,238	1,2
FHQ35CBVEB	x3				15,5	—	16	—	11,4	0,2	0,6	0,060 x 3	0,6 x 3
FHQ50CBVEB	x2				14,7	—	16	—	11,4	0,2	0,6	0,060 x 2	0,6 x 2
FHQ100CBVEB					14,8	—	16	—	11,4	0,2	0,6	0,150	1,3
FUQ100C8VEB					14,8	—	16	—	11,4	0,2	0,6	0,106	1,3

Symbols

MCA: Minimum Circuit Ampere [A]
 TOCA: Total overcurrent amps [A]
 MFA: Maximum Fuse Ampere [A]
 MSC: Maximum current of the starting compressor [A]
 RLA: Rated load amps [A]
 OFM: Outdoor fan motor
 IFM: Indoor fan motor
 FLA: Full Load Ampere [A]
 KW: Fan motor rated output [kW]

Notes

- The RLA is based on the following conditions.
 Cooling
 Indoor temperature 27.0°C DB / 19.0°C WB
 Outdoor temperature 35.0°C DB
 Heating
 Indoor temperature 20.0°C DB
 Outdoor temperature 7.0°C DB / 6.0°C WB
- TOCA is the total value of each overcurrent set.
- Voltage range
 The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- MCA is the maximum input current.
 The capacity of the MFA must be greater than that of the MCA.
 Select the MFA according to the table.
- Select the wire size according to the MCA.
- MFA is used to select the circuit breaker and the ground fault circuit interruptor.
 Earth leakage circuit breaker

3D077811 C

3 Electrical data

3 - 1 Electrical Data

RZQSG125-140L(8)Y1

Indoor	Outdoor	Power supply	Voltage range	MCA	TOCA	MFA	Compressor		OFM		IFM	
							MSC	RLA	KW	FLA	KW	FLA
FCQG125EVEB	RZQSG125L8Y1B	3N~ 50Hz 380-415V	Minimum: 342 V Maximum 456 V	14,6	—	16	—	11,4	0,2	0,6	0,106	1,1
FCQHG125FVEB	RZQSG125L8Y1B			15,0	—	16	—	11,4	0,2	0,6	0,244	1,4
FCQG35FVEB	x4 RZQSG125L8Y1B			14,7	—	16	—	11,4	0,2	0,6	0,044x4	0,3x4
FCQG50FVEB	x3 RZQSG125L8Y1B			14,3	—	16	—	11,4	0,2	0,6	0,039x3	0,3x3
FCQG60FVEB	x2 RZQSG125L8Y1B			14,0	—	16	—	11,4	0,2	0,6	0,044x2	0,3x2
FCQG125FVEB	RZQSG125L8Y1B			14,5	—	16	—	11,4	0,2	0,6	0,168	1
FFQ35C2VEB	x4 RZQSG125L8Y1B			15,2	—	16	—	11,4	0,2	0,6	0,05x4	0,4x4
FFQ50C2VEB	x3 RZQSG125L8Y1B			14,7	—	16	—	11,4	0,2	0,6	0,05x3	0,4x3
FFQ60C2VEB	x2 RZQSG125L8Y1B			14,7	—	16	—	11,4	0,2	0,6	0,05x2	0,6x2
FDXS35F2VEB	x4 RZQSG125L8Y1B			14,7	—	16	—	11,4	0,2	0,6	0,034x4	0,3x4
FDXS50F2VEB9	x3 RZQSG125L8Y1B			15,1	—	16	—	11,4	0,2	0,6	0,060x3	0,5x3
FDXS60F2VEB	x2 RZQSG125L8Y1B			14,5	—	16	—	11,4	0,2	0,6	0,060x2	0,5x2
FBQ35C8VEB	x4 RZQSG125L8Y1B			19,2	—	20	—	11,4	0,2	0,6	0,140x4	1,2x4
FBQ50C8VEB	x3 RZQSG125L8Y1B			17,7	—	20	—	11,4	0,2	0,6	0,140x3	1,2x3
FBQ60C8VEB	x2 RZQSG125L8Y1B			16,0	—	20	—	11,4	0,2	0,6	0,350x2	1,1x2
FBQ125C8VEB	RZQSG125L8Y1B			15,8	—	16	—	11,4	0,2	0,6	0,350	2,1
FDQ125C7VEB	RZQSG125L8Y1B			15,8	—	16	—	11,4	0,2	0,6	0,350	2,1
FVQ125CVEB	RZQSG125L8Y1B			14,7	—	16	—	11,4	0,2	0,6	0,238	1,2
FHQ35CBVEB	x4 RZQSG125L8Y1B			16,2	—	20	—	11,4	0,2	0,6	0,060x4	0,6 x 4
FHQ50CBVEB	x3 RZQSG125L8Y1B			15,5	—	16	—	11,4	0,2	0,6	0,060x3	0,6 x 3
FHQ60CBVEB	x2 RZQSG125L8Y1B			14,7	—	16	—	11,4	0,2	0,6	0,091x2	0,8 x 2
FHQ125CBVEB	RZQSG125L8Y1B			15,1	—	16	—	11,4	0,2	0,6	0,15	1,5
FUQ125CVEB	RZQSG125L8Y1B			15,0	—	16	—	11,4	0,2	0,6	0,106	1,4
FCQG71EVEB	x2 RZQSG140L7Y1B	3N~ 50Hz 380-415V	Minimum: 342 V Maximum 456 V	17,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,048x2	0,4x2
FCQG140EVEB	RZQSG140L7Y1B			17,875	—	20	—	14,2	0,094+0,094	0,4+0,4	0,106	1,1
FCQHG71FVEB	x2 RZQSG140L7Y1B			17,75	—	20	—	14,2	0,094+0,094	0,4+0,4	0,091x2	0,5x2
FCQHG140FVEB	RZQSG140L7Y1B			18,25	—	20	—	14,2	0,094+0,094	0,4+0,4	0,244	1,4
FCQG35FVEB	x4 RZQSG140L7Y1B			18	—	20	—	14,2	0,094+0,094	0,4+0,4	0,044x4	0,3x4
FCQG50FVEB	x3 RZQSG140L7Y1B			17,625	—	20	—	14,2	0,094+0,094	0,4+0,4	0,039x3	0,3x3
FCQG71FVEB	x2 RZQSG140L7Y1B			17,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,054x2	0,4x2
FCQG140FVEB	RZQSG140L7Y1B			17,75	—	20	—	14,2	0,094+0,094	0,4+0,4	0,168	1
FFQ35C2VEB	x4 RZQSG140L7Y1B			18,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,05x4	0,4x4
FFQ50C2VEB	x3 RZQSG140L7Y1B			18	—	20	—	14,2	0,094+0,094	0,4+0,4	0,05x3	0,4x3
FFQ60C2VEB	x2 RZQSG140L7Y1B			18	—	20	—	14,2	0,094+0,094	0,4+0,4	0,034x4	0,3x4
FDXS35F2VEB	x4 RZQSG140L7Y1B			18,375	—	20	—	14,2	0,094+0,094	0,4+0,4	0,06x3	0,5x3
FDXS50F2VEB9	x3 RZQSG140L7Y1B			22,5	—	25	—	14,2	0,094+0,094	0,4+0,4	0,140x4	1,2x4
FBQ35C8VEB	x4 RZQSG140L7Y1B			21	—	25	—	14,2	0,094+0,094	0,4+0,4	0,140x3	1,2x3
FBQ50C8VEB	x3 RZQSG140L7Y1B			19,25	—	20	—	14,2	0,094+0,094	0,4+0,4	0,350x2	1,1x2
FBQ71C8VEB	x2 RZQSG140L7Y1B			19,125	—	20	—	14,2	0,094+0,094	0,4+0,4	0,35	2,1
FBQ140C8VEB	RZQSG140L7Y1B			17,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,048x2	0,4x2
FAQ71CVEB9	x2 RZQSG140L7Y1B			18,25	—	20	—	14,2	0,094+0,094	0,4+0,4	0,276	1,4
FVQ140CVEB	RZQSG140L7Y1B			19,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,060 x 4	0,6 x 4
FHQ35CBVEB	x 4 RZQSG140L7Y1B			18,8	—	20	—	14,2	0,094+0,094	0,4+0,4	0,060 x 3	0,6 x 3
FHQ50CBVEB	x 3 RZQSG140L7Y1B			18,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,091 x 2	0,8 x 2
FHQ71CBVEB	x 2 RZQSG140L7Y1B			18,8	—	20	—	14,2	0,094+0,094	0,4+0,4	0,15	1,8
FHQ140CBVEB	RZQSG140L7Y1B			18,8	—	20	—	14,2	0,094+0,094	0,4+0,4	0,046 x 2	0,9 x 2
FUQ71CVEB	x2 RZQSG140L7Y1B			18,8	—	20	—	14,2	0,094+0,094	0,4+0,4	0,046 x 2	0,9 x 2

Symbols

MCA: Minimum Circuit Ampere [A]
 TOCA: Total overcurrent amps [A]
 MFA: Maximum Fuse Ampere [A]
 MSC: Maximum current of the starting compressor [A]
 RLA: Rated load amps [A]
 OFM: Outdoor fan motor
 IFM: Indoor fan motor
 FLA: Full Load Ampere [A]
 KW: Fan motor rated output [kW]

Notes

- The RLA is based on the following conditions.
 Cooling
 Indoor temperature 27.0°C DB / 19.0°C WB
 Outdoor temperature 35.0°C DB
 Heating
 Indoor temperature 20.0°C DB
 Outdoor temperature 7.0°C DB / 6.0°C WB
- TOCA is the total value of each overcurrent set.
- Voltage range
 The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- MCA is the maximum input current.
 The capacity of the MFA must be greater than that of the MCA.
 Select the MFA according to the table.
- Select the wire size according to the MCA.
- MFA is used to select the circuit breaker and the ground fault circuit interruptor.
 Earth leakage circuit breaker

3D077811 C

3 Electrical data

3 - 1 Electrical Data

RZQSG-L(8)Y1

Unit combination		Minimum Ssc value (kVA)
FFQ35B9V1B	x3	936
FFQ50B9V1B	x2	951
FHQ35BWW1B	x3	977
FHQ50BWW1B	x2	936
FBQ35C8VEB	x3	1092
FBQ50C8VEB	x2	1014
FCQG35FVEB	x3	915
FCQG50FVEB	x2	899
FBQ100C8VEB	x1	962
FCQG100FVEB	x1	905
FCQHG100FVEB	x1	941
FAQ100CVEB	x1	884
FVQ100CVEB	x1	936
FHQG100CVEB	x1	936
FUQ100BWW1B	x1	925
FFQ35B9V1B	x4	962
FFQ50B9V1B	x3	993
FFQ60B9V1B	x2	951
FHQ35BWW1B	x4	1014
FHQ50BWW1B	x3	977
FHQ60BWW1B	x2	936
FBQ35C8VEB	x4	1170
FBQ50C8VEB	x3	1092
FBQ60C8VEB	x2	1003
FCQG35FVEB	x4	936
FCQG50FVEB	x3	915
FCQG60FVEB	x2	899
FBQ125C8VEB	x1	993
FCQG125FVEB	x1	925
FCQHG125FVEB	x1	951
FVQ125CVEB	x1	936
FHQG125CVEB	x1	962
FUQ125BWW1B	x1	925
FDQ125C7VEB	x1	993

Unit combination		Minimum Ssc value (kVA)
FFQ35B9V1B	x4	962
FFQ50B9V1B	x3	993
FHQ35BWW1B	x4	1014
FHQ50BWW1B	x3	977
FBQ35C8VEB	x4	1170
FBQ50C8VEB	x3	1092
FCQG35FVEB	x4	936
FCQG50FVEB	x3	915
FCQG71FVEB	x2	910
FCQHG71FVEB	x2	925
FAQ71CVEB	x2	910
FHQG71CVEB	x2	962
FBQ71C8VEB	x2	1003
FUQ71BWW1B	x2	936
FBQ140C8VEB	x1	993
FCQG140FVEB	x1	925
FCQHG140FVEB	x1	951
FVQ140CVEB	x1	951
FHQG140CVEB	x1	977
FFQ35B9V1B	x4	962
FFQ50B9V1B	x3	993
FHQ35BWW1B	x4	1014
FHQ50BWW1B	x3	977
FBQ35C8VEB	x4	1170
FBQ50C8VEB	x3	1092
FCQG35FVEB	x4	936
FCQG50FVEB	x3	915
FCQG71FVEB	x2	910
FCQHG71FVEB	x2	925
FAQ71CVEB	x2	910
FHQG71CVEB	x2	962
FBQ71C8VEB	x2	1003
FBQ140C8VEB	x1	993
FCQG140FVEB	x1	925
FCQHG140FVEB	x1	951
FVQ140CVEB	x1	951
FHQG140CVEB	x1	977

3D079056

NOTES

- In accordance with EN/IEC 61000-3-12⁽¹⁾, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with $S_{sc}^{(2)} \geq$ minimum Ssc value.

- ⁽¹⁾ European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current > 16A and $\leq$ 75A per phase.

- ⁽²⁾ Short-circuit power

3 Electrical data

3 - 1 Electrical Data

RZQSG100-125L8Y1

Unit combination restrictions		Power supply					COMP		OFM		IFM	
Indoor	Outdoor	①	②	③	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
2xFNQ50A2VEB	RZQSG100L8Y1B	3N~ 50Hz	380~ 415V	MAX. 50Hz 456V MIN. 50Hz 342V	14,6	16	–	11,4	0,2	0,6	2x0.06	2x0.5
3xFNQ35A2VEB	RZQSG100L8Y1B				14,5	16	–	11,4	0,2	0,6	3x0.034	3x0.3
2xFNQ60A2VEB	RZQSG125L8Y1B				14,7	16	–	11,4	0,2	0,6	2x0.06	2x0.5
3xFNQ50A2VEB	RZQSG125L8Y1B				15,2	16	–	11,4	0,2	0,6	3x0.06	3x0.5
4xFNQ35A2VEB	RZQSG125L8Y1B				14,9	16	–	11,4	0,2	0,6	4x0.034	4x0.3

Notes

- The RLA is based on the following conditions.
Indoor temperature 27°C DB / 19°C WB
Outdoor temperature 35°C DB
- Select the wire size according to the MCA.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- Use a circuit breaker instead of a fuse.

Symbols

- ① Hz
② Voltage
③ Voltage range
MCA Minimum Circuit Ampere (A)
MFA Maximum Fuse Ampere (A)
RLA Rated load amps [A]

- OFM Outdoor fan motor
IFM Indoor fan motor
FLA Full Load Ampere (A)
kW Fan motor rated output [kW]
RHz Rated operating frequency [Hz]
COMP Compressor

3D096315C

RZQSG100-140L(8)Y1

Unit combination restrictions		Power supply					COMP		OFM		IFM	
Indoor	Outdoor	①	②	③	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
3xFBQ35D2VEB	RZQSG100L8Y1B	3N~ 50Hz	380~ 415V	MAX. 50Hz 456V MIN. 50Hz 342V	15,4	16	–	11,4	0,2	0,6	3x0.089	3x0.6
FBQ125D2VEB	RZQSG125L8Y1B				15,2	16	–	11,4	0,2	0,6	0,187	1,5
2xFBQ60D2VEB	RZQSG125L8Y1B				14,7	16	–	11,4	0,2	0,6	2x0.07	2x0.5
3xFBQ50D2VEB	RZQSG125L8Y1B				15,5	16	–	11,4	0,2	0,6	3x0.089	3x0.6
4xFBQ35D2VEB	RZQSG125L8Y1B				16,1	20	–	11,4	0,2	0,6	4x0.089	4x0.6
FBQ140D2VEB	RZQSG140L7Y1B				18,5	20	–	14,2	0.094 + 0.094	0.4 + 0.4	0,187	1,5
2xFBQ71D2VEB	RZQSG140L7Y1B				18	20	–	14,2	0.094 + 0.094	0.4 + 0.4	2x0.07	2x0.5
3xFBQ50D2VEB	RZQSG140L7Y1B				18,8	20	–	14,2	0.094 + 0.094	0.4 + 0.4	3x0.089	3x0.6
4xFBQ35D2VEB	RZQSG140L7Y1B				19,4	25	–	14,2	0.094 + 0.094	0.4 + 0.4	4x0.089	4x0.6

Notes

- The RLA is based on the following conditions.
Indoor temperature 27°C DB / 19°C WB
Outdoor temperature 35°C DB
- Select the wire size according to the MCA.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- Use a circuit breaker instead of a fuse.

Symbols

- ① Hz
② Voltage
③ Voltage range
MCA Minimum Circuit Ampere (A)
MFA Maximum Fuse Ampere (A)
RLA Rated load amps [A]

- OFM Outdoor fan motor
IFM Indoor fan motor
FLA Full Load Ampere (A)
kW Fan motor rated output [kW]
RHz Rated operating frequency [Hz]
COMP Compressor

3D094863B

3 Electrical data

3 - 1 Electrical Data

RZQSG100L8Y1

Unit combination restrictions		Power supply					COMP		OFM		IFM	
Indoor	Outdoor	①	②	③	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
FBQ100D2VEB	RZQSG100L8Y1B	3N~ 50Hz	380~ 415V	MAX. 50Hz 456V MIN. 50Hz 342V	14,6	16	–	11,4	0,2	0,6	0,127	1,0
2xFBQ50D2VEB	RZQSG100L8Y1B				14,8	16	–	11,4	0,2	0,6	2x0,089	2x0,6

Notes

- The RLA is based on the following conditions.
Indoor temperature 27°C DB / 19°C WB
Outdoor temperature 35°C DB
- Select the wire size according to the MCA.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- Use a circuit breaker instead of a fuse.

Symbols

① Hz	OFM Outdoor fan motor
② Voltage	IFM Indoor fan motor
③ Voltage range	FLA Full Load Ampere (A)
MCA Minimum Circuit Ampere (A)	kW Fan motor rated output [kW]
MFA Maximum Fuse Ampere (A)	RHz Rated operating frequency [Hz]
RLA Rated load amps [A]	COMP Compressor

3D094863B

Electrical data

3 - 1 Electrical Data

RZQSG125-140L(8)Y1

Indoor	Outdoor	Phase ~ Hz/Power supply	Voltage range	MCA	TOCA	MFA	Comp		OFM		IFM	
							MSC	RLA	kW	FLA	kW	FLA
FCQG125EVEB	RZQSG125L8Y1B	3N ~ 50Hz 380-415V	Min. 342V Max. 456V	14,6	—	16	—	11,4	0,2	0,6	0,106	1,1
FCQHG125FVEB				15,0	—	16	—	11,4	0,2	0,6	0,244	1,4
FCQG35FVEB x4				14,7	—	16	—	11,4	0,2	0,6	0,044x4	0,3x4
FCQG50FVEB x3				14,3	—	16	—	11,4	0,2	0,6	0,039x3	0,3x3
FCQG60FVEB x2				14,0	—	16	—	11,4	0,2	0,6	0,044x2	0,3x2
FCQG125FVEB				14,5	—	16	—	11,4	0,2	0,6	0,168	1,0
FFQ35C2VEB x4				15,2	—	16	—	11,4	0,2	0,6	0,05x4	0,4x4
FFQ50C2VEB x3				14,7	—	16	—	11,4	0,2	0,6	0,05x3	0,4x3
FFQ60C2VEB x2				14,7	—	16	—	11,4	0,2	0,6	0,05x2	0,6x2
FDXS35F2VEB x4				14,7	—	16	—	11,4	0,2	0,6	0,034x4	0,3x4
FDXS50F2VEB9 x3				15,1	—	16	—	11,4	0,2	0,6	0,060x3	0,5x3
FDXS60F2VEB x2				14,5	—	16	—	11,4	0,2	0,6	0,060x2	0,5x2
FBQ35C8VEB x4				19,2	—	20	—	11,4	0,2	0,6	0,140x4	1,2x4
FBQ50C8VEB x3				17,7	—	20	—	11,4	0,2	0,6	0,140x3	1,2x3
FBQ60C8VEB x2				16,0	—	20	—	11,4	0,2	0,6	0,350x2	1,1x2
FBQ125C8VEB				15,8	—	16	—	11,4	0,2	0,6	0,350	2,1
FDQ125C7VEB				15,8	—	16	—	11,4	0,2	0,6	0,350	2,1
FVQ125CVEB				14,7	—	16	—	11,4	0,2	0,6	0,238	1,2
FHQ35CAVEB x4				16,2	—	20	—	11,4	0,2	0,6	0,060x4	0,6 x 4
FHQ50CAVEB x3				15,5	—	16	—	11,4	0,2	0,6	0,060x3	0,6 x 3
FHQ60CAVEB x2				14,7	—	16	—	11,4	0,2	0,6	0,091x2	0,8 x 2
FHQ125CAVEB				15,1	—	16	—	11,4	0,2	0,6	0,150	1,5
FCQG71EVEB x2	RZQSG140L7Y1B	3N ~ 50Hz 380-415V	Min. 342V Max. 456V	17,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,048x2	0,4x2
FCQG140EVEB				17,9	—	20	—	14,2	0,094+0,094	0,4+0,4	0,106	1,1
FCQHG71FVEB x2				17,8	—	20	—	14,2	0,094+0,094	0,4+0,4	0,091x2	0,5x2
FCQHG140FVEB				18,3	—	20	—	14,2	0,094+0,094	0,4+0,4	0,244	1,4
FCQG35FVEB x4				18,0	—	20	—	14,2	0,094+0,094	0,4+0,4	0,044x4	0,3x4
FCQG50FVEB x3				17,6	—	20	—	14,2	0,094+0,094	0,4+0,4	0,039x3	0,3x3
FCQG71FVEB x2				17,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,054x2	0,4x2
FCQG140FVEB				17,8	—	20	—	14,2	0,094+0,094	0,4+0,4	0,168	1,0
FFQ35C2VEB x4				18,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,05x4	0,4x4
FFQ50C2VEB x3				18,0	—	20	—	14,2	0,094+0,094	0,4+0,4	0,05x3	0,4x3
FDXS35F2VEB x4				18,0	—	20	—	14,2	0,094+0,094	0,4+0,4	0,034x4	0,3x4
FDXS50F2VEB9 x3				18,4	—	20	—	14,2	0,094+0,094	0,4+0,4	0,06x3	0,5x3
FBQ35C8VEB x4				22,5	—	25	—	14,2	0,094+0,094	0,4+0,4	0,140x4	1,2x4
FBQ50C8VEB x3				21,0	—	25	—	14,2	0,094+0,094	0,4+0,4	0,140x3	1,2x3
FBQ71C8VEB x2				19,3	—	20	—	14,2	0,094+0,094	0,4+0,4	0,350x2	1,1x2
FBQ140C8VEB				19,1	—	20	—	14,2	0,094+0,094	0,4+0,4	0,350	2,1
FAQ71C8VEB x2				17,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,048x2	0,4x2
FVQ140C8VEB				18,3	—	20	—	14,2	0,094+0,094	0,4+0,4	0,276	1,4
FHQ35CAVEB x4				19,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,060 x 4	0,6 x 4
FHQ50CAVEB x3				18,8	—	20	—	14,2	0,094+0,094	0,4+0,4	0,060 x 3	0,6 x 3
FHQ71CAVEB x2				18,5	—	20	—	14,2	0,094+0,094	0,4+0,4	0,091 x 2	0,8 x 2
FHQ140CAVEB				18,8	—	20	—	14,2	0,094+0,094	0,4+0,4	0,150	1,8

SYMBOLS

MCA	: Min. Circuit Amps. (A)
TOCA	: Total Over-Current Amps. (A)
MFA	: Max. Fuse Amps (See note 7) (A)
MSC	: Max. current during the starting compressor, (A)
RLA	: Rated Load Amps. (A)
OFM	: Outdoor Fan Motor, (A)
IFM	: Indoor Fan Motor.
FLA	: Full Load Amps.
kW	: Fan Motor Rated Output (kW)

NOTES

- 1 RLA is based on the following conditions:
Cooling
Indoor temperature 27.0°CDB/19.0°CWB
Outdoor temperature 35.0°CDB
Heating
Indoor temperature 20.0°CDB
Outdoor temperature 7.0°CDB / 6.0°CWB
- 2 TOCA means the total value of each OC set.
- 3 Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.
- 4 Maximum allowable voltage variation between phases is 2%.
- 5 MCA represents maximum input current, MFA represents capacity which may accept MCA.
(next lower standard fuse rating, min.15A)
- 6 Select wire size based on the larger value of MCA or TOCA.
- 7 MFA is used to select the circuit breaker and the ground fault circuit interrupter.
(earth leakage circuit breaker)

3D077811B

3 Electrical data

3 - 1 Electrical Data

RZQSG140LY1

Unit combination restrictions		Power supply					COMP		OFM		IFM	
Indoor	Outdoor	①	②	③	MCA	MFA	RHz	RLA	kW	FLA	kW	FLA
3xFNQ50A2VEB	RZQSG140L7Y1B	3N~ 50Hz	380~ 415V	MAX. 50Hz 456V MIN. 50Hz 342V	18,5	20	–	14,2	0.094 + 0.094	0.4 + 0.4	3x0.06	3x0.5
4xFNQ35A2VEB	RZQSG140L7Y1B				18,2	20	–	14,2	0.094 + 0.094	0.4 + 0.4	4x0.034	4x0.3

Notes

- The RLA is based on the following conditions.
Indoor temperature 27°C DB / 19°C WB
Outdoor temperature 35°C DB
- Select the wire size according to the MCA.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- Use a circuit breaker instead of a fuse.

Symbols

- ① Hz
- ② Voltage
- ③ Voltage range
- MCA Minimum Circuit Ampere (A)
- MFA Maximum Fuse Ampere (A)
- RLA Rated load amps [A]

- OFM Outdoor fan motor
- IFM Indoor fan motor
- FLA Full Load Ampere (A)
- kW Fan motor rated output [kW]
- RHz Rated operating frequency [Hz]
- COMP Compressor

3D096315C

4 Options

4 - 1 Options

RZQSG-L(8)Y1

Available options for RZQSG models:

Name of option		Kit name		
		RZQSG100L8Y1	RZQSG125L8Y1	RZQSG140LY1
Bottom plate heater		-		
Refrigerant branch piping	Twin	KHRQ22M20TA (KHRQ58T): See note 1		
	Triple	KHRQ127H (KHRQ58H): See note 1		
	Double twin	-	KHRQ22M20TA (KHRQ58T): See note 1	
Demand adapter kit		KRP58M51		

3D076079

NOTES

- 1 For RZQSG71-140L(8)Y1 in combination with FCQG35-71F or FCQH71F use the refrigerant branch piping mentioned between brackets.

5 Combination table

5 - 1 Combination Table

5

RZQSG-L3/9V1
RZQSG-L(8)Y1

Possible combinations	P= Pair	71	100	125	140
2= Twin		35+35	50+50	60+60	71+71
3= Triple		35+35+35	50+50+50 (*)	60+60+60 (*)	71+71+71
4= Double twin			35+35+35+35 (*)	50+50+50+50 (*)	

(*) Maximum capacity of outdoor units

Sky Air	High Cassette	Thin cassette	2x2 cassette	Duct (medium ESP)	Ceiling-suspended	Ceiling-mounted - 4-way blow	Wall mounted type	Duct (high ESP)	Floor standing type	Slim duct
Model	FCQHG1FVEB FCQHG100FVEB FCQHG125FVEB FCQHG140FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB
RZQSG71L3V1B	P									
RZQSG100L9V1B	P									
RZQSG125L9V1B	P									
RZQSG140L9V1B	P									

Sky Air	Duct (medium ESP)	Concealed floor standing type
Model	FBQSD2VEB FBQSD2VEB FBQSD2VEB FBQSD2VEB	FBQSD2VEB FBQSD2VEB FBQSD2VEB FBQSD2VEB
RZQSG71L3V1B	P	
RZQSG100L9V1B	P	
RZQSG125L9V1B	P	
RZQSG140L9V1B	P	

Notes

- The capacities in the table are combined capacities (multiple units operating simultaneously) and not individual indoor unit capacities.
- When combining multiple indoor units, designate the unit whose remote controller is equipped with the most functions as the master unit.
- For the selection of the correct refnet kit, required to install a multi-combination, refer to the option list.

Twin : KHRQ22M20TA or KHRQ58T
Triple : KHRQ127H or KHRQ58H
Double twin : KHRQ22M20TA or KHRQ58T

3D090361C

RZQSG-L3/9V1

RZQSG-L(8)Y1

Possible combinations	P= Pair	71	100	125	140
2= Twin		35+35	50+50	60+60	71+71
3= Triple		35+35+35	50+50+50 (*)	60+60+60 (*)	71+71+71
4= Double twin			35+35+35+35 (*)	50+50+50+50 (*)	

(*) Maximum capacity of outdoor units

Sky Air	High Cassette	Thin cassette	2x2 cassette	Duct (medium ESP)	Ceiling-suspended	Ceiling-mounted - 4-way blow	Wall mounted type	Duct (high ESP)	Floor standing type	Slim duct
Model	FCQHG1FVEB FCQHG100FVEB FCQHG125FVEB FCQHG140FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB
RZQSG71L3V1B	P									
RZQSG100L9V1B	P									
RZQSG125L9V1B	P									
RZQSG140L9V1B	P									

Sky Air	High Cassette	Thin cassette	2x2 cassette	Duct (medium ESP)	Ceiling-suspended	Ceiling-mounted - 4-way blow	Wall mounted type	Duct (high ESP)	Floor standing type	Slim duct
Model	FCQHG1FVEB FCQHG100FVEB FCQHG125FVEB FCQHG140FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB	FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB FCQGS9FVEB
RZQSG71L3V1B	P									
RZQSG100L9V1B	P									
RZQSG125L9V1B	P									
RZQSG140L9V1B	P									

Sky Air	Duct (medium ESP)	Concealed floor standing type
Model	FBQSD2VEB FBQSD2VEB FBQSD2VEB FBQSD2VEB	FBQSD2VEB FBQSD2VEB FBQSD2VEB FBQSD2VEB
RZQSG71L3V1B	P	
RZQSG100L9V1B	P	
RZQSG125L9V1B	P	
RZQSG140L9V1B	P	

Notes

- The capacities in the table are combined capacities (multiple units operating simultaneously) and not individual indoor unit capacities.
- When combining multiple indoor units, designate the unit whose remote controller is equipped with the most functions as the master unit.
- For the selection of the correct refnet kit, required to install a multi-combination, refer to the option list.

Twin : KHRQ22M20TA or KHRQ58T
Triple : KHRQ127H or KHRQ58H
Double twin : KHRQ22M20TA or KHRQ58T

3D090361D


6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables


RZQSG100L9V1

RZQSG100L8Y1

Cooling

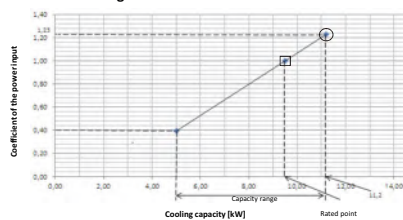

Heating

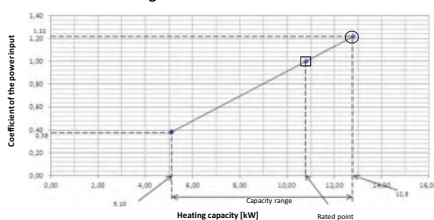

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 PI: Power input [kW]
 compressor + indoor and outdoor fan motors

Cooling

Indoor		Outdoor temperature (°C DB)											
		25			30			35			40		
TC	SHC	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
16.0	22	11.2	7.61	1.01	10.8	7.44	1.11	10.5	7.29	1.22	10.1	7.09	1.32
18.0	25	11.6	7.59	1.01	11.4	7.49	1.12	11.0	7.27	1.23	10.5	7.09	1.33
19.0	27	12.0	7.57	1.02	11.6	7.44	1.12	11.2	7.26	1.23	10.8	7.04	1.33
19.5	27	12.1	7.59	1.02	11.7	7.37	1.13	11.4	7.34	1.23	10.9	7.04	1.34
22.0	30	12.8	7.52	1.02	12.4	7.36	1.13	11.9	7.15	1.24	11.5	7.00	1.35
24.0	32	13.3	7.42	1.03	12.9	7.27	1.14	12.4	7.06	1.25	12.0	6.91	1.36

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- = Maximum at standard conditions
 □ = Rated capacity and rated coefficient of the power input
 The maximum capacity is not guaranteed except at standard conditions.
- SHC is based on indoor units EWB & EDB.
 SHC for other dry-bulb temperatures = SHC + SHC*
 SHC* = SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
- The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0m
- CPI is a percentage value compared to the rated value which is 1.00.
- The error rate for this value is less than 5% and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.
- The air flow rate and bypass factor are mentioned in the table.

Pair	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P
AFR	33.3	33.0	32.0	20.0	26.0	28.0	29.0	29.0	31.0
(BF)	(0.17)	(0.17)	(0.13)	(0.09)	(0.10)	(0.20)	(0.09)	(0.03)	(0.20)

Twin	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2
AFR	12.6 x 2	16 x 2	15 x 2	12 x 2	16 x 2	18 x 2	16 x 2
(BF)	(0.12 x 2)	(0.16 x 2)	(0.15 x 2)	(0.12 x 2)	(0.16 x 2)	(0.18 x 2)	(0.12 x 2)

Triple	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3
AFR	12.5 x 3	16 x 3	14 x 3	10 x 3	8.7 x 3	15 x 3	8.7 x 3
(BF)	(0.4 x 3)	(0.15 x 3)	(0.17 x 3)	(0.15 x 3)	(0.17 x 3)	(0.08 x 3)	(0.17 x 3)

Heating

Indoor		Outdoor temperature (°C WB)																	
		-15.0			-10.0			-5.0			0.0			6.0			10.0		
		TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI		
TC	EW		EW		EW		EW		EW		EW		EW		EW		EW		
16	8.58	0.93	9.45	0.99	10.1	1.02	10.4	1.06	12.8	1.12	13.8	1.18	13.8	1.18	13.8	1.18	13.8		
18	8.57	0.97	9.44	1.02	10.0	1.07	10.3	1.10	12.8	1.17	13.8	1.23	13.8	1.23	13.8	1.23	13.8		
20	8.56	1.01	9.43	1.07	10.0	1.11	10.3	1.14	12.8	1.22	13.8	1.28	13.8	1.28	13.8	1.28	13.8		
21	8.56	1.03	9.42	1.09	10.0	1.13	10.3	1.16	12.8	1.24	13.8	1.30	13.8	1.30	13.8	1.30	13.8		
22	8.55	1.04	9.42	1.10	10.0	1.14	10.3	1.18	12.8	1.26	13.8	1.33	13.8	1.33	13.8	1.33	13.8		
24	8.54	1.09	9.41	1.15	10.0	1.19	10.3	1.23	12.8	1.31	13.8	1.38	13.8	1.38	13.8	1.38	13.8		

- The rated power input for each model is mentioned in the table below.

Pair	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P	FCQSH100P
Cooling	2.57	2.38	2.87	2.96	3.16	2.96	2.96	2.84	2.96
Heating	2.51	3.05	2.96	2.99	3.17	2.99	2.99	2.94	2.99

Twin	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2	FCQSH100P x 2
Cooling	2.76	2.93	3.35	3.13	3.15	3.10	3.15
Heating	2.61	2.86	3.28	3.34	3.31	3.27	3.31


Triple	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3	FCQSH100P x 3
Cooling	2.82	2.93	3.33	3.88	3.71	2.90	3.71
Heating	2.66	2.86	3.26	3.04	4.06	3.24	4.06

3D076753F


RZQSG125L9V1

RZQSG125L8Y1

Cooling

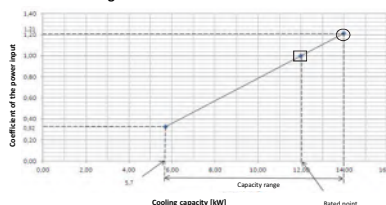

Heating

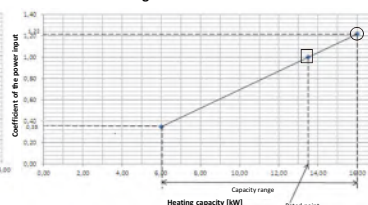

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 PI: Power input [kW]
 compressor + indoor and outdoor fan motors

Cooling

Indoor		Outdoor temperature (°C DB)											
		25			30			35			40		
TC	SHC	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
16.0	22	14.1	9.54	0.99	13.6	9.30	1.09	13.1	9.12	1.19	12.6	8.78	1.29
18.0	25	14.7	9.50	0.99	14.2	9.32	1.09	13.7	9.06	1.20	13.2	8.83	1.31
19.0	27	15.0	9.52	1.00	14.5	9.34	1.10	14.0	9.06	1.20	13.5	8.87	1.31
19.5	27	15.2	9.52	1.00	14.7	9.26	1.11	14.2	9.00	1.20	13.6	8.81	1.31
22.0	30	16.0	9.39	1.00	15.5	9.14	1.11	14.9	8.85	1.21	14.4	8.74	1.32
24.0	32	16.7	9.31	1.01	16.1	9.09	1.12	15.5	8.83	1.23	15.0	8.63	1.33

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- = Maximum at standard conditions
 □ = Rated capacity and rated coefficient of the power input
 The maximum capacity is not guaranteed except at standard conditions.
- SHC is based on indoor units EWB & EDB.
 SHC for other dry-bulb temperatures = SHC + SHC*
 SHC* = SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
- The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0m
- CPI is a percentage value compared to the rated value which is 1.00.
- The error rate for this value is less than 5% and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.
- The air flow rate and bypass factor are mentioned in the table.

Pair	FCQSH125P	FCQSH125P	FCQSH125P	FCQSH125P	FCQSH125P	FCQSH125P	FCQSH125P
AFR	33.5	33.0	39.0	31.0	28.0	31.0	34.0
(BF)	(0.19)	(0.22)	(0.15)	(0.13)	(0.14)	(0.14)	(0.05)

Twin	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2
AFR	13.6 x 2	18 x 2	15 x 2	14.5 x 2	16 x 2	18 x 2	16 x 2
(BF)	(0.2 x 2)	(0.15 x 2)	(0.20 x 2)	(0.13 x 2)	(0.12 x 2)	(0.15 x 2)	(0.12 x 2)

Triple	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3
AFR	12.6 x 3	16 x 3	15 x 3	12 x 3	16 x 3	15 x 3	16 x 3
(BF)	(0.22 x 3)	(0.16 x 3)	(0.18 x 3)	(0.16 x 3)	(0.13 x 3)	(0.13 x 3)	(0.11 x 3)

Double twin	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4
AFR	12.5 x 4	16 x 4	14 x 4	10 x 4	8.7 x 4	15 x 4	8.7 x 4
(BF)	(0.4 x 4)	(0.15 x 4)	(0.17 x 4)	(0.15 x 4)	(0.17 x 4)	(0.08 x 4)	(0.17 x 4)

Pair	FCQSH125P	FCQSH125P	FCQSH125P	FCQSH125P	FCQSH125P	FCQSH125P	FCQSH125P
Cooling	3.71	3.74	3.74	4.15	4.27	4.15	3.72
Heating	3.60	3.96	3.85	3.73	3.96	3.73	4.53

Twin	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2	FCQSH125P x 2
Cooling	3.66	3.95	4.34	4.75	4.98	4.34	4.88
Heating	3.88	4.06	4.43	4.31	4.38	4.34	4.38

Triple	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3	FCQSH125P x 3
Cooling	3.69	3.95	4.31	4.67	4.90	4.67	3.96
Heating	3.90	4.06	4.42	3.87	3.92	4.09	3.92


Double twin	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4	FCQSH125P x 4
Cooling	3.75	3.95	4.31	3.99	4.67	3.95	4.87
Heating	3.96	4.06	4.32	3.59	4.66	4.03	4.66

3D076754H

Capacity tables

6 - 1 Cooling/Heating Capacity Tables

RZQSG140L9V1
RZQSG140LY1

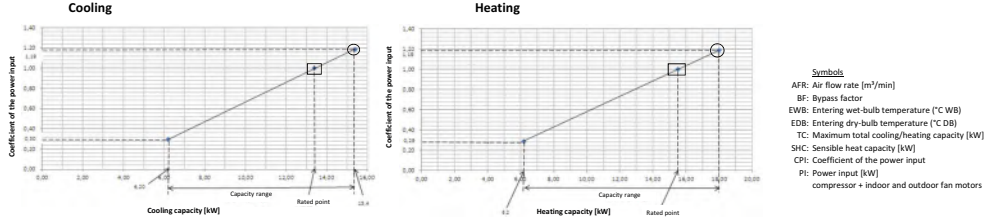

Indoor		Outdoor temperature (°C DB)											
		25			30			35			40		
°C WB	°C DB	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
16.0	22	15.5	10.47	0.98	14.8	10.25	1.08	14.4	10.03	1.18	13.9	9.69	1.28
18.0	25	16.2	10.55	0.98	15.6	10.21	1.09	15.1	10.0	1.19	14.5	9.71	1.30
19.0	27	16.6	10.43	0.99	16.0	10.19	1.09	15.4	9.98	1.19	14.8	9.76	1.30
19.5	27	16.7	10.49	0.99	16.1	10.19	1.10	15.6	10.00	1.19	15.0	9.66	1.30
22.0	30	17.8	10.57	0.99	17.0	10.19	1.10	16.4	9.85	1.21	15.8	9.60	1.31
24.0	32	18.4	10.20	1.00	17.7	10.00	1.11	17.0	9.67	1.22	16.4	9.47	1.32

Indoor		Outdoor temperature (°C WB)											
		-15.0			-10.0			-5.0			0.0		
°C DB	°C WB	TC	GPI	TC	GPI	TC	GPI	TC	GPI	TC	GPI	TC	GPI
16	11.6	0.91	12.7	0.97	13.6	1.00	13.9	1.03	18.0	1.09	19.4	1.16	1.16
18	11.6	0.95	12.7	1.00	13.6	1.04	13.9	1.07	18.0	1.14	19.4	1.21	1.21
20	11.6	0.99	12.7	1.05	13.5	1.09	13.9	1.11	18.0	1.19	19.4	1.25	1.25
21	11.5	1.00	12.7	1.06	13.5	1.11	13.9	1.13	18.0	1.21	19.4	1.28	1.28
22	11.5	1.02	12.7	1.08	13.5	1.12	13.9	1.16	18.0	1.24	19.4	1.30	1.30
24	11.5	1.07	12.6	1.12	13.5	1.17	13.9	1.20	18.0	1.29	19.4	1.35	1.35

- Notes
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - $\bigcirc$ = Maximum at standard conditions
 $\square$ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units EWB & DBB.
SHC for other dry-bulb temperatures = SHC + SHC*
SHC* = SHC correction for other dry-bulb temperatures
= $0.02 \times \text{AFR} (\text{m}^3/\text{min}) \times (1 - \text{BF}) \times (\text{DB}^* - \text{EDB})$
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

9. The rated power input for each model is mentioned in the table below.

Pair		FCQSG140F	FCQSG140F	FRQ140C	FRQSG140C	FRQ140C	FRQ140CA	FRQ140C
AFR	33.5	33.0	39.4/41.8	34.0	30.0	34.0	34.0	34.0
(BF)	(0.15)	(0.23)	(0.14)	(0.17)	(0.18)	(0.17)	(0.17)	(0.18)
Twin		FCQSG140F x 2	FRQ140C x 2	FRQ140C x 2	FRQ140C x 2	FRQ140C x 2	FRQ140C x 2	FRQ140C x 2
AFR	21.2 x 2	21.5 x 2	26.9 x 2	20.5 x 2	18.0 x 2	20.5 x 2	20.5 x 2	20.5 x 2
(BF)	(0.2 x 2)	(0.14 x 2)	(0.08 x 2)	(0.13 x 2)	(0.16 x 2)	(0.13 x 2)	(0.13 x 2)	(0.13 x 2)
Triple		FCQSG140F x 3	FRQ140C x 3	FRQ140C x 3	FRQ140C x 3	FRQ140C x 3	FRQ140C x 3	FRQ140C x 3
AFR	12.6 x 3	16.3	15 x 3	12 x 3	12.7/16.4	15 x 3	12.7/16.4	15 x 3
(BF)	(0.22 x 3)	(0.16 x 3)	(0.18 x 3)	(0.16 x 3)	(0.11 x 3)	(0.13 x 3)	(0.11 x 3)	(0.11 x 3)
Double twin		FCQSG140F x 4	FRQ140C x 4	FRQ140C x 4	FRQ140C x 4	FRQ140C x 4	FRQ140C x 4	FRQ140C x 4
AFR	12.5 x 4	16.4	14 x 4	10 x 4	8.7 x 4	15 x 4	8.7 x 4	8.7 x 4
(BF)	(0.4 x 4)	(0.15 x 4)	(0.20 x 4)	(0.25 x 4)	(0.17 x 4)	(0.08 x 4)	(0.17 x 4)	(0.17 x 4)


Pair		FCQSG140F	FCQSG140F	FRQ140C	FRQSG140C	FRQ140C	FRQ140CA	FRQ140C
Cooling	4.17	4.45	4.44	4.45	4.45	4.45	4.38	4.38
Heating	4.29	4.54	4.54	4.54	4.54	4.54	4.54	4.56
Twin		FCQSG140F x 2	FRQ140C x 2	FRQ140C x 2	FRQ140C x 2	FRQ140C x 2	FRQ140C x 2	FRQ140C x 2
Cooling	4.11	4.39	4.37	4.01	4.23	4.01	4.37	4.37
Heating	4.23	4.48	4.56	4.21	4.52	4.21	4.54	4.54
Triple		FCQSG140F x 3	FRQ140C x 3	FRQ140C x 3	FRQ140C x 3	FRQ140C x 3	FRQ140C x 3	FRQ140C x 3
Cooling	4.40	4.17	4.67	4.43	4.68	4.17	4.68	4.68
Heating	4.48	4.94	5.67	4.39	4.61	4.94	4.61	4.61
Double twin		FCQSG140F x 4	FRQ140C x 4	FRQ140C x 4	FRQ140C x 4	FRQ140C x 4	FRQ140C x 4	FRQ140C x 4
Cooling	4.56	4.17	4.65	4.11	4.80	4.17	4.80	4.80
Heating	4.54	4.94	5.57	4.05	4.69	4.94	4.69	4.69

3D076755D

6 Capacity tables

6 - 2 Capacity Correction Factor

RZQSG-L(8)Y1

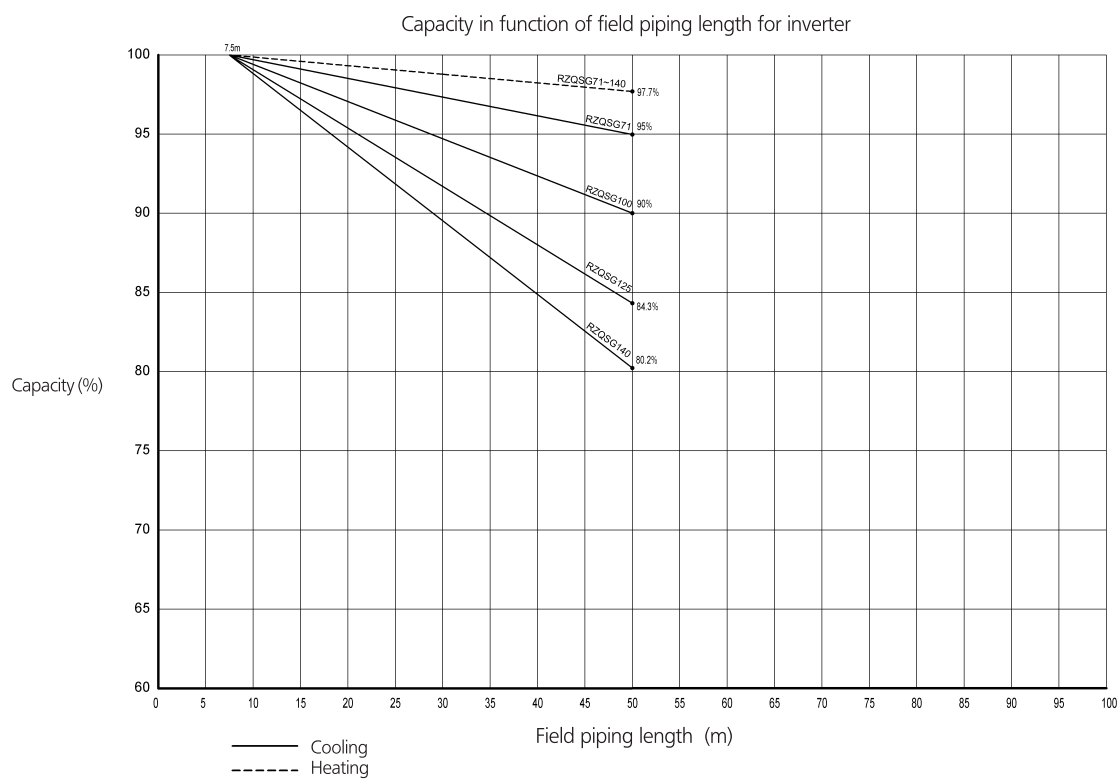


3D076247A


7 Dimensional drawings

7 - 1 Dimensional Drawings

RZQSG100-125L8Y1

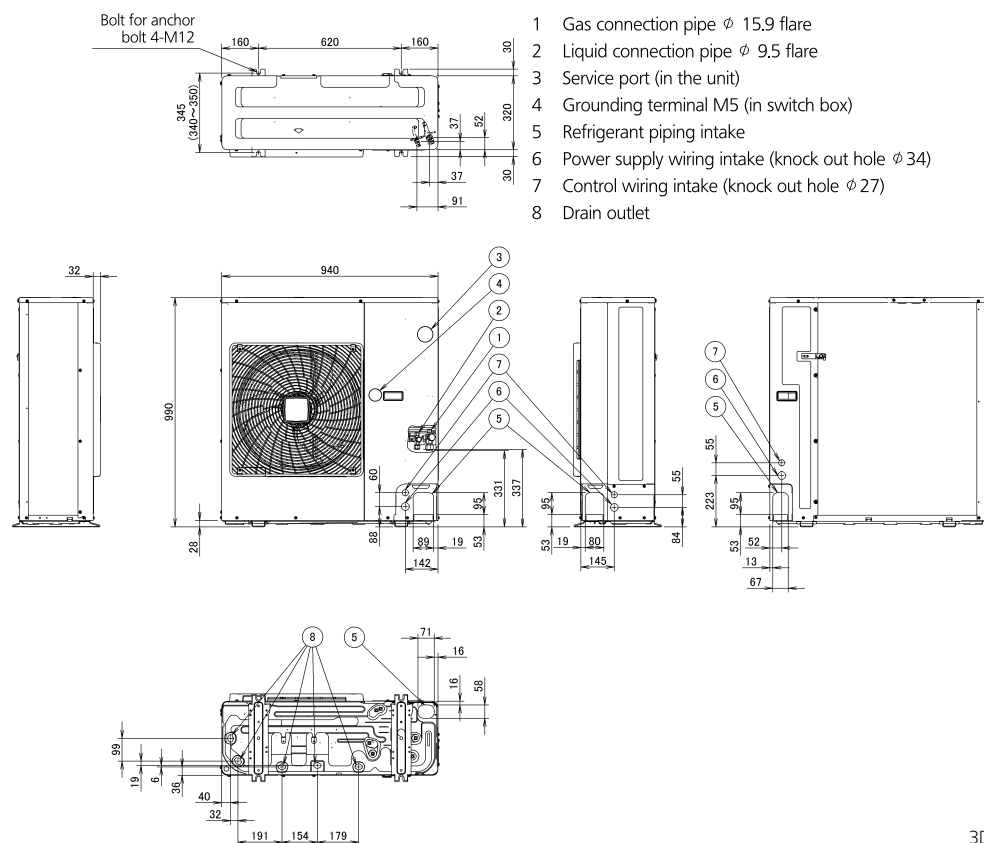

RZQSG140LY1

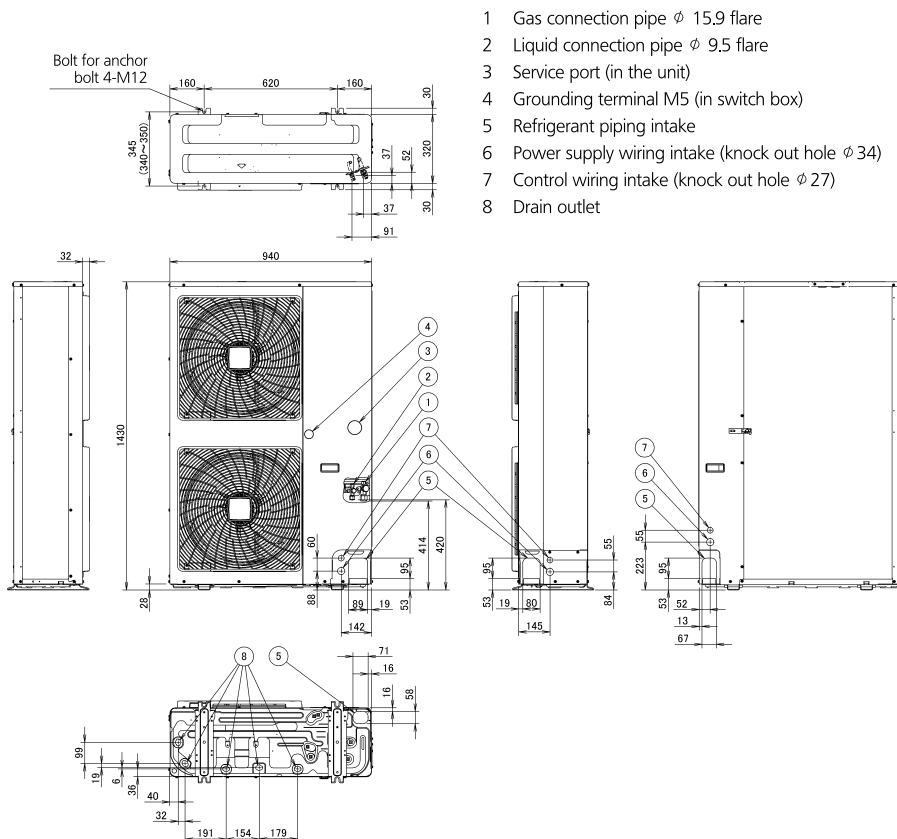


8 Centre of gravity

8 - 1 Centre of Gravity


8

RZQSG100-125L8Y1

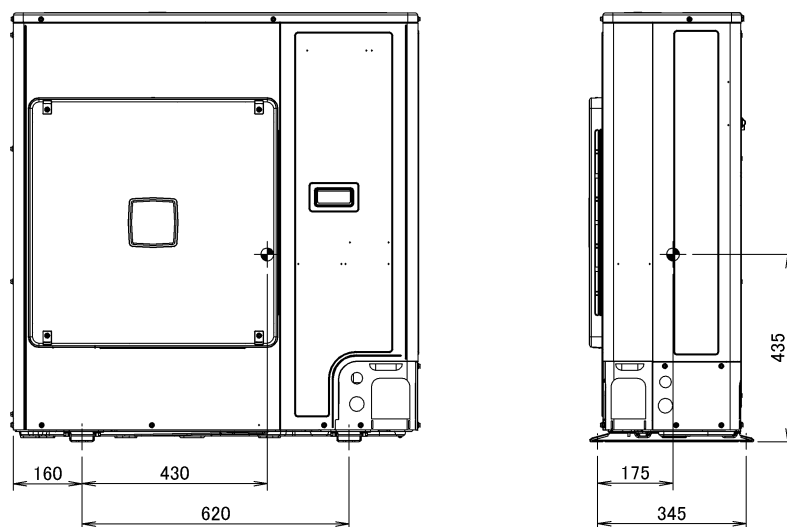

4D077809


RZQSG140LY1

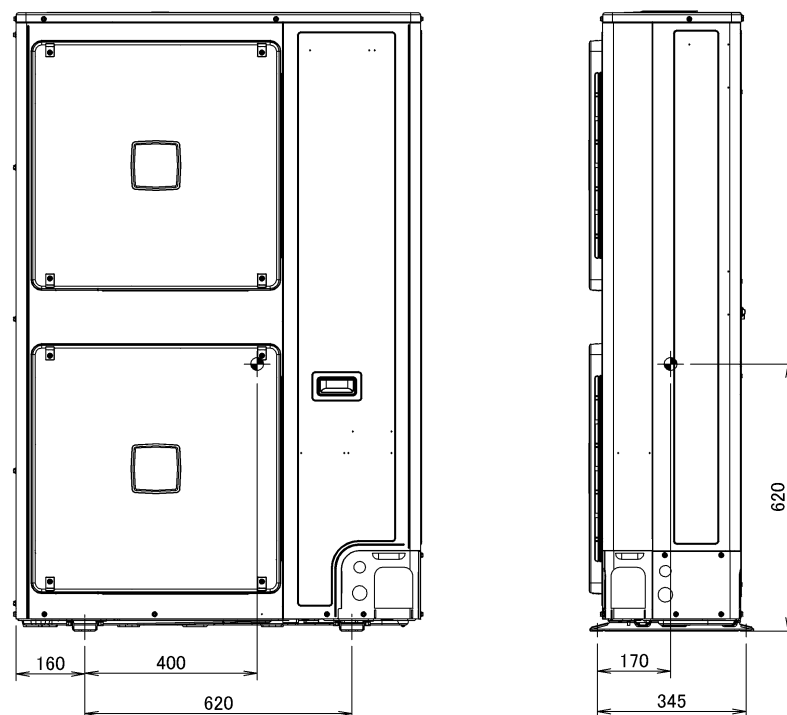

4D077808

9 Piping diagrams


9 - 1 Piping Diagrams

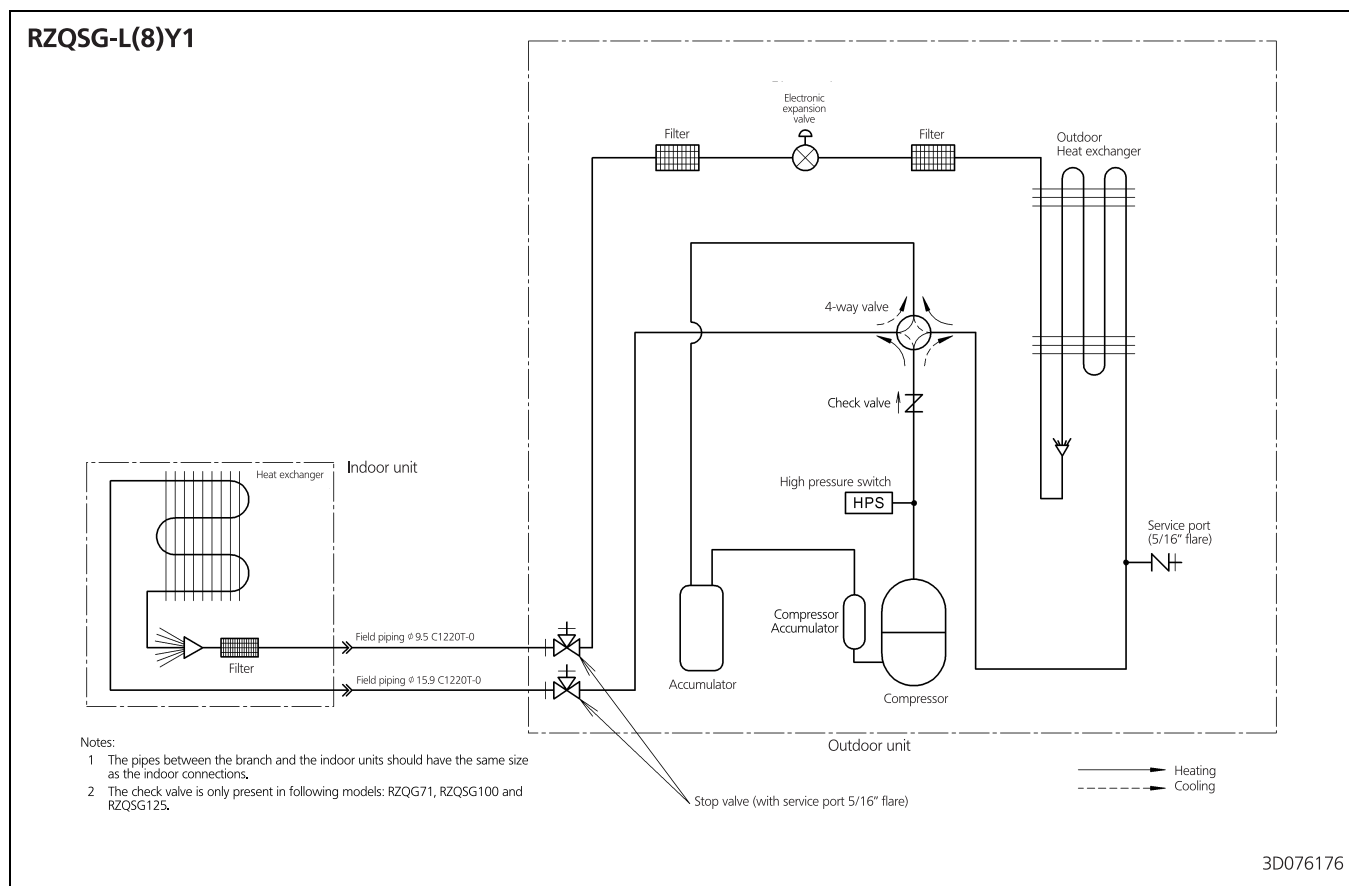

9 Piping diagrams

9 - 2 Piping Diagram Twin Application


9

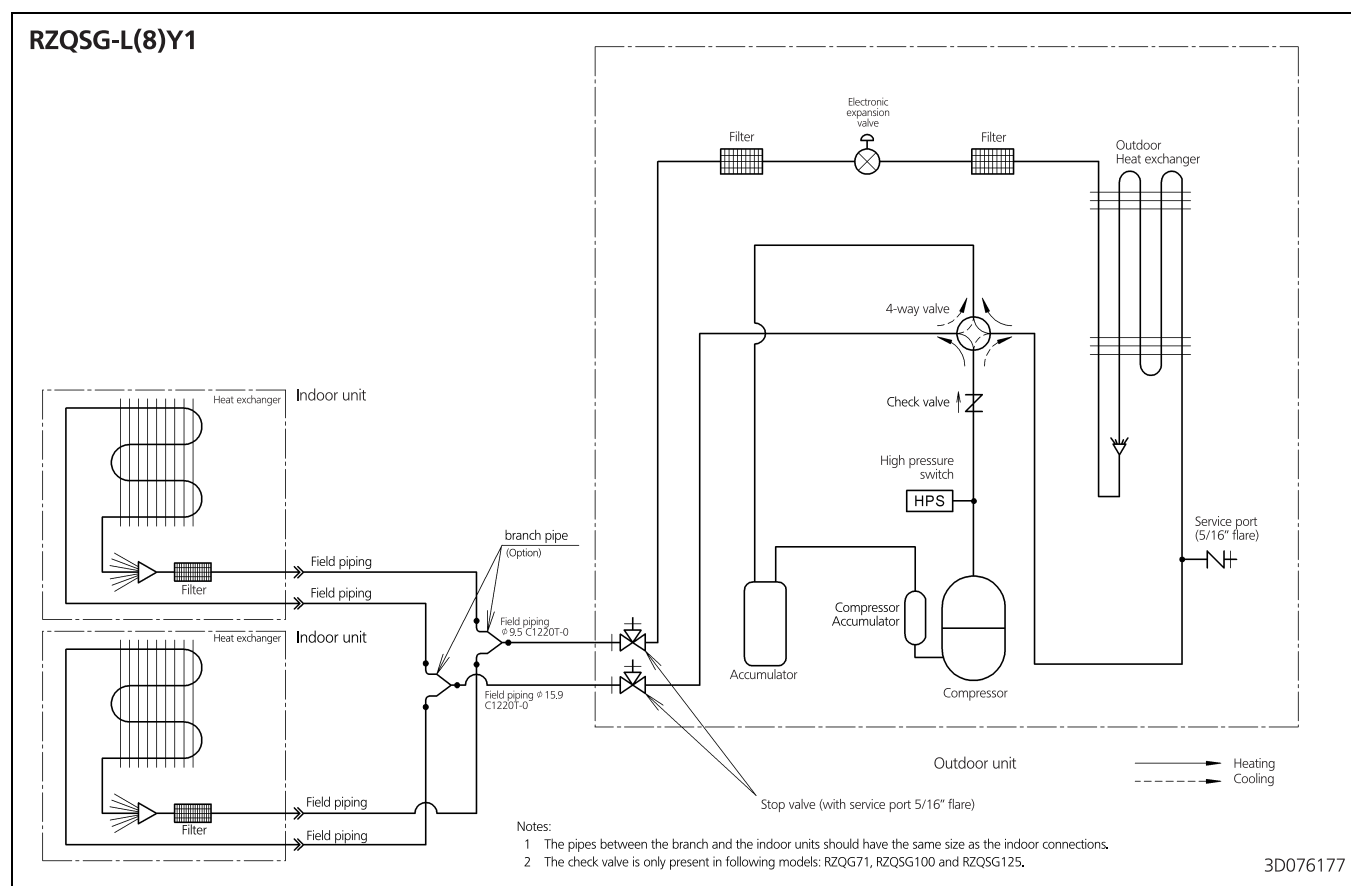

9 Piping diagrams

9 - 3 Piping Diagram Triple Application

RZQSG-L(8)Y1

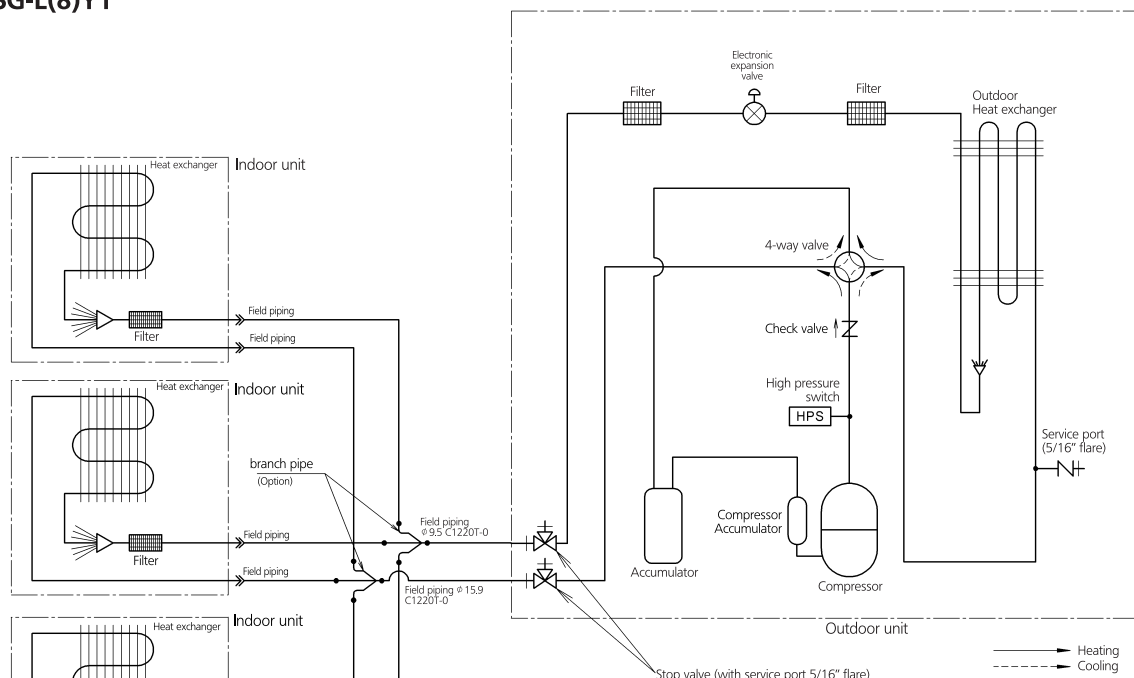

Notes:


- 1 The pipes between the branch and the indoor units should have the same size as the indoor connections.
- 2 The check valve is only present in following models: RZQSG100 and RZQSG125.

3D076178

9 Piping diagrams

9 - 4 Piping Diagram Double Twin Application

RZQSG125-140L(8)Y1

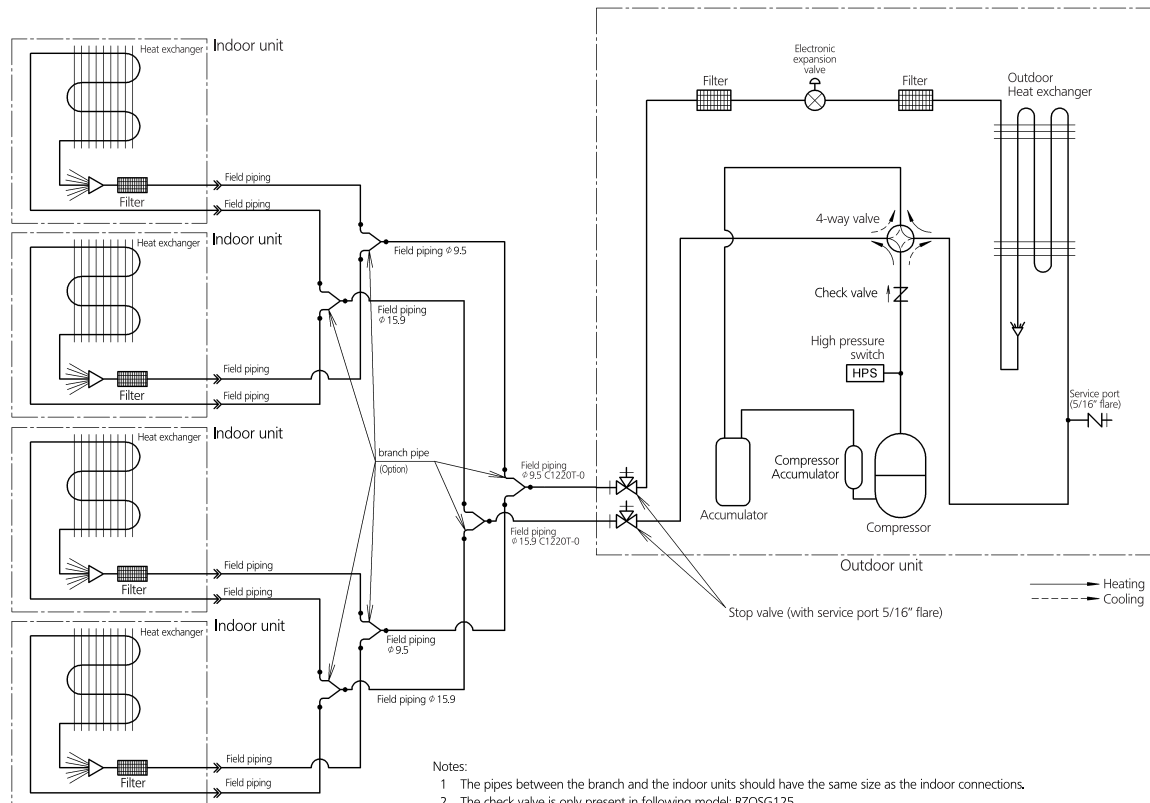


3D076179

10 Wiring diagrams

10 - 1 Wiring Diagrams - Three Phase

RZQSG100-125L8Y1

- A1P : Printed circuit board
A2P : Printed circuit board (Inverter)
BS1-BS2 : Push button switch
C1-C3 : Capacitor
DS1 : Dip switch
ETH : Bottomplate heater (Option)
F1U : Fuse (31.5A / 250V)
F2U : Fuse (31.5A / 250V)
F3U-F6U : Fuse (6.3A / 250V)
F7U-F8U : Fuse (1.0A / 250V)
F1U (A2P) : Fuse (5.0A / 250V)
H1P-H7P : Light emitting diode (service monitor orange)
HAP (A1P/A2P) : Light emitting diode (service monitor green)
K1M : Magnetic contactor
K1R (A1P) : Magnetic relay (Y1S)
K1R (A2P) : Magnetic relay
K2R (A1P) : Magnetic relay (E1H Option)
K2R (A2P) : Magnetic relay
L1R : Reactor
M1C : Motor (compressor)
M1F : Motor (fan) (upper)
M2F : Motor (fan) (lower)
PS : Switching power supply
Q1DI : Earth leakage breaker (30mA)
R1-R3 : Resistor
R1T : Thermistor (air)
R2T : Thermistor (discharge)
R3T : Thermistor (Suction)
R4T : Thermistor (Heat exchanger)
R5T : Thermistor (Heat exchanger middle)
R6T : Thermistor (liquid)
R10T : Thermistor (fin)
S1PH : Pressure switch (High)
V1R : IGBT Power module
V2R, V3R : Diode module
X6A : Connector (Option)
X1M : Terminal strip
Y1E : Electronic expansion valve
Y1S : Solenoid valve (4 way valve)
Z1C-Z5C : Noise filter (ferrite core)
Z1F-Z3F : Noise filter
- L: Live
N: Neutral
PE: Protective earth (screw)
PE: Noiseless earth
○: Terminal
●: Connection
□: Terminal strip
□: Connector
→: Relay connector
---: Option
- BLK: Black
BLU: Blue
BRN: Brown
GRN: Green
ORG: Orange
RED: Red
WHT: White
YLW: Yellow

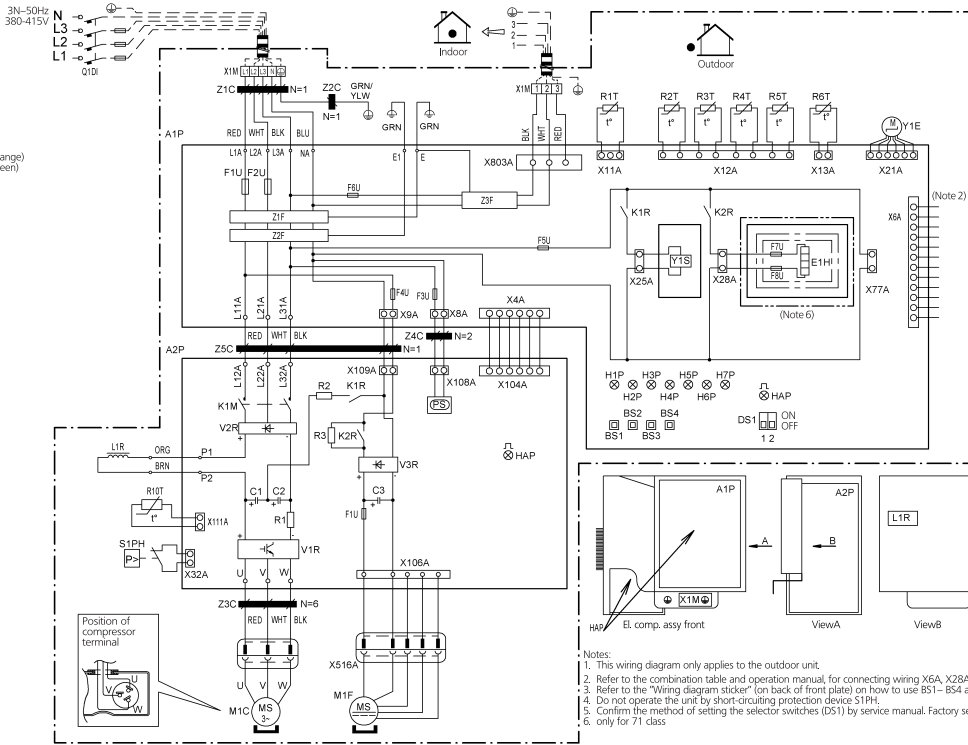


- Notes:
1. This wiring diagram only applies to the outdoor unit.
2. Refer to the combination table and operation manual, for connecting wiring X6A, X28A and X77A.
3. Refer to the "Wiring diagram sticker" (on back of front plate) on how to use BS1-BS4 and DS1 switch.
4. Do not operate the unit by short-circuiting protection device S1PH.
5. Confirm the method of setting the selector switches (DS1) by service manual. Factory setting of all switches: "OFF".
6. only for 71 class

2D080114B

RZQSG140LY1

- A1P : Printed circuit board
A2P : Printed circuit board (Inverter)
BS1-BS2 : Push button switch
C1-C3 : Capacitor
DS1 : Dip switch
ETH : Bottomplate heater (Option)
F1U : Fuse (31.5A / 250V)
F2U : Fuse (31.5A / 250V)
F3U-F6U : Fuse (6.3A / 250V)
F7U-F8U : Fuse (1.0A / 250V)
F1U (A2P) : Fuse (5.0A / 250V)
H1P-H7P : Light emitting diode (service monitor orange)
HAP (A1P/A2P) : Light emitting diode (service monitor green)
K1M : Magnetic contactor
K1R (A1P) : Magnetic relay (Y1S)
K1R (A2P) : Magnetic relay
K2R (A1P) : Magnetic relay (E1H Option)
K2R (A2P) : Magnetic relay
L1R : Reactor
M1C : Motor (compressor)
M1F : Motor (fan) (upper)
M2F : Motor (fan) (lower)
PS : Switching power supply
Q1DI : Earth leakage breaker (30mA)
R1-R3 : Resistor
R1T : Thermistor (air)
R2T : Thermistor (discharge)
R3T : Thermistor (Suction)
R4T : Thermistor (Heat exchanger)
R5T : Thermistor (Heat exchanger middle)
R6T : Thermistor (liquid)
R10T : Thermistor (fin)
S1PH : Pressure switch (High)
V1R : IGBT Power module
V2R, V3R : Diode module
X6A : Connector (Option)
X1M : Terminal strip
Y1E : Electronic expansion valve
Y1S : Solenoid valve (4 way valve)
Z1C-Z5C : Noise filter (ferrite core)
Z1F-Z3F : Noise filter
- L: Live
N: Neutral
PE: Protective earth (screw)
PE: Noiseless earth
○: Terminal
●: Connection
□: Terminal strip
□: Connector
→: Relay connector
---: Option
- BLK: Black
BLU: Blue
BRN: Brown
GRN: Green
ORG: Orange
RED: Red
WHT: White
YLW: Yellow

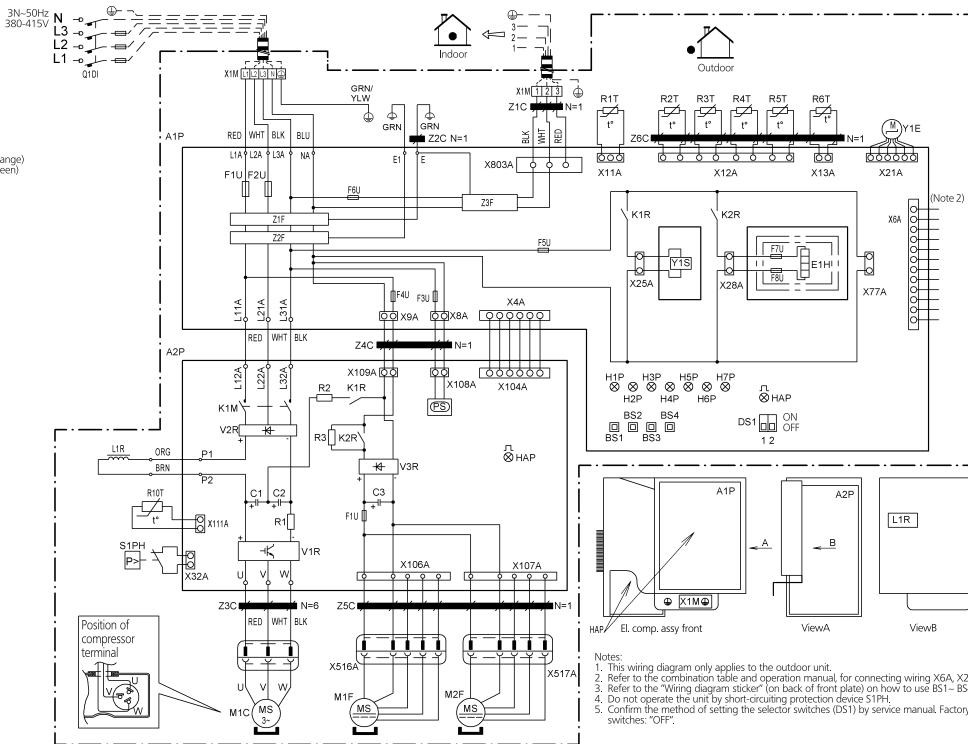

- Notes:
1. This wiring diagram only applies to the outdoor unit.
2. Refer to the combination table and operation manual, for connecting wiring X6A, X28A and X77A.
3. Refer to the "Wiring diagram sticker" (on back of front plate) on how to use BS1-BS4 and DS1 switch.
4. Do not operate the unit by short-circuiting protection device S1PH.
5. Confirm the method of setting the selector switches (DS1) by service manual. Factory setting of all switches: "OFF".


2D077192A

11 Sound data

11 - 1 Sound Power Spectrum

11

RZQSG100L8Y1

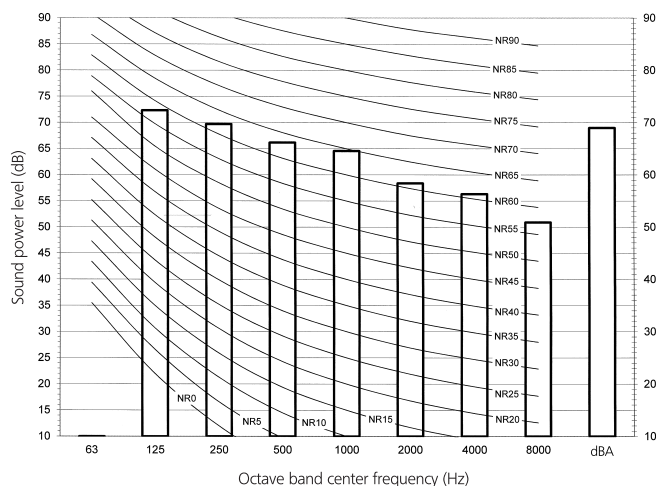


NOTES

- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity 0 dB = $10E-6\mu W/m^2$
- 3 Measured according to ISO 3744

3D077783

RZQSG125L8Y1

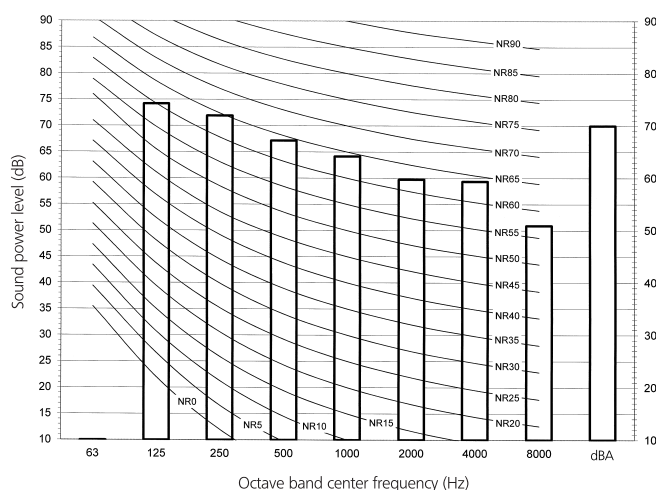

NOTES


- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity 0 dB = $10E-6\mu W/m^2$
- 3 Measured according to ISO 3744

3D077784

11 Sound data

11 - 1 Sound Power Spectrum

RZQSG140LY1

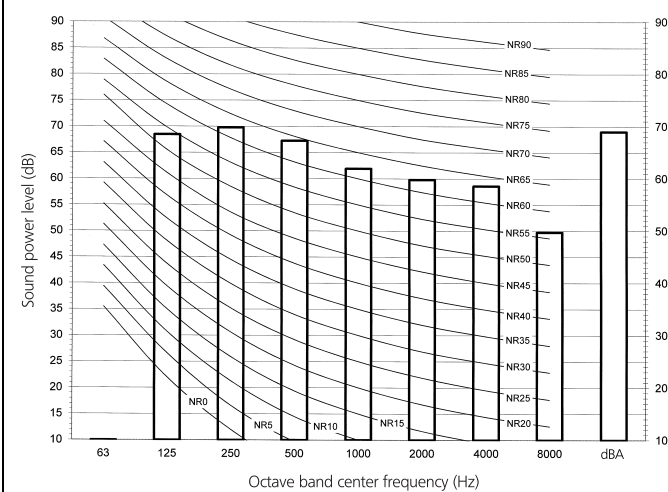

NOTES



- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity $0 \text{ dB} = 10^{-6} \text{ W/m}^2$
- 3 Measured according to ISO 3744

3D077785

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling


11

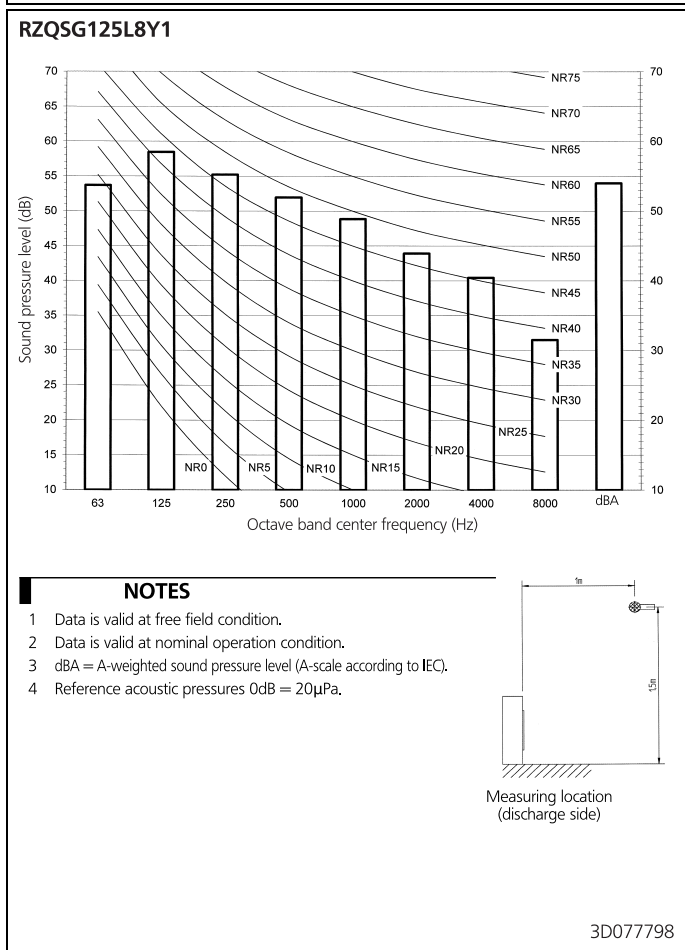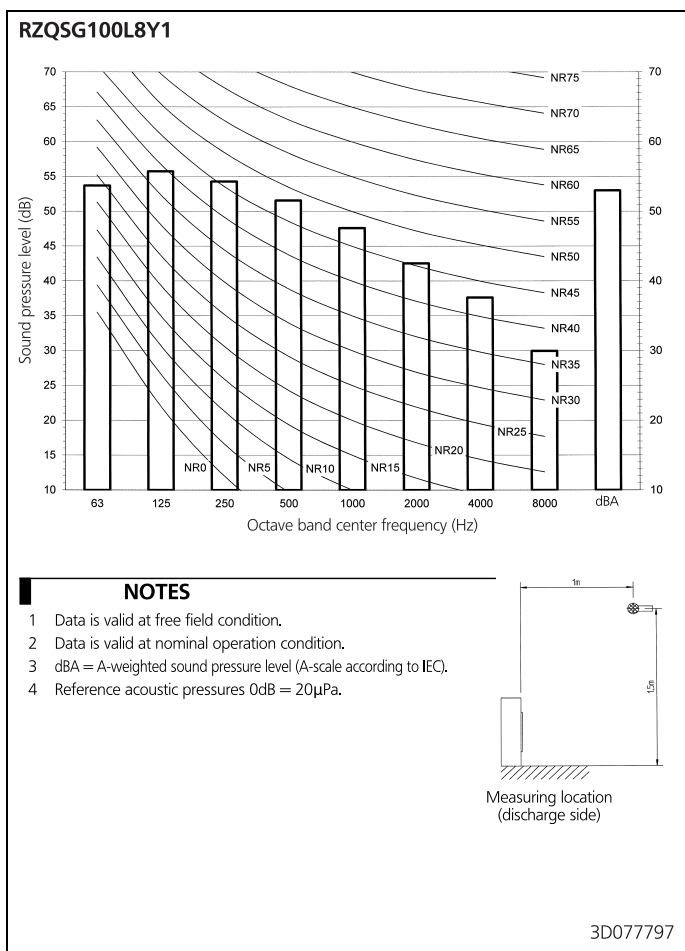

11 Sound data


11 - 2 Sound Pressure Spectrum - Cooling

RZQSG140LY1

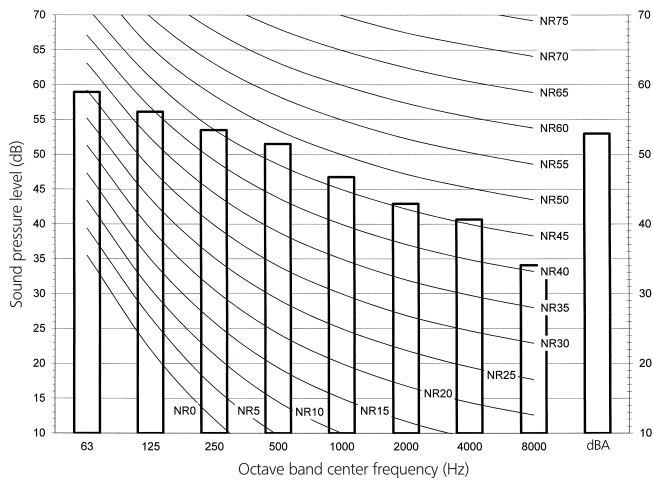

NOTES

- 1 Data is valid at free field condition.
- 2 Data is valid at nominal operation condition.
- 3 dBA = A-weighted sound pressure level (A-scale according to IEC).
- 4 Reference acoustic pressures 0dB = 20μPa.





3D077799

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating


11

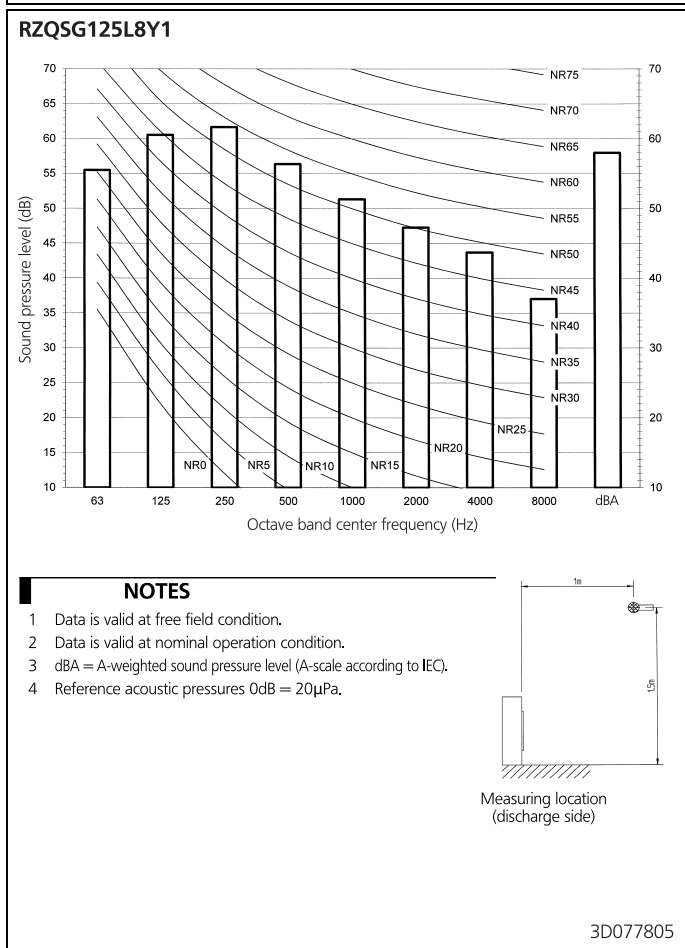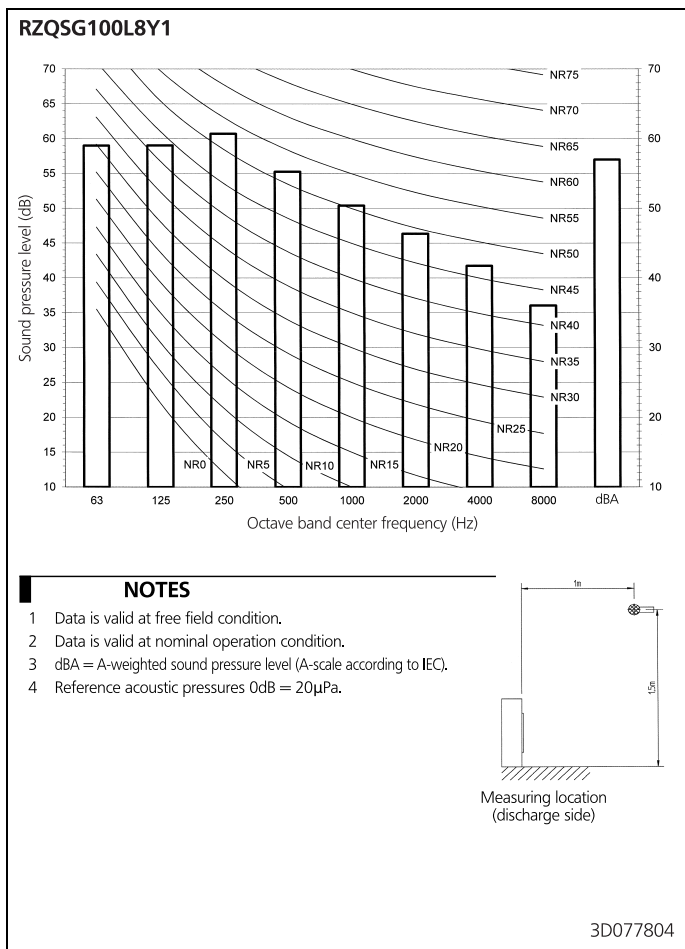

11 Sound data


11 - 3 Sound Pressure Spectrum - Heating

RZQSG140LY1

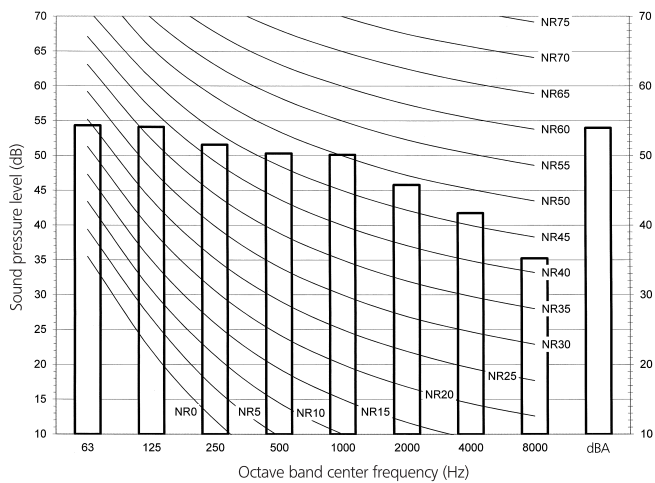

NOTES

- 1 Data is valid at free field condition.
- 2 Data is valid at nominal operation condition.
- 3 dBA = A-weighted sound pressure level (A-scale according to IEC).
- 4 Reference acoustic pressures 0dB = 20μPa.




3D077806

11 Sound data



11 - 4 Sound Pressure Spectrum Quiet Mode

11

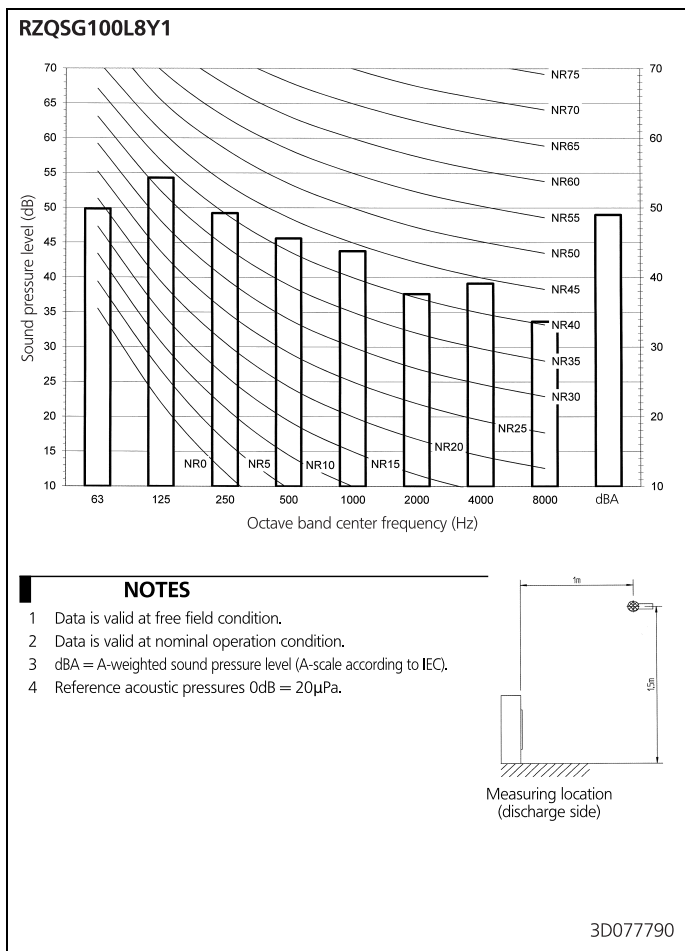


NOTES

- 1 Data is valid at free field condition.
- 2 Data is valid at nominal operation condition.
- 3 dBA = A-weighted sound pressure level (A-scale according to IEC).
- 4 Reference acoustic pressures 0dB = 20μPa.

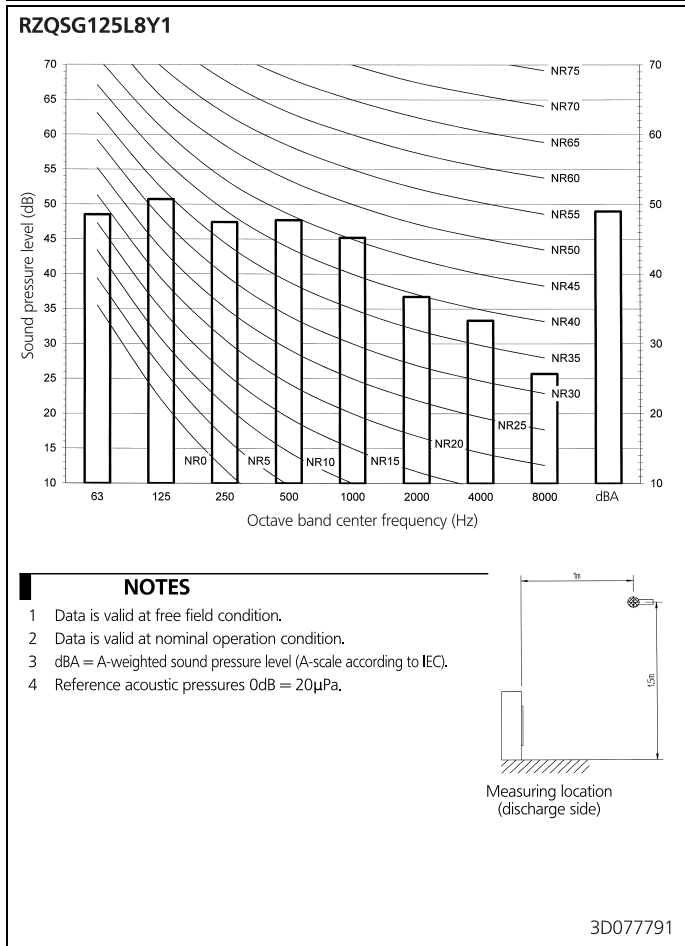

NOTES


- 1 Data is valid at free field condition.
- 2 Data is valid at nominal operation condition.
- 3 dBA = A-weighted sound pressure level (A-scale according to IEC).
- 4 Reference acoustic pressures 0dB = 20μPa.



11 Sound data


11 - 4 Sound Pressure Spectrum Quiet Mode

RZQSG140LY1

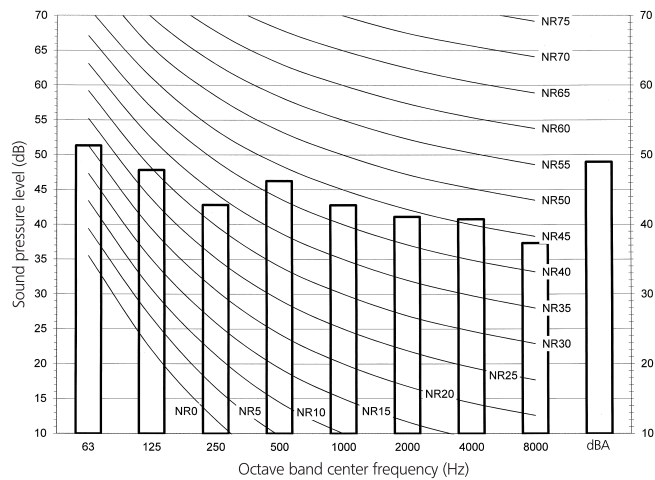

NOTES

- 1 Data is valid at free field condition.
- 2 Data is valid at nominal operation condition.
- 3 dBA = A-weighted sound pressure level (A-scale according to IEC).
- 4 Reference acoustic pressures 0dB = 20μPa.



3D077792

12 Installation

12 - 1 Installation Method

RZQSG-L(8)Y1


Installation service space

The measure of these values is "mm".


(A) When there are obstacles on suction sides.

• No obstacle above


- ① Stand-alone installation
- Obstacle on the suction side only



- Obstacle on both sides and suction side, too




- ② Series installation (2 or more) (Note 1)
- Obstacle on the suction side and both sides

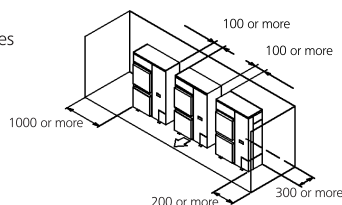


• Obstacle above, too.


- ① Stand-alone installation
- Obstacle on the suction side, too



- Obstacle on both sides and suction side, too





- ② Series installation (2 or more) (Note 1)
- Obstacle on the suction side and both sides

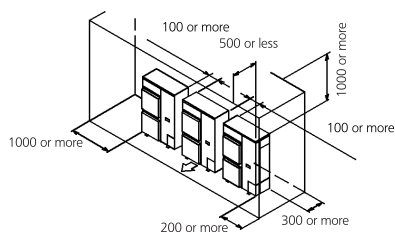

(B) When there are obstacles on discharge sides.


• No obstacle above

- ① Stand-alone installation
- Obstacle on the discharge side only
- ② Series installation (2 or more) (Note 1)
- Obstacle on the discharge side only

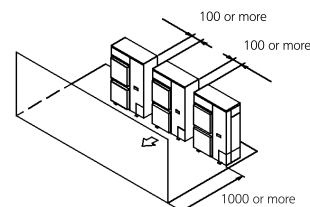


• Obstacle above, too

- ① Stand-alone installation
- Obstacle on the discharge side only, too



- ② Series installation (2 or more) (Note 1)
- Obstacle on the discharge side

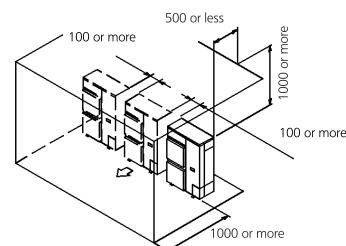


(C) When there are obstacles on both suction and discharge sides.:

Pattern 1


When the obstacles on the discharge side is higher than the unit. ($L > H$)
(There is no limit for the height of obstructions on the suction side.)

• No obstacle above

- ① Stand-alone installation
- No obstacle above



- ② Series installation (2 or more) (Note 1)
- No obstacle above

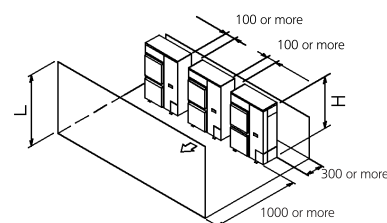

3D069554

12 Installation

12 - 1 Installation Method


RZQSG-L(8)Y1

● Obstacle above, too

- ① Stand-alone installation (Note 2)
- When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	750 or more
	$1/2 H < L \leq H$	1000 or more
$L > H$	Set the stand as: $L \leq H$ Refer to the column of $L \leq H$ for A	



- ② Series installation (2 or more) (Note 1, 2)
- When there are obstacles on suction, discharge and top sides.


The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	1000 or more
	$1/2 H < L \leq H$	1250 or more
$L > H$	Set the stand as: $L \leq H$ Refer to the column of $L \leq H$ for A	

Limit of series installation is 2 units.


Pattern 2

When the obstacle on the discharge side is lower than the unit ($L \leq H$)
(There is no limit for the height of obstructions on the suction side.)



● No obstacle above


- ① Stand-alone installation
- No obstacle above



- ② Series installation (2 or more) (Note 1)
- When there are obstacles on both suction and discharge sides.

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	250 or more
	$1/2 H < L \leq H$	300 or more

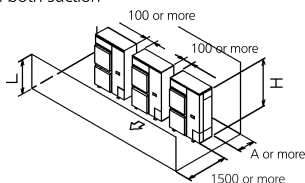


● Obstacle above, too

- ① Stand-alone installation (Note 2)
- When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	100 or more
	$1/2 H < L \leq H$	200 or more
$L > H$	Set the stand as: $L \leq H$ Refer to the column of $L \leq H$ for A	




- ② Series installation (2 or more) (Note 1, 2)
- When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.


	L	A
$L \leq H$	$L \leq 1/2 H$	250 or more
	$1/2 H < L \leq H$	300 or more
$L > H$	Set the stand as: $L \leq H$ Refer to the column of $L \leq H$ for A	

Limit of series installation is 2 units.




(D) Double-decker installation

- ① Obstacle on the discharge side. (Note 1)
- Do not exceed two levels for stacked installation.
 - Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
 - Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.




- ② Obstacle on the suction side. (Note 1)
- Do not exceed two levels for stacked installation.
 - Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
 - Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.



(E) Multiple rows of series installation (on the rooftop, etc.)


- ① One row of stand-alone installation

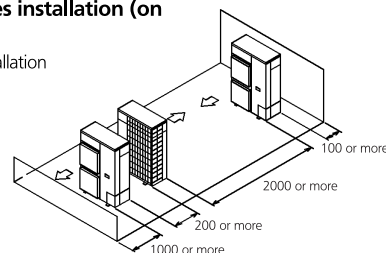

- ② Rows of series installation (2 or more)

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$	250 or more
	$1/2 H < L \leq H$	300 or more
$L > H$	Can not be installed	

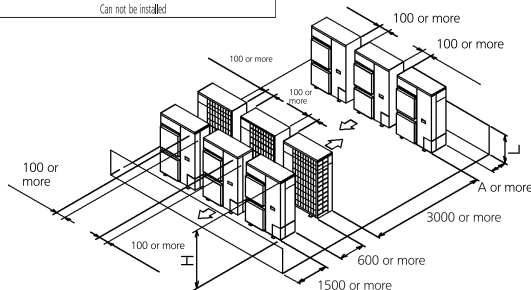

NOTES



- In case of the sideways piping, make a 100mm gap between the unit above.
- Close the bottom of the installation frame to prevent the discharged air from being bypassed.
- It is not necessary to install a roof cover if there is no danger of drainage dripping and freezing. In this case, the space between the upper and lower outdoor units should be at least 100mm. (Close off the gap between the upper and lower units so there is no re-intake of discharged air.)

3D069554

13 Operation range

13 - 1 Operation Range

RZQSG-L(8)Y1

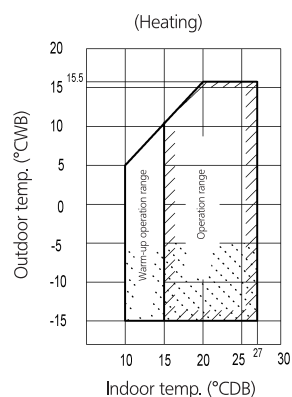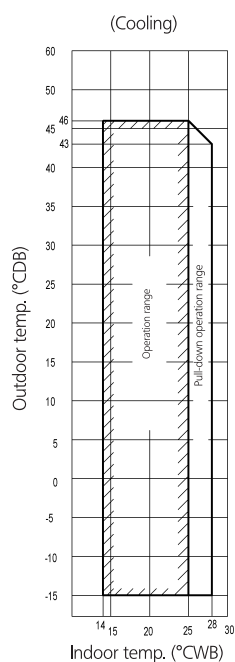


Notes:

- 1 Depending on operation and installation conditions, the outdoor unit can change over to defrost operation (anti freeze-up).
- 2 To reduce the defrost operation (anti freeze-up) frequency it is recommended to install the outdoor unit in a location not exposed to wind.
- 3 In case of high humidity conditions (>92%) in this operation area, an RZQG model should be used instead of an RZQSG model. This to avoid freeze-up of the outdoor unit.

3D086703

Daikin Europe N.V. Naamloze Vennootschap - Zandvoordestraat 300, B-8400 Oostende - Belgium - www.daikin.eu - BE 0412 120 336 - RPR Oostende



EEEN16A

XXX-07/16



Daikin Europe N.V. participates in the Eurovent Certification programme for Liquid Chilling Packages (LCP), Air handling units (AHU), Fan coil units (FCU) and variable refrigerant flow systems (VRF) Check ongoing validity of certificate online: www.eurovent-certification.com or using: www.certiflash.com



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.